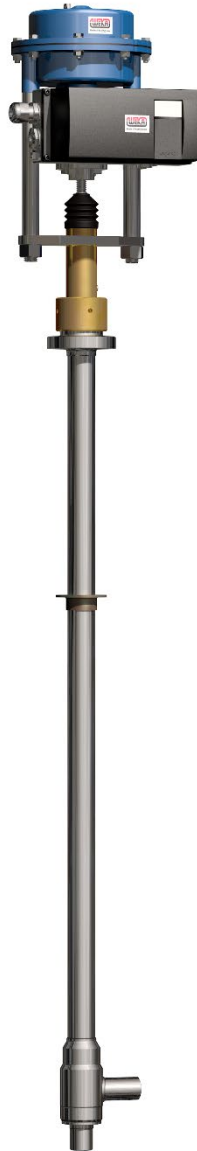


Cryogenic Valves Type -TxV, -WxV



Installation, Operating, and Maintenance Manual

Document number C-0059

Table of contents

1.	General information.....	3
1.1	Applicability	3
1.2	Contact data	3
1.3	Further applicable documents.....	3
1.4	Storage place of the manual.....	3
2.	Safety	4
2.1	General safety information	4
2.2	Explanations of symbols and notes.....	4
2.3	Intended use.....	5
2.4	Incorrect use.....	5
2.5	Residual risks	6
2.6	Qualification of personnel	6
2.7	Operator's obligation to exercise due diligence.....	6
2.8	Personal protection equipment.....	7
3.	Transport, storage and packaging	7
3.1	Transport.....	7
3.2	Storage	7
3.3	Packaging.....	7
3.4	Disposal of the packaging.....	7
4.	Cleanliness	8
5.	Designation of the valve components	9
6.	Installation, assembly and disassembly of valves.....	10
6.1	General information.....	10
6.2	Installation position	10
6.3	Installation welding of the housing.....	10
6.4	Allow piping loads and deflection.....	13
6.5	Valve disassembly and assembly	14
6.5.1	Disassembly of the Hlc or Hlcp drive unit	15
6.5.2	Disassembly of the HL drive unit	18
6.5.3	Disassembly of the PM drive, vonRohr type	22
6.5.4	Disassembly of the PM drive, Samson type	32
6.5.5	Disassembly of the PM drive, Sart-von-Rohr type for TbxV/WbxV or TcxV/WcxV valves	37
6.5.6	Disassembly of a TxV DNxx/PNxx valve.....	41
6.5.7	Disassembly of a TbxV/WbxV DNxx/PNxx valve.....	47
6.5.8	Disassembly of a TcxV/WcxV DNxx/PNxx valve.....	53
6.5.9	Replacing a control cone	58
6.5.10	Assembly of a TxV DNxx/PNxx valve.....	62
6.5.11	Assembly of a TbxV/WbxV DNxx/PNxx valve	70
6.5.12	Assembly of a TcxV/WcxV DNxx/PNxx valve	76
6.5.13	Assembly of the Hlc or Hlcp drive unit.....	82
6.5.14	Assembly of the HL drive unit.....	85
6.5.15	Setting of the preload pressure.....	90
6.5.16	Assembly of the PM drive, vonRohr type.....	93
6.5.17	Assembly of the PM drive, Samson type.....	106
6.5.18	Assembly of the PM drive, Sart-von-Rohr type for TbxV/WbxV or TcxV/WcxV valves	111
6.5.19	Replacing the seals.....	115

7.	Marking.....	119
8.	Commissioning and operation.....	119
8.1	General information.....	119
8.2	Manually actuated valves.....	120
8.3	Pneumatic valves	121
8.4	Electrical and pneumatic additional components	122
8.4.1	Attaching and adjusting inductive sensors.....	122
8.5	Operation Conditions	125
9.	Maintenance	126
9.1	General information.....	126
9.2	Orifice hole	126
10.	Spare parts	127
11.	Disassembly and disposal	127
12.	Declarations of conformity.....	128

1. General information

The present operating manual contains instructions for safe and correct installation, start-up / operation and maintenance of the product. The present operating manual is exclusively intended for specifically trained and authorised experts. In case of problems that cannot be resolved with the help of the present operating manual, please contact the manufacturer. The product is subject to technical change at any time.

1.1 Applicability

The present operating manual applies to cryogenic valves of type -TxV and -WxV with nominal widths from DN2 to DN150 and pressure levels up to PN40, equipped with manual actuators or pneumatic diaphragm actuators.

1.2 Contact data

For more information on the product, please contact

WEKA AG

Schürlistrasse 8
CH-8344 Baeretswil

T: +41 44 833 43 43

F: +41 43 833 43 49

info@weka-ag.ch

www.weka-ag.ch

1.3 Further applicable documents

In addition to the present manual, the technical drawing of the valve, the documentation of additional components, and, if available, the respective device certificate shall be taken into account.

1.4 Storage place of the manual

The operating manual and all other applicable documents are integral parts of the product and must be kept in proximity of the product and be accessible to the staff at all times.

2. Safety

2.1 General safety information

The operating manual contains detailed descriptions for safe and correct installation, start-up / operation and maintenance of the product.

- Read this manual carefully and thoroughly to familiarise yourself with the product.
- The information in the present chapter is of particular importance and must be heeded.

2.2 Explanations of symbols and notes

Safety information and warnings are intended to prevent hazards for the life and health of users or maintenance staff and to avoid property damage. They are highlighted by the signal words defined below. In addition, they are marked by warning symbols (pictograms) at the place they appear. The signal words used have the following meanings:

Safety information and warnings indicate important information. The following symbols are used to point out specific properties or hazards.

Danger

Death, severe physical injuries and/or major property damage will occur in case that the appropriate precautionary measures are not taken or not complied with.



Warning

Death, severe physical injuries and/or major property damage may occur in case that the appropriate precautionary measures are not taken or not complied with.



Caution

Minor physical injuries and/or property damage may occur in case that the appropriate precautionary measures are not taken or not complied with.



Please note

Represents important information on the product and/or handling of the product that requires specific attention.



Ex

For equipment intended for use in potentially explosive atmospheres in accordance with the European directive 2014/34/EU (ATEX)

This information is applicable in addition to all other information.



2.3 Intended use

At the time of delivery, the product complies with all applicable laws, regulations, and standards.

If the product is used as intended and the warnings in this manual and those at the product are complied with, the product does not pose any hazards or risks for persons, property, and the environment. This applies to the entire service life of the product, from delivery and installation to operation, and to disassembly and disposal.

The following is considered intended use:

- Only operate the product according to the present operating manual, the specifications from our order confirmation, the technical drawing, and, if available, the device certificate.
- Only use original WEKA spare parts for maintenance and repair of the product.

The following must be ensured prior to all and any maintenance work:

- Depressurise the pipe.
- The pipe must be completely drained and, in case of hazardous media, purged with suitable cleaning liquids.
- Obtain information about potential hazards that may occur due to residues of the operating medium and take appropriate measures (wearing personal protection equipment, etc.).
- If required, the fitting must be cooled down or heated up to ambient temperature.
- Interrupt the auxiliary energy of the actuator and move the actuator to its home position.
- Prevent potential re-start of the system by third parties.
- We hereby explicitly point out that any regulations for potentially explosive systems and devices must be heeded, as required.



Ex

- The valve may only be used for the purposes recorded on the technical drawing and the marking on the product.
- The valve may only be installed, commissioned and maintained by a trained professional with expertise in explosion prevention.
- The valve may only be repaired and modified by the manufacturer (or, if appropriate, in consultation with the notified body).



Oxygen

Oxygen valves may only be operated in the permitted operating range. Exceeding the allowed pressure or oxygen concentration can lead to total damage.



2.4 Incorrect use

Any use of the product other than or not within the specifications as described in chapter 2.3 is considered incorrect. The following additionally applies:

- Any unauthorised modifications of the product may result in personal injuries, property damage and/or functional defects. The risk for any such situation is solely borne by the user. Any warranty or liability claims are excluded.

2.5 Residual risks

Residual risks may still be present even when the product is used as intended.

- Hazard due to crushing by non-secured drives.

In case of negligent or incorrect use of personal protection equipment:

- Hazard due to noise resulting in loss of hearing.
- Thermal hazard (burns, scalding, etc.)
- Hazard due to escape of operating medium

Despite all precautions taken, there may be residual risks that are not obvious. Residual risks can be minimised if the safety information and information on commissioning and start-up, as well as the entire operating manual is observed.

2.6 Qualification of personnel

The product is exclusively intended for application within systems and facilities where the required work is performed by trained and qualified experts. Experts are persons who are familiar with installation, commissioning and operation of this product and who have the appropriate qualifications for their tasks, e.g.

- vocational training or instructions with regard to use and care of appropriate safety equipment on the basis of the current state of safety engineering.
- First-aid training.
- For systems with explosion protection equipment: vocational training or instructions and/or authorisation to perform work at potentially explosive systems.

Maintenance and repair work must only be performed by trained and qualified professionals. Work at electrical systems may only be performed by qualified electricians or by persons who have received instructions on electro-technical systems.

Ex

The valve may only be installed, commissioned and maintained by a trained professional with expertise in explosion prevention.



2.7 Operator's obligation to exercise due diligence

To prevent accidents, faults and damage to the environment, the person respectively responsible for transport, commissioning/start-up, operation, maintenance, and disposal of the product must ensure the following:

- All warnings and information on hazards must be observed.
- The personnel must be instructed with regard to occupational health and safety, the operating manual and particularly the contained safety information on a regular basis.
- Regulations and operating instructions for workplace safety and the relevant information with regard to personnel conduct in case of accidents or fires must be kept in an easily accessible place or hung up within the premises in an easily visible manner.
- The product must only be operated in perfect and functional condition.
- Only use spare parts as well as lubricants and operating media that are approved by the manufacturer.
- Observe the specified operating conditions and requirements for the place of installation.
- Provide all necessary devices and the personal protection equipment required for the respective work tasks.

- The specified maintenance intervals see Maintenance chapter, and the corresponding regulations must be observed.
- Have installation, commissioning/start-up and maintenance of the product performed only by trained and qualified personnel according to this operating manual.
- The operator must ensure use of the product as intended.
- Prior to commissioning of the product, the operator shall carry out a risk assessment and define appropriate inspection and maintenance intervals according to the operating conditions.

2.8 Personal protection equipment

Wearing of personal protection equipment is required during work to minimise potential health hazards.

- The protective equipment required for the respective kinds of work must always be worn.
- The information and instructions on personal protection equipment displayed in the work area must be observed.

3. Transport, storage and packaging

3.1 Transport

The cryogenic valves are transported either in wooden boxes or in conventional packaging and must be kept in the original WEKA packaging throughout the transport. Transport below $-40\text{ }^{\circ}\text{C}$ and/or above $+80\text{ }^{\circ}\text{C}$ and humidity of 5% to 95% is not permitted.



3.2 Storage

The cryogenic valves must be stored in a dry and dust-free environment. Storage below $-40\text{ }^{\circ}\text{C}$ and/or above $+80\text{ }^{\circ}\text{C}$ and humidity of 5% to 95% is not permitted.



3.3 Packaging

Every cryogenic valve is separately packed in one or more PE bags, either as one complete unit (housing with insert and drive completely mounted) or as individual units (housing, insert, drive, additional components). The valve inlet and outlet are sealed by protective caps. To avoid unnecessary contamination, the packaging should only be removed shortly before the product is needed for installation.

3.4 Disposal of the packaging

Protect the environment and dispose of the packaging material properly or recycle it. Observe the applicable local disposal regulations.

4. Cleanliness

Prior to being packed, the cryogenic valves are cleaned according to ISO23208, to be oil- and grease-free for cryogenic applications. Particularly during installation, cleanliness must be ensured. Even the smallest contaminations may impair the function and/or tightness of the valves.

The following rules must be observed during installation and maintenance.

- The valve inlet and outlet must be sealed by protective caps.
- Disassembled components, such as drives or inserts must be stored in PE bags in a dry and dust-free place.
- Open valve housings must be protected from ingress of particles and other kinds of contamination after removing the insert.

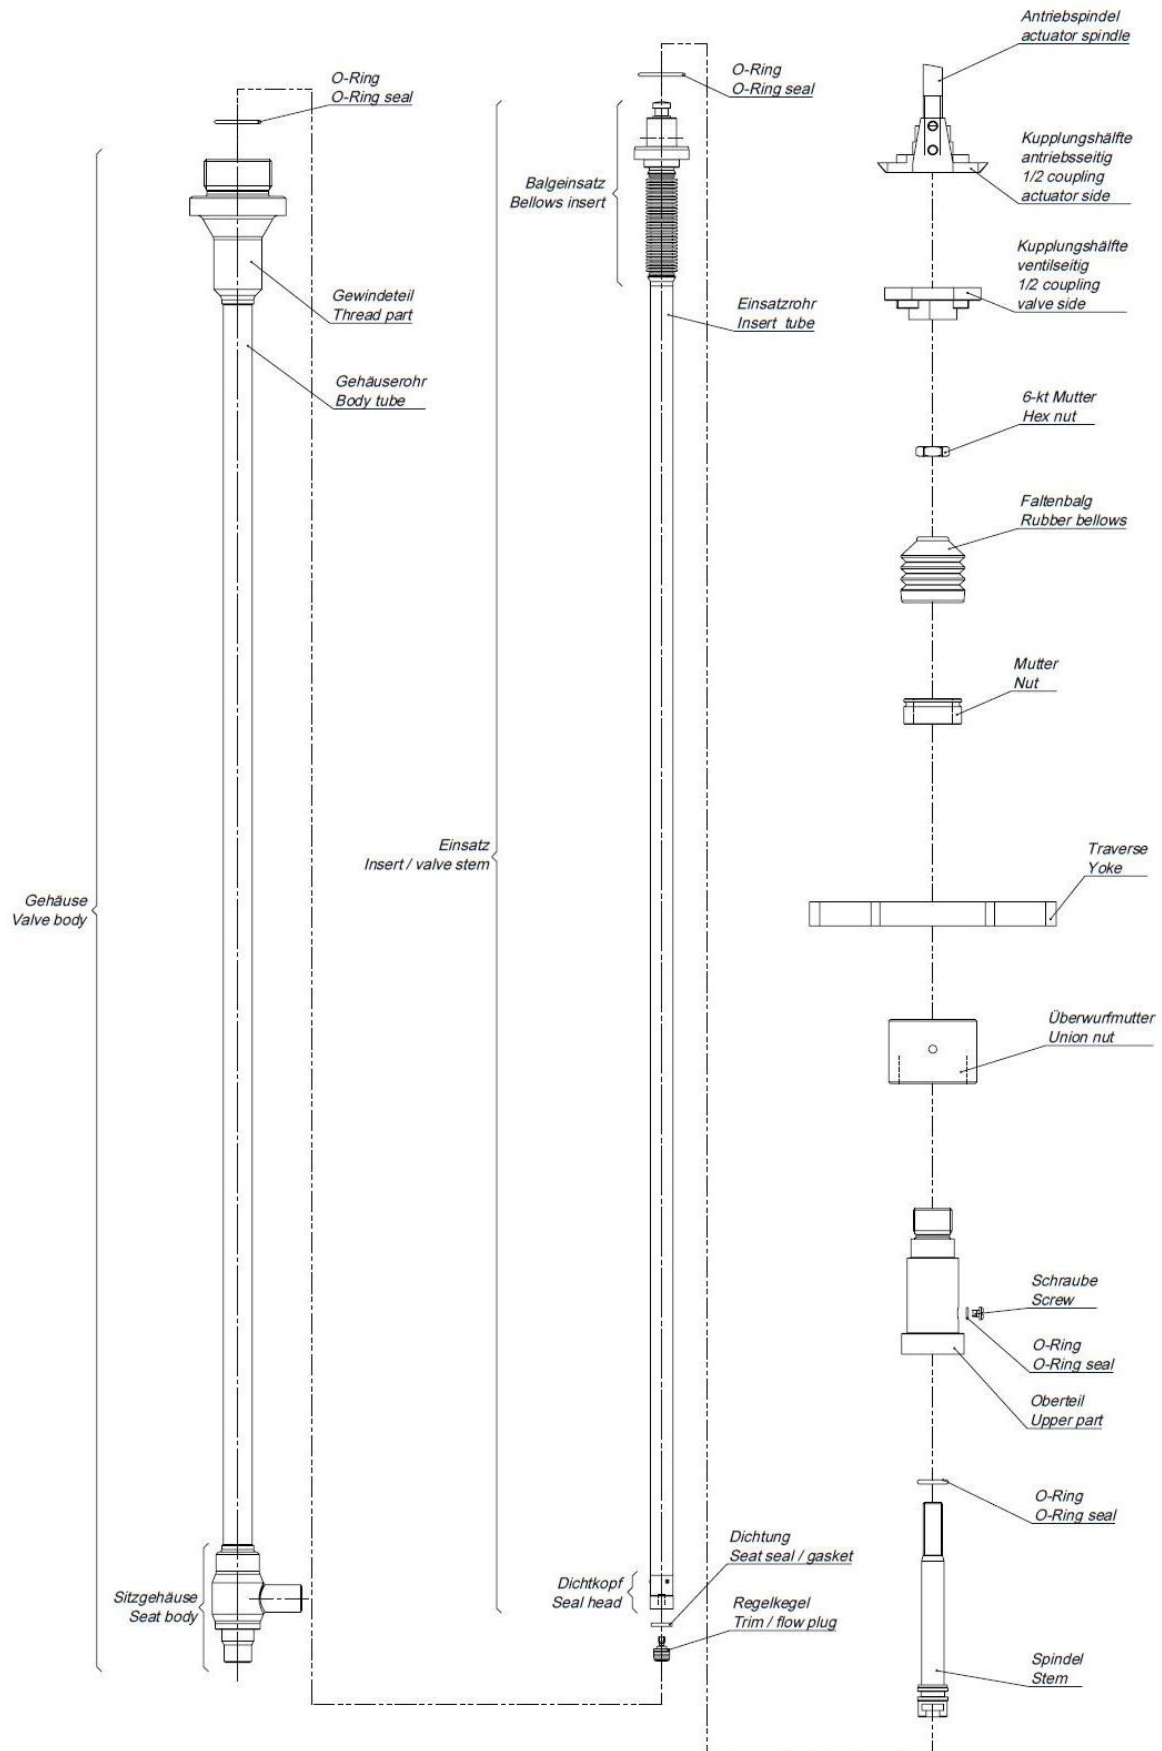


Oxygen

Valves for oxygen service require special attention for assembly and disassembly. Dirt or the wrong equipment can lead to total damage. Cleaning according to WEKA specification no. 20150055 or similar must be observed



5. Designation of the valve components



6. Installation, assembly and disassembly of valves

6.1 General information

For installation of the valves into the pipe or into the vacuum box, we recommend disassembling the drives and valve inserts according to chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve. This is to prevent damage to seals by welding heat and also to ensure better manual handling and alignment. It must be ensured that insert and drive unit are stored packed in a dry and dust-free place.

Ex

- The valve may only be used for the purposes recorded on the technical drawing and the marking on the product.
- The valve may only be installed, commissioned and maintained by a trained professional with expertise in explosion prevention.
- The valve may only be repaired and modified by the manufacturer (or, if appropriate, in consultation with the notified body).
- Falling parts (screws, flanges, etc.) may create impact sparks and lead to an explosion in potentially explosive atmospheres. Make sure that there isn't a potentially explosive atmosphere and that no parts are falling when working on the valve.



6.2 Installation position

The valves shall preferably be installed in vertical position with the drive unit on top. Deviation from the vertical axis is generally possible up to angles of +/- 45°; however, this changes the heat influx.

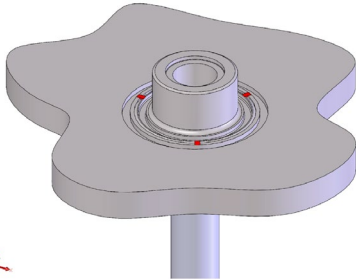
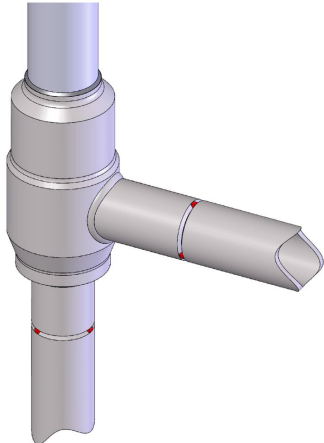
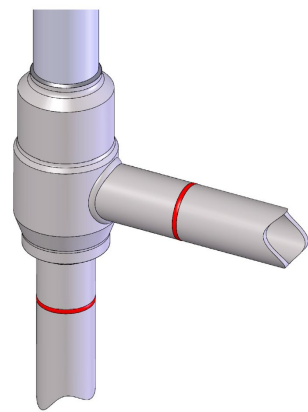
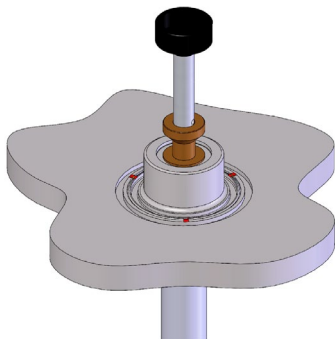
The valve housings must be installed into the pipe and vacuum insulation completely free of tension. Excessive transverse stresses caused by the pipe may impair valve function. Any bending or shearing stresses during or after welding should be avoided.

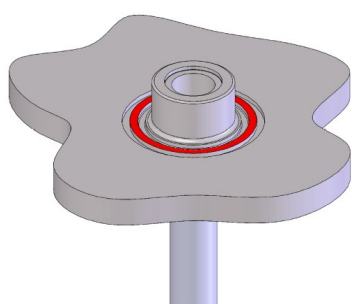
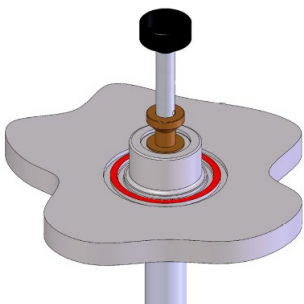
6.3 Installation welding of the housing

Valves must be carefully welded in by spot welding and minimum energy input to avoid deformation due to thermal distortion at the valve housing. The valve housing may be cooled with a damp cloth during welding. After spot welding, it is recommended to first weld on the fluid pipes and then the vacuum flange.

Ensure cleanliness during work. Contamination at the valve seat or the guide areas may be the reason for malfunction or functional failure of the valve.

After welding, the valve spindle insert must turn smoothly in the housing without any noticeable resistance. For this test, DN2-65 straightness test mandrels of appropriate nominal width (**WEKA art. no. 42363 DN2-15, 44686 DN20-65**) can be used. This protects the original inserts and their control cones. If a straightness test mandrel fits into the housing, this guarantees friction-free installation of the original insert! Also, the opening and closing movement by hand with the upper part mounted must be possible without noticeable frictional resistance.

Step	Picture	Description
1		Fix the threaded part in the valve plate with 3 welding spots.
2		Spot-welding of pipes with 3 spots around the circumference.
3		Weld the pipes with as low heat input as possible. If required, cool with a damp cloth.
4		If available, straightness test mandrels can be used for valves up to DN65 to check the housing for distortion. If distortion is present, the test mandrel cannot be easily turned in the housing; in that case, the tack welding spots must be disconnected at the threaded part so that the tension of the housing is released. Then, the housing can be re-checked using the straightness test mandrel.

5		Now weld another 3-6 tack sports at the threaded part and subsequently carefully finish the weld joint. 
6		Check the housing again for distortion using the straightness test mandrel. Then, the matching insert can be carefully placed into the housing. Inserts with nominal widths DN6-15 should be easy to turn in the housing, DN20 and higher should be easy to extend and retract in different positions.

Additional tips for reducing welding heat:

For welding procedure 141, TIG welding:

- Ensure low heat input
- For sockets with 2mm wall thickness, use approx. 48-52 amps.
- The diameter of the filler wire should be 1-2mm

These values are only intended as guidelines. Depending on the welder and the welding process, the values need to / may be adjusted.

Shielding gas:

The flow direction of the shielding gas should always be from the valve into the pipe.

- Welding at the seat socket: The shielding gas input must be from the output socket
- Welding at the output socket: The shielding gas input must be from the seat socket

Welding sequence:

First, weld 2 quarters of the circumference on opposite sides. Leave to cool. Then, weld the rest.

Oxygen

Valves for oxygen service require special attention for assembly and disassembly. Dirt or the wrong equipment can lead to total damage. Cleaning according to WEKA specification no. 20150055 or similar must be observed



6.4 Allow piping loads and deflection

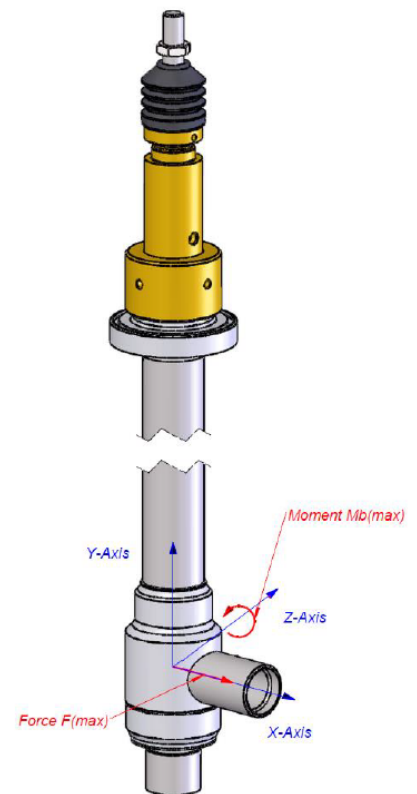
The following table (WEKA spec. 20100223) shows the permitted pipe forces F (max) and moments Mb (max) allowed to act on the valve. Based on the forces and moments, the maximum deflection (r-max) calculated for a valve. The permissible forces and moments with deviating cryolength can be determined on the basis of the radiation set become.

WEKA Specification no. 20100223 - Allowed Piping Loads - Allowed Displacement

Rev A. Jan 2019 - MBh / Page 1 of 1

- Assumed maximum additional stress on valve body due to loads introduced by piping load/misalignments: $<70...75\text{N/mm}^2$
- Considering max additional stress above max radius of misalignments on angel body axis crossing $r<3.0\text{mm}$ with assumed cryogenic length $h=875\text{mm}$. Max value of r is depending on valve size and cryogenic length, see table following.
- Following values are for reference only. Misalignments higher then r-max as indicated above may affecting proper valve function and may bending the valve stem as well!

Size DN	Pressure PN	Outside Dia. body tube mm	Wall thickness body tube mm	Moment of inertia of area I mm ⁴ *10E3	Section modulus Wb mm ³ *10E3	r-max for reference only! mm	Cryogenic length mm	E N/mm ²	F(max) kN	Mb(max) Nm*1E3	eb(max) N/mm ²
DN2	PN25	14.0	1.00	0.9	0.1	3.0	875.0	205'000	0.002	0.002	16.87
DN4	PN25	14.0	1.00	0.9	0.1	3.0	875.0	205'000	0.002	0.002	16.87
DN6	PN25	14.0	1.00	0.9	0.1	3.0	875.0	205'000	0.002	0.002	16.87
DN8	PN25	16.0	1.00	1.3	0.2	3.0	875.0	205'000	0.004	0.003	19.28
DN10	PN25	18.0	1.00	1.9	0.2	3.0	875.0	205'000	0.005	0.005	21.69
DN15	PN25	24.0	1.00	4.8	0.4	3.0	875.0	205'000	0.013	0.012	28.92
DN20	PN25	32.5	1.00	12.3	0.8	3.0	875.0	205'000	0.034	0.030	39.16
DN25	PN25	38.0	1.20	23.5	1.2	3.0	875.0	205'000	0.065	0.057	45.79
DN32	PN25	43.5	1.50	43.7	2.0	3.0	875.0	205'000	0.120	0.105	52.41
DN40-rb	PN25	48.3	1.60	64.1	2.7	3.0	875.0	205'000	0.176	0.154	58.20
DN40	PN25	55.2	2.00	118.4	4.3	3.0	875.0	205'000	0.326	0.285	66.51
DN50	PN25	68.2	2.00	228.1	6.7	2.5	875.0	205'000	0.523	0.458	68.48
DN65	PN25	85.8	2.50	568.0	13.2	2.0	875.0	205'000	1.043	0.912	68.92
DN80	PN10	99.6	2.60	932.5	18.7	1.7	875.0	205'000	1.455	1.273	68.00
	PN25	101.6	3.60	1'332.4	26.2	1.7	875.0	205'000	2.079	1.819	69.37
DN100	PN10	121.0	2.50	1'634.4	27.0	1.9	1'000.0	205'000	1.910	1.910	70.69
	PN25	121.0	4.00	2'518.7	41.6	1.9	1'000.0	205'000	2.943	2.943	70.69
DN125	PN10	139.7	2.60	2'632.1	37.7	1.7	1'000.0	205'000	2.752	2.752	73.03
	PN25	141.3	3.40	3'503.4	49.6	1.7	1'000.0	205'000	3.663	3.663	73.86
DN150	PN10	168.3	2.60	4'646.3	55.2	2.0	1'200.0	205'000	3.307	3.969	71.88
	PN25	168.3	4.00	6'970.9	82.8	2.0	1'200.0	205'000	4.962	5.954	71.88
DN200	PN10	219.1	2.90	11'510.7	105.1	1.5	1'200.0	205'000	6.145	7.374	70.18
DN250	PN10	273.0	2.90	22'443.0	164.4	1.3	1'200.0	205'000	9.984	11.981	72.87
DN250-rb	PN10	306.0	3.00	32'775.7	214.2	1.4	1'400.0	205'000	10.284	14.398	67.21
DN300	PN10	323.9	3.20	41'452.4	256.0	1.4	1'400.0	205'000	13.007	18.209	71.14
DN400	PN10	408.0	4.00	103'587.3	507.8	1.2	1'400.0	205'000	26.699	37.379	73.61



6.5 Valve disassembly and assembly

The work must be performed in a clean environment using suitable tools.

All disassembled parts must be taken to a clean place directly after disassembly and protected by means of a plastic bag to avoid contamination or damage.

Prior to beginning of the work, it must first be determined which type of drive and which nominal width is involved (see technical drawing of the valve). The work steps must be adjusted to the drive type and the nominal width.

In case that additional components, such as switches, sensors or other elements are installed at the drive units, these do not necessarily need to be disassembled beforehand. However, WEKA AG recommends disassembling them to avoid damage and minimise the risk of injury.

Tools

The required tools are listed in the respective chapters. Special tools or special auxiliary agents can be ordered from WEKA AG. They are not included in the scope of delivery.



Previous knowledge

A certain amount of previous knowledge of mechanical handling is mandatory to prevent damage to the valve. Tightening of fasteners, such as screws and nuts, must be performed according to generally applicable mechanical engineering guidelines.



Risk of injury

During certain work steps, parts are put into movement under great use of force. To avoid injuries, act with special care and caution. Also, some components may be very heavy. If possible, handling such components should be carried out using a crane.



Training

WEKA AG offers training courses in addition to this operating manual; participants receive valuable advice to make their work and specific work steps easier.



Ex

Falling parts (screws, flanges, etc.) may create impact sparks and lead to an explosion in potentially explosive atmospheres. Make sure that there isn't a potentially explosive atmosphere and that no parts are falling when working on the valve.



Oxygen

Valves for oxygen service require special attention for assembly and disassembly. Dirt or the wrong equipment can lead to total damage. Only BAM-tested (approved for the area of application) seals or equipment are permitted. Cleaning according to WEKA specification no. 20150055 or similar must be observed.



6.5.1 Disassembly of the Hlc or Hlcp drive unit

Required tools and auxiliary agents

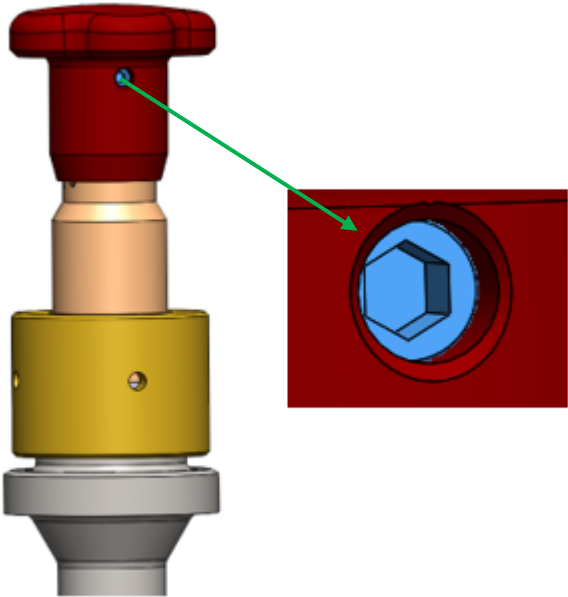
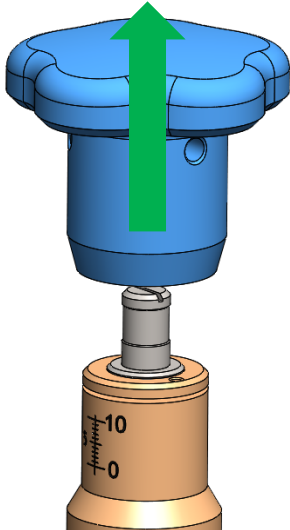
DN2 to DN15

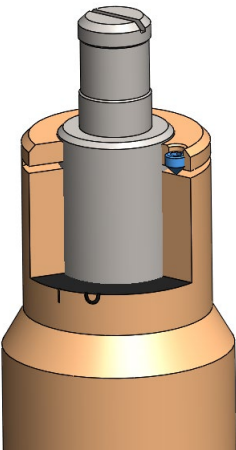
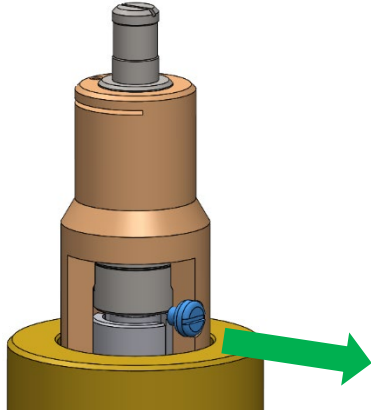
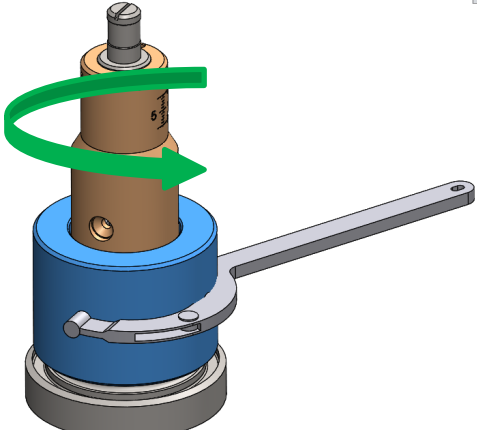
Allen-type wrench, 3mm

Allen-type wrench, 1.5mm (for Hlcp version only)

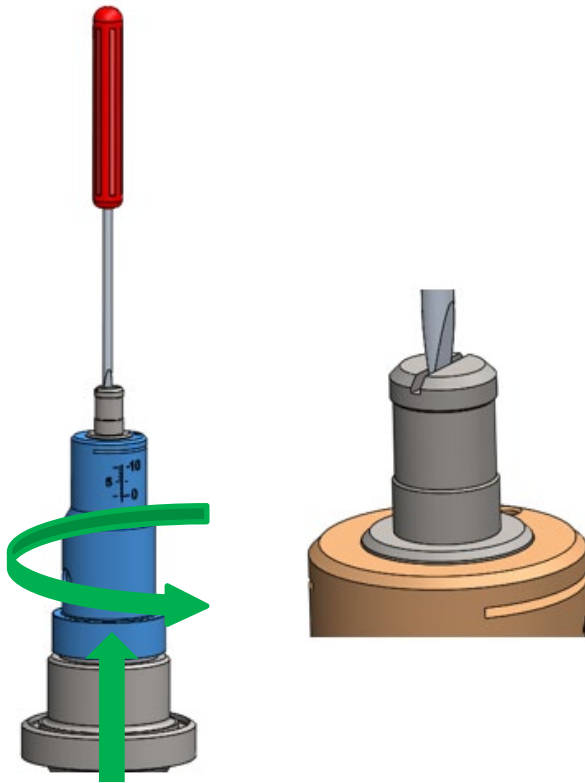
Articulated hook wrench 35-60/4

Plain slot screwdriver no. 3

Step	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Loosen and remove the 3 threaded pins using an Allen wrench. DN2 to DN15 Allen-type wrench, 3mm
2		Lift the hand wheel (marked blue) until it can be completely removed from the drive spindle.

3		For Hlcp version (precision) Loosen and remove the threaded pin using an Allen wrench. DN2 to DN15 Allen wrench 1.5mm for M3
4		Loosen and remove the cylinder head screw using a plain slot screwdriver no. 3. Also remove the o-ring and store at a clean place to avoid contamination.
5		Loosen and remove the sleeve nut (marked blue) using an articulated hook wrench 35-60/4. Slight tapping with a hammer might be necessary to loosen the sleeve nut.

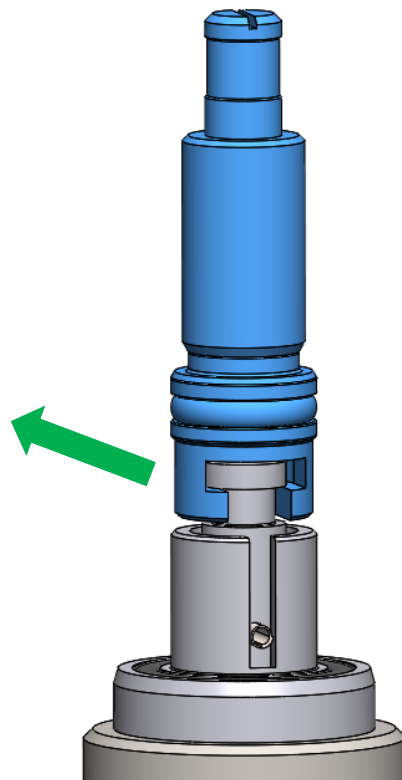
6



Fix the drive spindle in place using a plain slot screwdriver, size 3. A slot has been worked into the drive spindle specifically for that purpose.

Then turn the upper part (marked blue) by hand until the threaded joint no longer holds the parts together.

7



The drive spindle can be uncoupled from the insert.

6.5.2 Disassembly of the HL drive unit

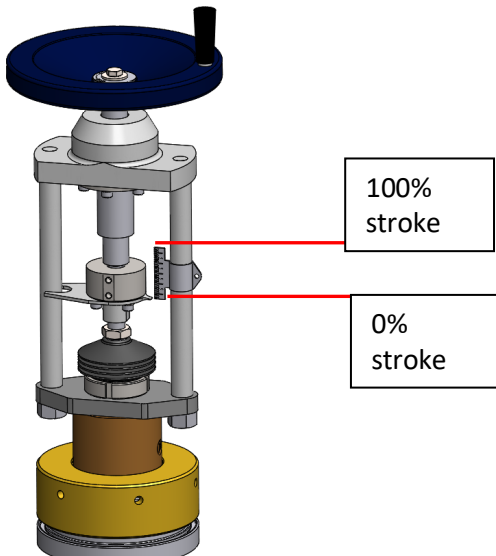
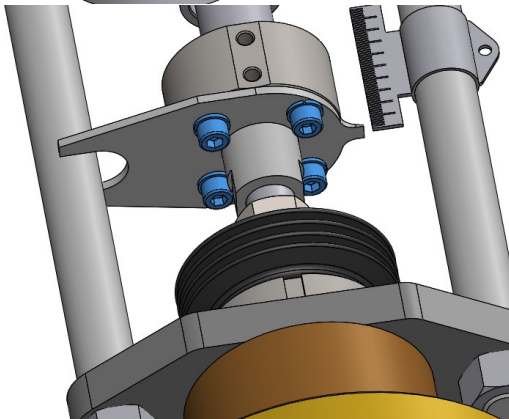
Required tools and auxiliary agents

DN50 to DN65

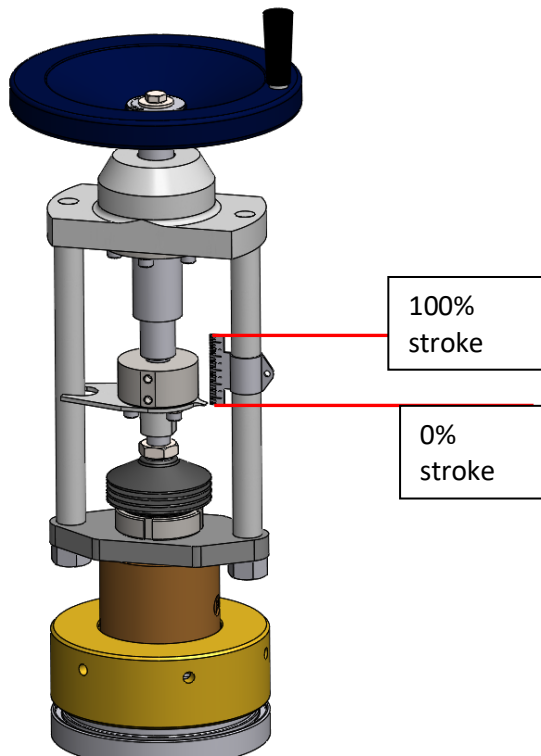
Allen-type wrench, 5mm
Open-end spanner with SW24
Open-end spanner with SW22
Depth gauge

DN80

Allen-type wrench, 6mm
Open-end spanner with SW24
Depth gauge
Plain slot screwdriver, size 3
Open-end spanner SW30
Articulated hook wrench 35-60/4

Step	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Put the valve in closed position by turning the hand wheel 0% stroke position
2		Loosen and remove the cylinder head screws (4x) using an Allen wrench. Also remove the washers. DN50 to DN65 Allen-type wrench, 5mm DN80 Allen-type wrench, 6mm

3

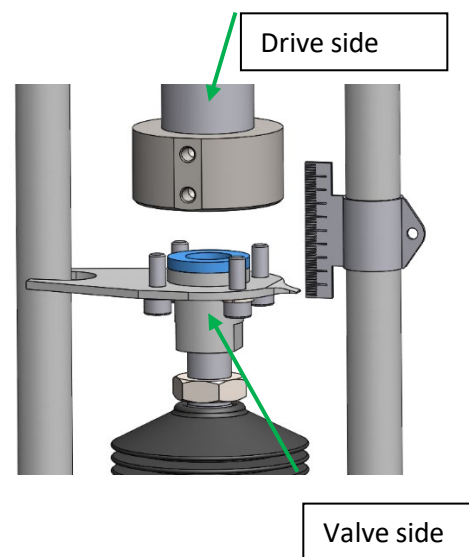


Put the valve in open position by turning the hand wheel

100% stroke position

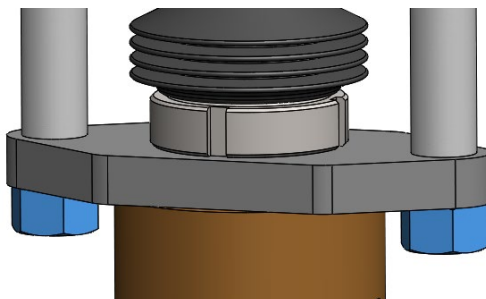
ATTENTION:

During uncoupling, the thrust washer (marked blue) is released. Remove the thrust washer and put to the side.



If the thrust washer is not present on the valve side of the coupling, it must be removed from the drive side of the coupling.

4



Loosen and remove the hex nut using an open-end spanner SW24.

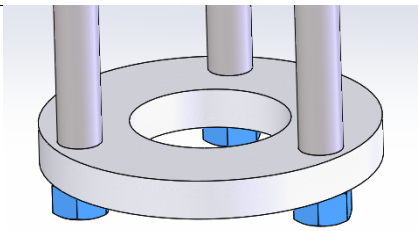
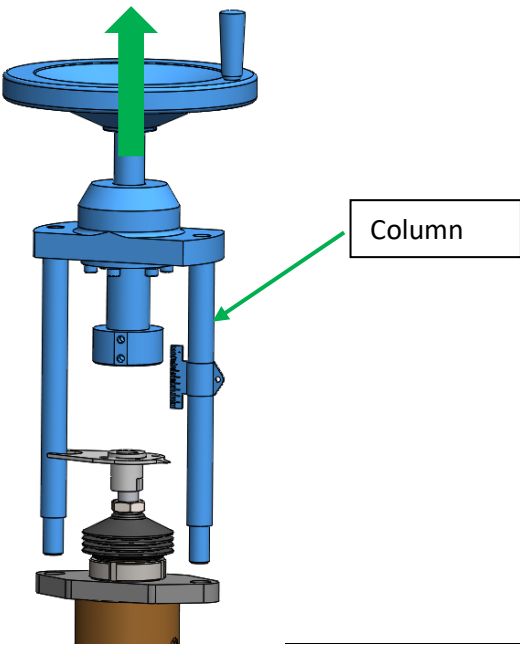
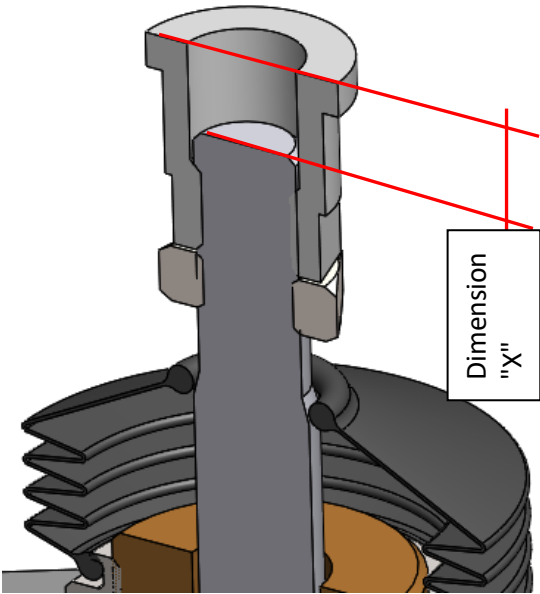
DN50 to DN80

Open-end spanner with SW24

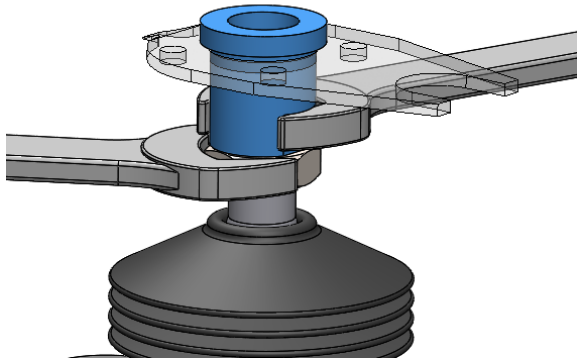
Please note:

From DN80, the manual column drive is fixed by 3 columns. Therefore, all 3 nuts need to be loosened and removed.



		
5		Lift out the complete manual drive unit and put to the side. Please note: Do not hold or lift the manual drive unit by the hand wheel. We recommend holding it by the columns. 
6		The dimension "X" between the upper edge of the coupling and the drive spindle must always be measured before disassembly. During assembly of the valve, the dimension "X" must be set! Otherwise, the valve stroke will be incorrect. We recommend writing down the dimension "X" and the respective tag no. of the valve.

DN2 to DN65



Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Remove the coupling and put to the side.

DN50 to DN65

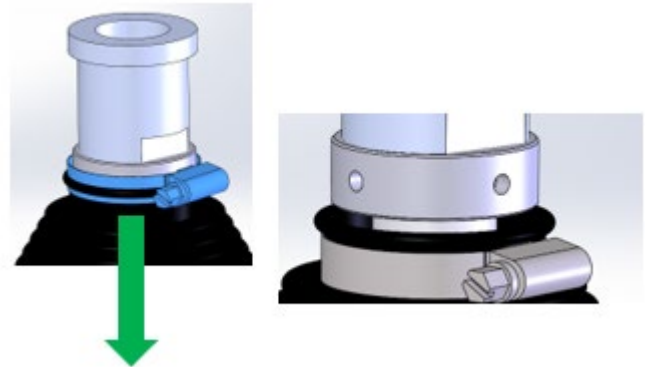
Open-end spanner SW22 & SW24

From DN80

Step 1:

Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed.

→ The counter-nut with holes is exposed.

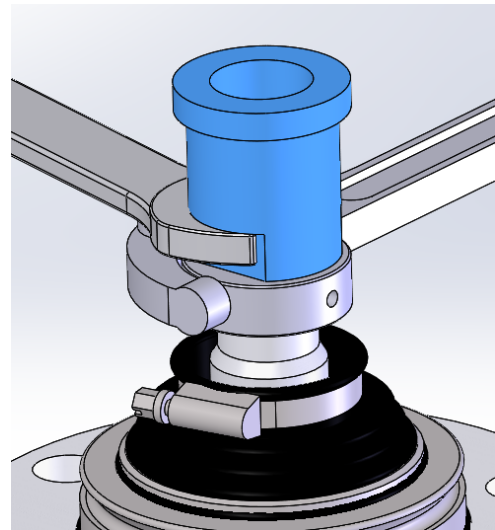


Step 2:

Using an open-end spanner as shown in the picture, hold the coupling (marked blue).

Using an articulated hook wrench, hold the counter nut.

→ Loosen the coupling



DN80

Open-end spanner SW30

Articulated hook wrench 35-60/4

6.5.3 Disassembly of the PM drive, vonRohr type

Prior to beginning with your work, you must first determine whether the drive is Po (closed at zero pressure) or Ps (open at zero pressure), because there is a difference in the work steps for the two types. This information can be found on the type plate of the drive.



Po drive

Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW13
Open-end spanner SW18
Open-end spanner SW24
Allen-type wrench, 6mm
Depth gauge

DN40 to DN65

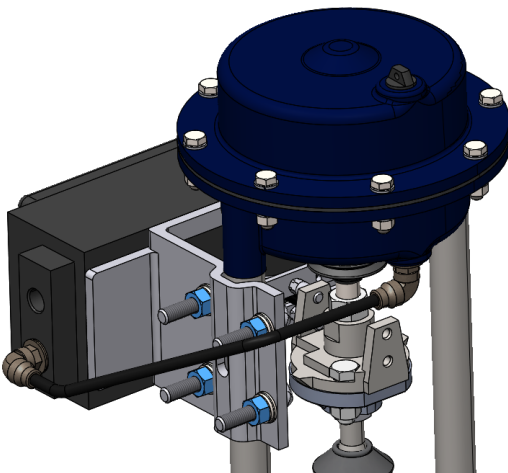

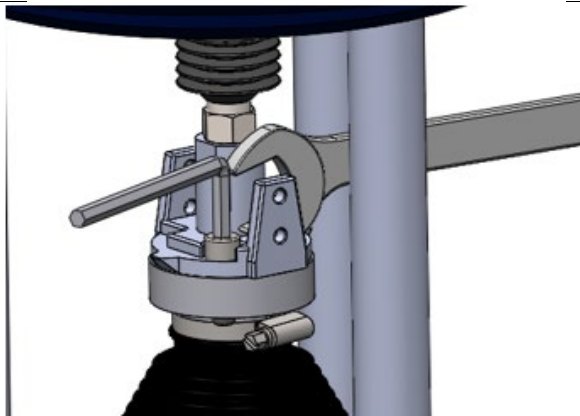
Open-end spanner SW13
Open-end spanner SW24 (2x)
Allen-type wrench, 6mm
Depth gauge

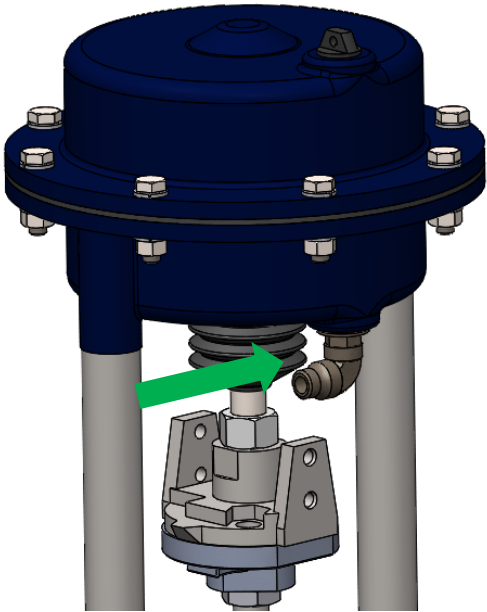
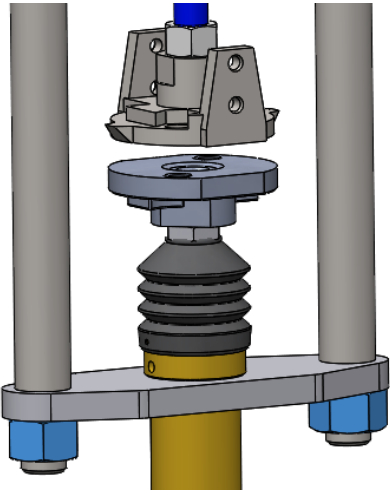
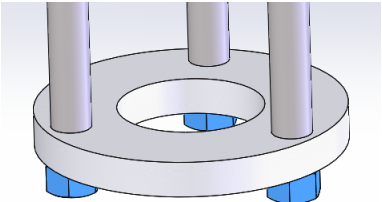
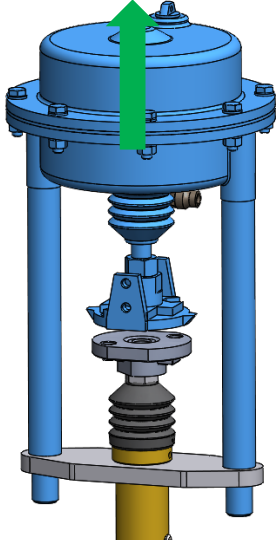
DN80

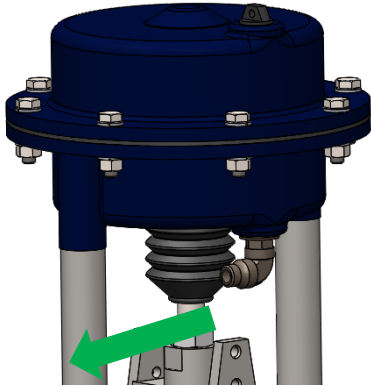
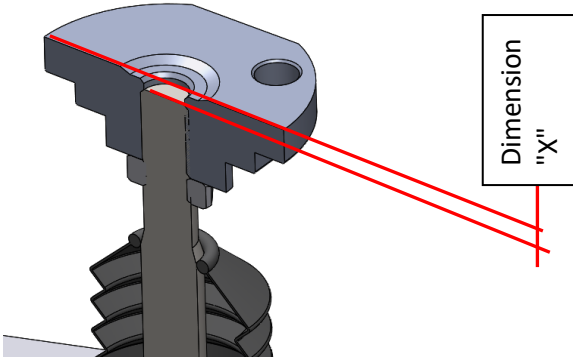
Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 6mm
Plain slot screwdriver, size 3
Face spanner with pins D6
Articulated hook wrench 35-60/4
Depth gauge

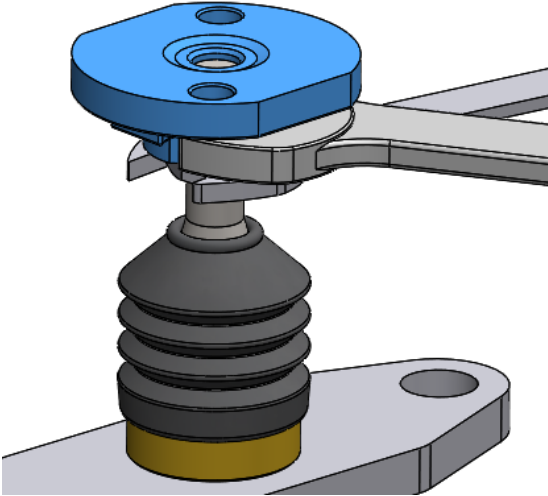
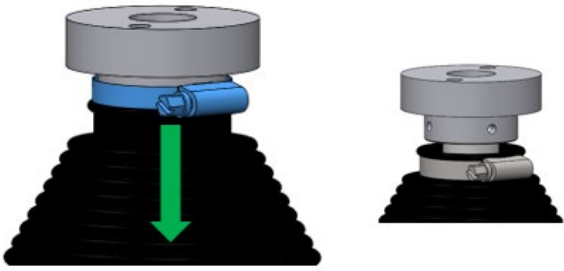
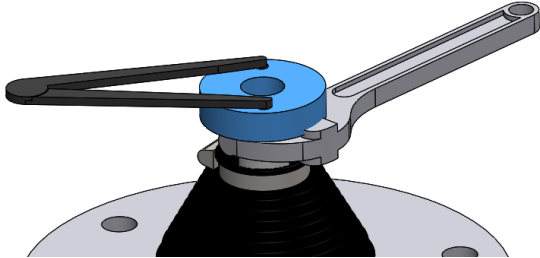
DN125

Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 10mm
Plain slot screwdriver, size 3
Open-end spanner SW36
Articulated hook wrench 35-60/4
Depth gauge

Step	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		If position controllers are used: Open the fitting of the compressed air line so that the hose is loose. Open the 4 hex nuts using the open-end spanner SW13 enough so that the position controller can be swivelled off. The position controller and tappet are no longer connected to one another. 
2		DN2 to DN65 Remove both screws at the coupling from below using a 6mm Allen wrench. Using a screwdriver, press against the coupling. Also remove the nuts. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface or the drive diaphragm. 
		DN80 to DN125 Remove the two screws at the coupling from above using a 6mm Allen wrench. Using a screwdriver, press against the coupling. ATTENTION: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface or the drive diaphragm  DN80 Allen-type wrench, 6mm DN125

3		Allen-type wrench, 10mm Re-connect the compressed air line to the drive. The maximum and minimum air pressure values are provided in the customer drawing. Please note: The maximum air pressure of 6 bar must not be exceeded; higher pressure will result in damage to the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive.  
4		Loosen the hex nut using an open-end spanner SW24 Remark: With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.! 
5		Remove the drive unit (marked blue). Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. Please note: Depending on the nominal width or the drive type, the work  

		should be performed by two persons or using a crane.
6		Remove the compressed air line from the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 
7		The dimension "X" between the upper edge of the coupling and the drive spindle must always be measured before disassembly. During assembly of the valve, the dimension "X" must be set! Otherwise, the valve stroke will be incorrect. We recommend writing down the dimension "X" and the respective tag no. of the valve.

	DN2 to DN65	From DN80
8	 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Remove the coupling and put to the side. DN2 to DN40-36 Open-end spanner SW18 & SW24 DN40 – DN65 Open-end spanner SW24 & SW24	Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. → The counter-nut with holes is exposed.  Step 2: Using a face spanner as shown in the picture, hold the coupling (marked blue). Using an articulated hook wrench, hold the counter-nut. → Loosen the coupling  DN80 Face spanner with pins D6 Articulated hook wrench 35-60/4 DN125 Open-end spanner SW36 Articulated hook wrench 35-60/4

Ps drive

Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW13
Open-end spanner SW18
Open-end spanner SW24
Allen-type wrench, 6mm
Depth gauge

DN40 to DN65

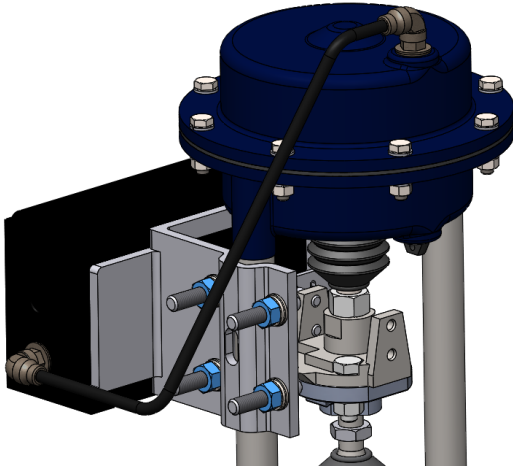
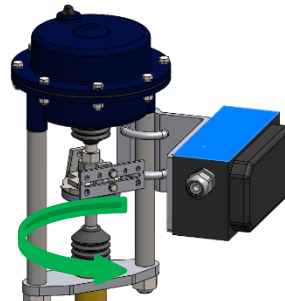
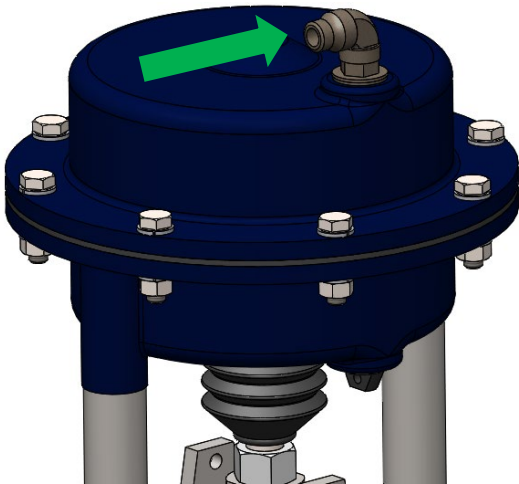
Open-end spanner SW13
Open-end spanner SW24 (2x)
Allen-type wrench, 6mm
Depth gauge

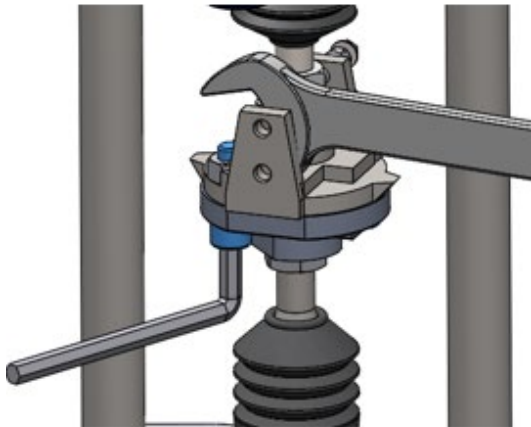
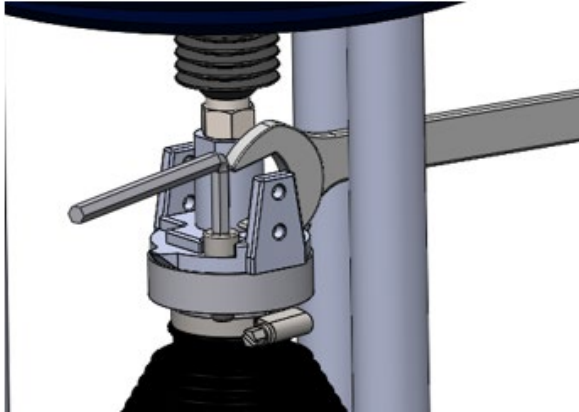
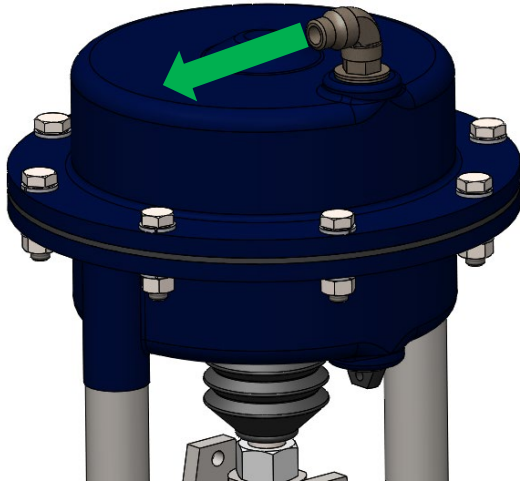
DN80

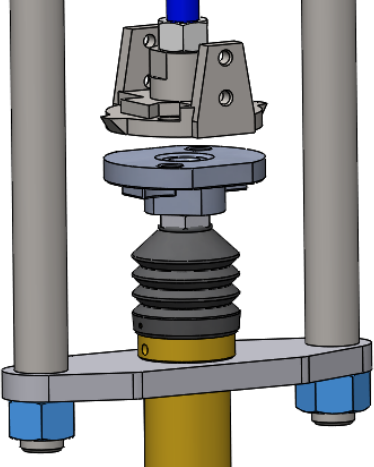
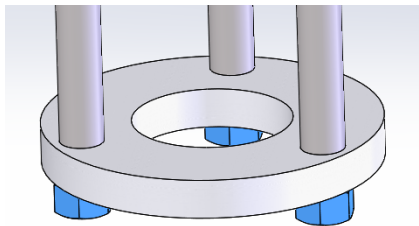
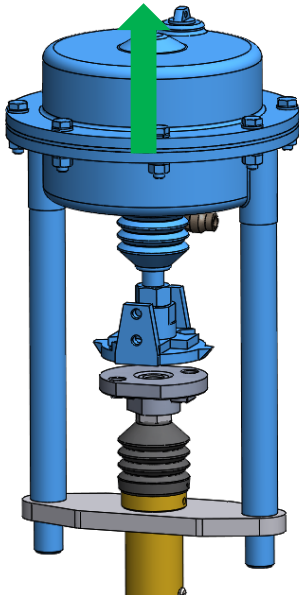
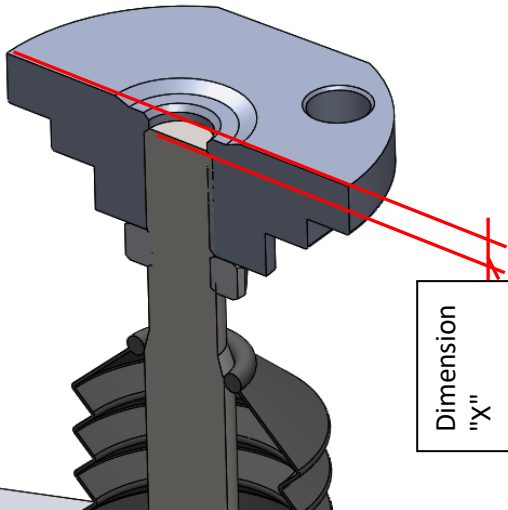
Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 6mm
Plain slot screwdriver, size 3
Face spanner with pins D6
Articulated hook wrench 35-60/4
Depth gauge

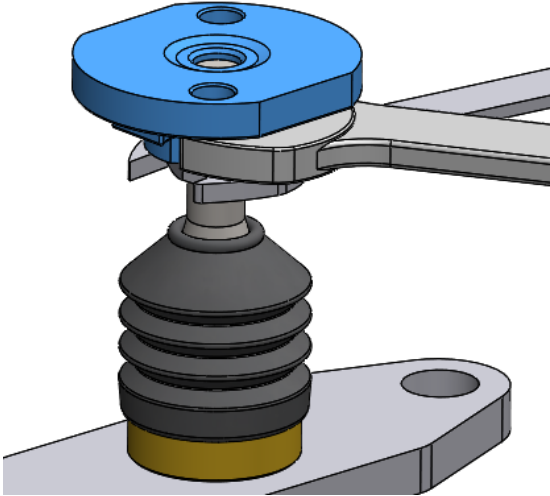
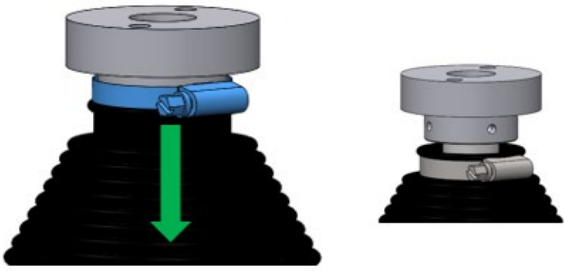
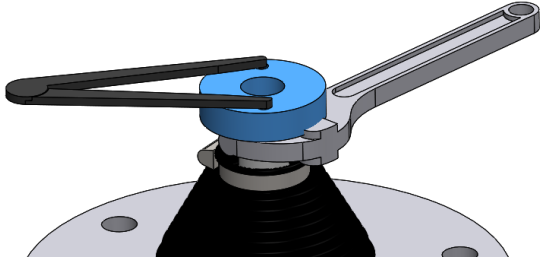
DN125

Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 10mm
Plain slot screwdriver, size 3
Open-end spanner SW36
Articulated hook wrench 35-60/4
Depth gauge

Step	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same		
1		If position controllers are used: Open the fitting of the compressed air line so that the hose is loose. Open the 4 hex nuts using the open-end spanner SW13 enough so that the position controller can be swivelled off. The position controller and tappet are not connected to one another. 
2		Directly connect the compressed air line to the drive. The maximum and minimum air pressure values are provided in the customer drawing. Please note: The maximum air pressure of 6 bar must not be exceeded; higher pressure will result in damage to the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive.  

		DN2 to DN65 Remove both screws at the coupling from below using a 6mm Allen wrench. Using a screwdriver, press against the coupling. Also remove the nuts. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface or the drive diaphragm. 
3		DN80 to DN125 Remove the two screws at the coupling from above using a 6mm Allen wrench. Using a screwdriver, press against the coupling. ATTENTION: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface or the drive diaphragm DN80 Allen-type wrench, 6mm DN125 Allen-type wrench, 10mm
4		Remove the compressed air line from the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 

5		Loosen the hex nut using an open-end spanner SW24 Remark: With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.! 
6		Remove the drive unit (marked blue). Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface.  Please note: Depending on the nominal width or the drive type, the work should be performed by two persons or using a crane. 
7		The dimension "X" between the upper edge of the coupling and the drive spindle must always be measured before disassembly. During assembly of the valve, the dimension "X" must be set! Otherwise, the valve stroke will be incorrect. We recommend writing down the dimension "X" and the respective tag no. of the valve.

DN2 to DN65	From DN80
 8 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Remove the coupling and put to the side. DN2 to DN40-36 Open-end spanner SW18 & SW24 DN40 – DN65 Open-end spanner SW24 & SW24	Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. → The counter-nut with holes is exposed.  Step 2: Using a face spanner as shown in the picture, hold the coupling (marked blue). Using an articulated hook wrench, hold the counter-nut. → Loosen the coupling  DN80 Face spanner with pins D6 Articulated hook wrench 35-60/4 DN125 Open-end spanner SW36 Articulated hook wrench 35-60/4

6.5.4 Disassembly of the PM drive, Samson type

Prior to beginning with your work, you must first determine whether the drive is Po (closed at zero pressure) or Ps (open at zero pressure), because there is a difference in the work steps for the two types. This information can be found on the type plate of the drive.



Po drive

Required tools and auxiliary agents

DN20

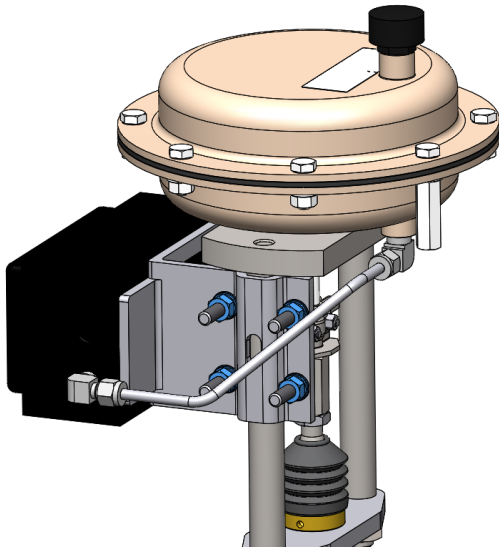
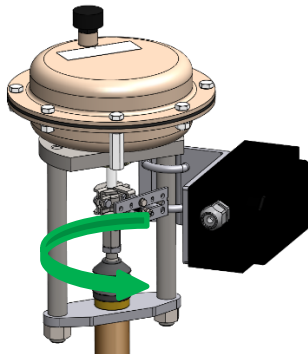
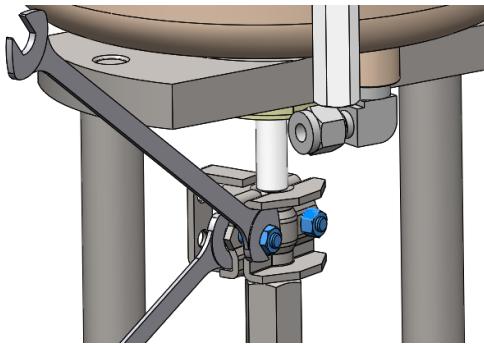
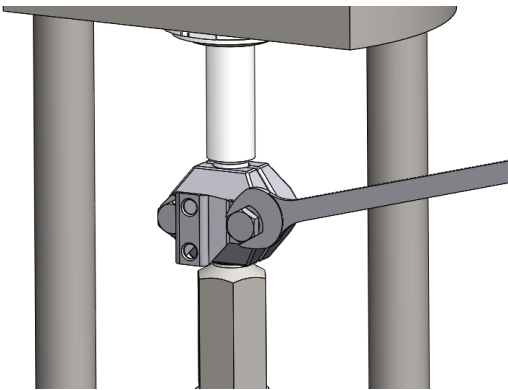
- Open-end spanner SW8 (2x)
- Open-end spanner SW13
- Open-end spanner SW17
- Open-end spanner SW18
- Open-end spanner SW24
- Depth gauge

DN40 to DN65

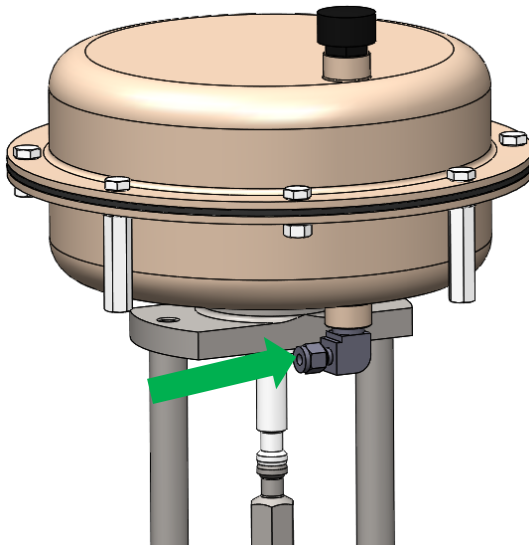
- Open-end spanner SW10
- Open-end spanner SW13
- Open-end spanner SW22
- Open-end spanner SW24
- Depth gauge

From DN80

- Open-end spanner SW10
- Open-end spanner SW13
- Open-end spanner SW24
- Open-end spanner SW32
- Articulated hook wrench 35-60/4
- Depth gauge

	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		If position controllers are used: Open the fitting of the compressed air line so that the hose is loose. Open the 4 hex nuts using the open-end spanner SW13 enough so that the position controller can be swivelled off. The position controller and tappet are not connected to one another. 
2		DN20 Remove the two screws at the coupling using two open-end spanners SW8. Also remove the nuts. The coupling can be disassembled. ATTENTION: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface or the drive diaphragm.
		From DN40 Remove the two screws at the coupling using an open-end spanner SW10. The coupling can be disassembled. ATTENTION: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface or the drive diaphragm.

3



Re-connect the compressed air line to the drive.

The maximum and minimum air pressure values are provided in the customer drawing.

Please note:

The maximum air pressure of 6 bar must not be exceeded; higher pressure will result in damage to the drive.

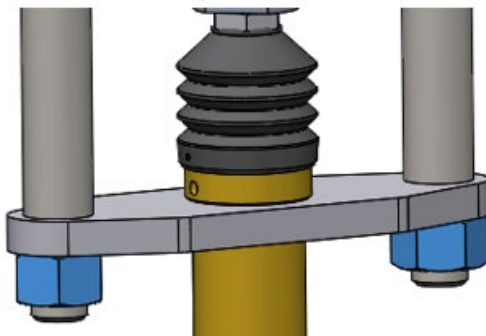


Attention:

Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive.



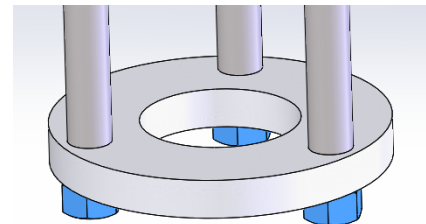
4

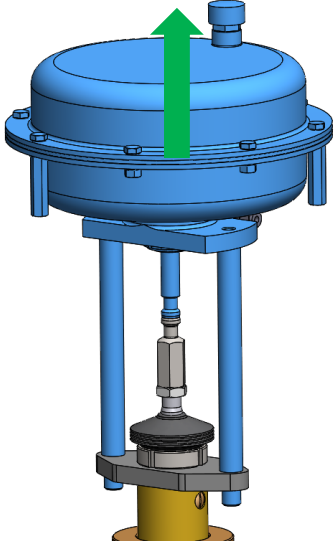
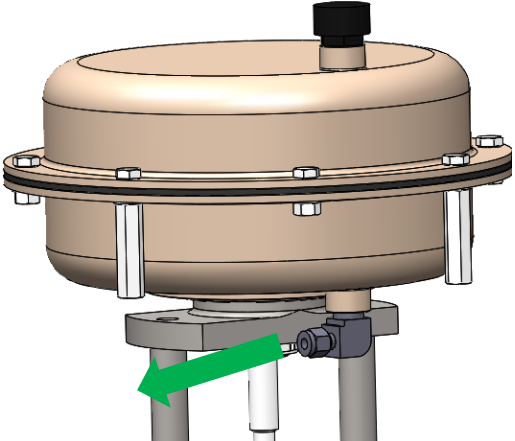
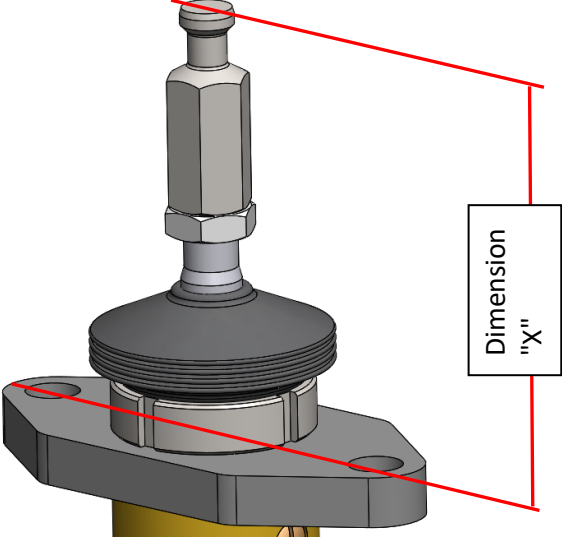


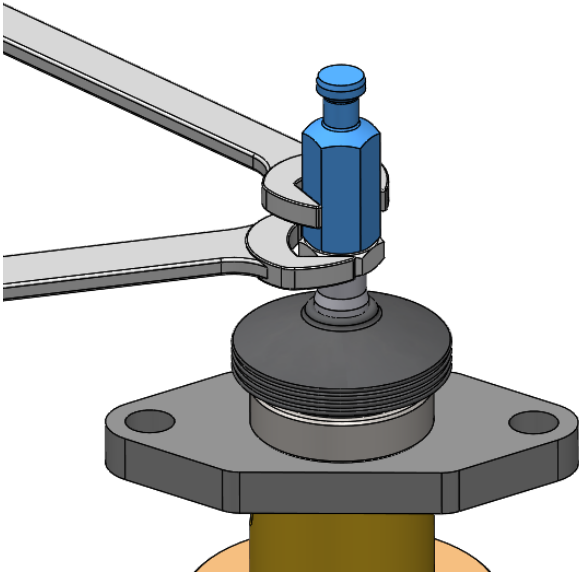
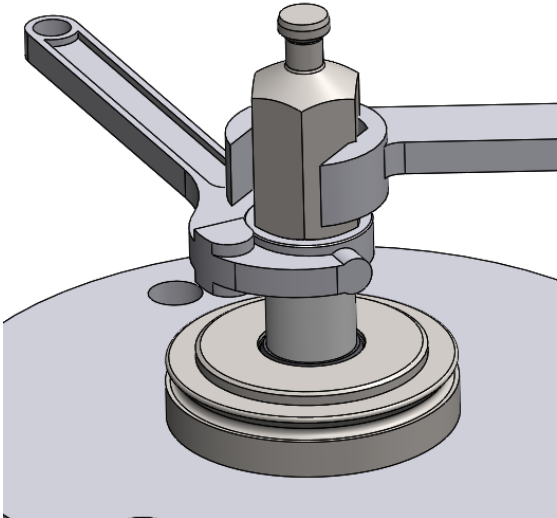
Loosen the hex nut using an open-end spanner SW24.

Remark:

With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.!



5		Remove the drive unit (marked blue). ATTENTION: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. Please note: Depending on the nominal width or the drive type, the work should be performed by two persons or using a crane. 
6		Remove the compressed air line from the drive Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 
7	 Dimension "X"	The dimension "X" between the upper edge of the coupling and the cross piece must be measured. During assembly of the valve, the dimension "X" must be set! Otherwise, the valve stroke will be incorrect We recommend writing down the dimension "X" and the respective tag no. of the valve.

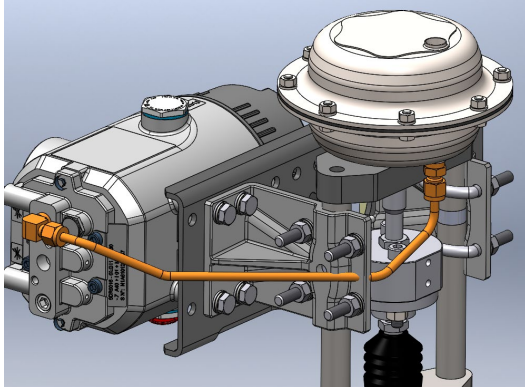
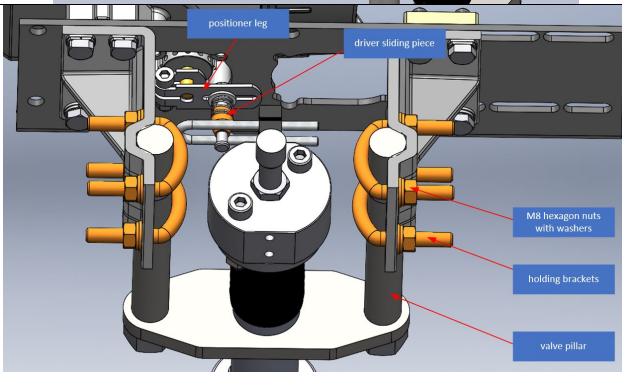
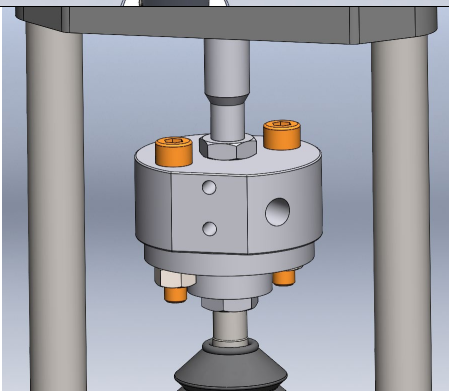
	DN2 to DN65	From DN80
8	 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Remove the coupling and put to the side. DN20 Open-end spanner SW17 & SW18 DN40 to DN65 Open-end spanner SW22 & SW24	Using an open-end spanner SW32 as shown in the picture, hold the coupling. Using an articulated hook wrench 35-60/4, hold the counter-nut. → Loosen the coupling 

6.5.5 Disassembly of the PM drive, Sart-von-Rohr type for TbxV/WbxV or TcxV/WcxV valves

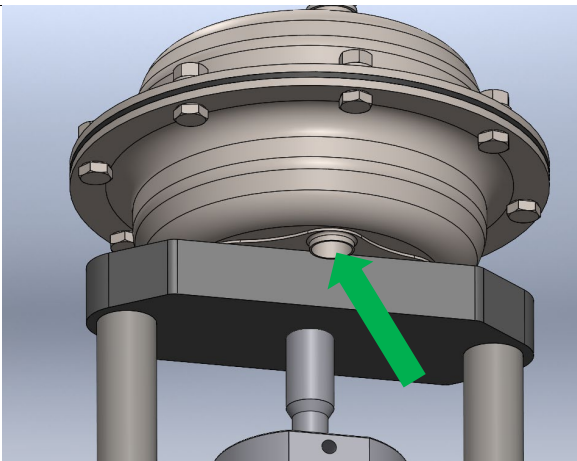
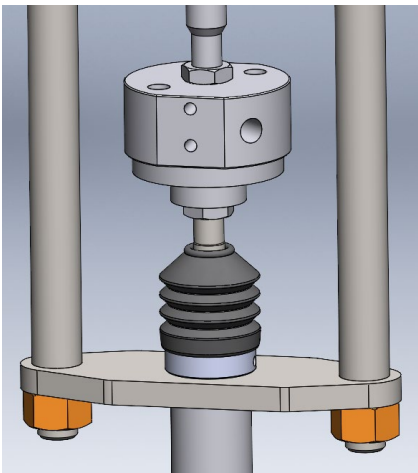
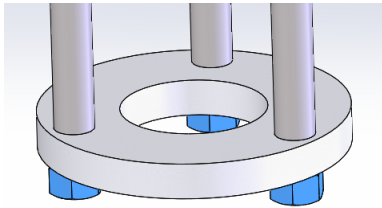
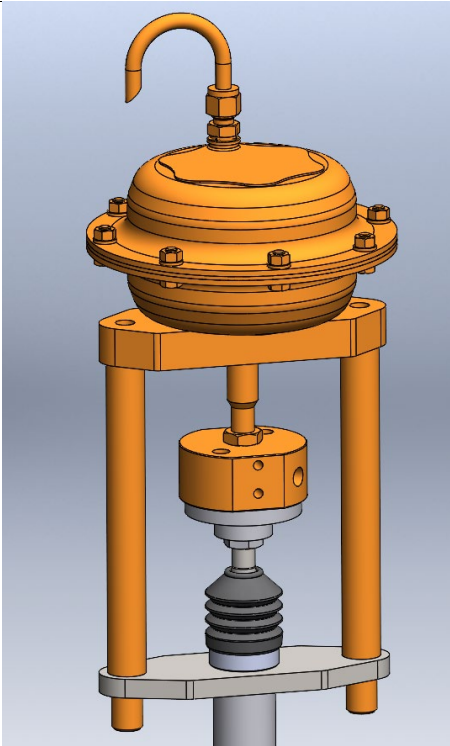
Prior to beginning with your work, you must first determine whether the drive is Po (closed at zero pressure) or Ps (open at zero pressure), because there is a difference in the work steps for the two types. This information can be found on the type plate of the drive.

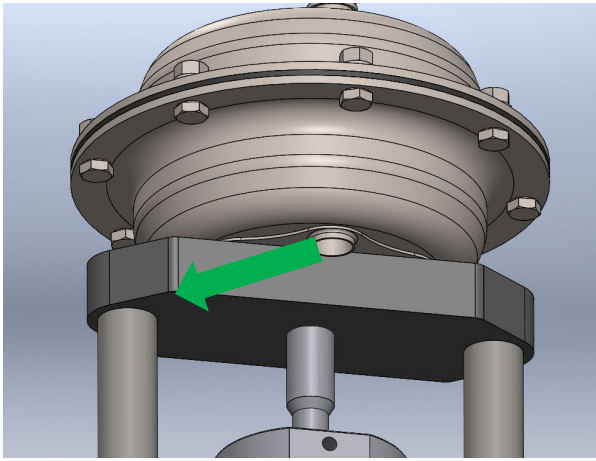
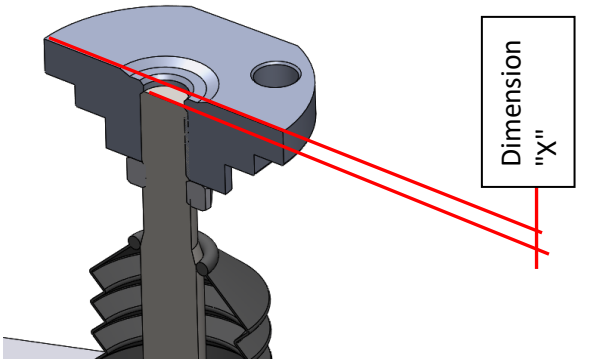


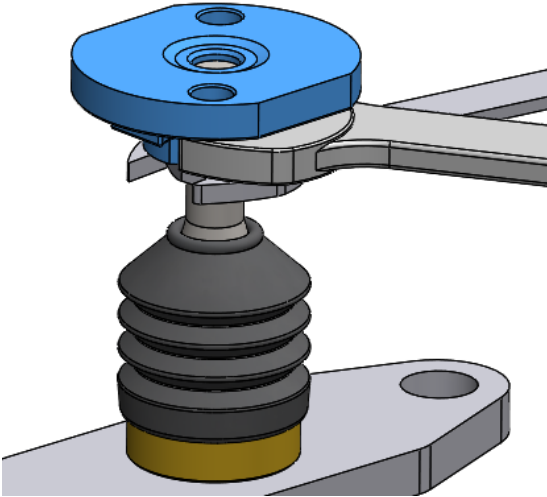
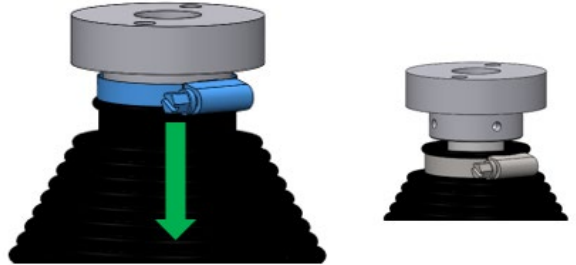
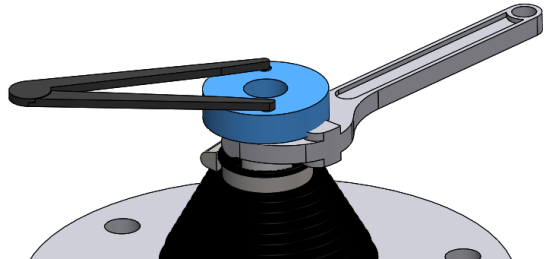
Description for Po drives.

Step	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		If position controllers are used: Open the fitting of the compressed air line so that the hose is loose with an open-end spanner SW14.
2		Open the 8x M8 hex nuts using an open-end spanner SW13 on one side fully and disconnect the positioner. The position controller (drivers sliding piece) and tappet are no longer connected to one another.
3		DN2 to DN65 Remove both screws at the coupling from below using a 6mm Allen wrench. Also remove the M8 hexagon nuts using an open-end spanner SW13. Attention: The insert must not be turned during disassembly. This could result in irreversible damage to the seat surface or the drive diaphragm.



4		Po-drives: Install a compressed air line to the actuator and pressurize it according to the customer drawing. The actuator moves to open valve position. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 
5		Loosen the M16 hex nuts using an open-end spanner SW24 Remark: With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.! 
6		Remove the drive unit (marked orange). Attention: The insert must not be turned during disassembly. This could result in irreversible damage to the seat surface.  Please note: Depending on the nominal width or the drive type, the work should be performed by two persons or using a crane. 

7		Remove the compressed air line from the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 
8		The dimension "X" between the upper edge of the coupling and the drive spindle must always be measured before disassembly. During assembly of the valve, the dimension "X" must be set! Otherwise, the valve stroke will be incorrect. We recommend writing down the dimension "X" and the respective tag no. of the valve.

	DN2 to DN65	From DN80
9	 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Remove the coupling and put to the side. DN2 to DN40-36 Open-end spanner SW18 & SW24 DN40 – DN65 Open-end spanner SW24 & SW24	Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. → The counter-nut with holes is exposed.  Step 2: Using a face spanner as shown in the picture, hold the coupling (marked blue). Using an articulated hook wrench, hold the counter-nut. → Loosen the coupling  DN80 Face spanner with pins D6 Articulated hook wrench 35-60/4 DN125 Open-end spanner SW36 Articulated hook wrench 35-60/4

6.5.6 Disassembly of a TxV DNxx/PNxx valve

Prior to beginning with your work, you must first determine the nominal width of the valve, because there is a difference in the work steps for the different nominal widths. This information is provided either on the valve (marking) or in the technical drawing.



The disassembled components must be stored in a clean place. Damage to the sealing surfaces requires great effort and expenditure to remedy.



If the valve is an Hlc or Hlcp valve, the first work steps are not required. Only perform the work steps from the point of disassembling the insert.



Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW18
Plain slot screwdriver, no. 3
Articulated hook wrench 35-60/4

DN40 to DN65

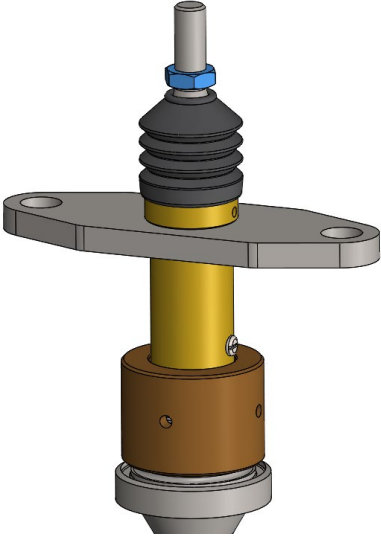
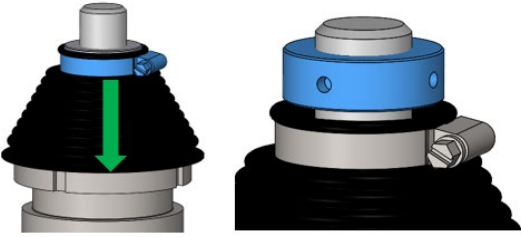
Open-end spanner SW24
Plain slot screwdriver, no. 4
Articulated hook wrench 95-155/6
Hand-held mounting tool, WEKA no. 2479

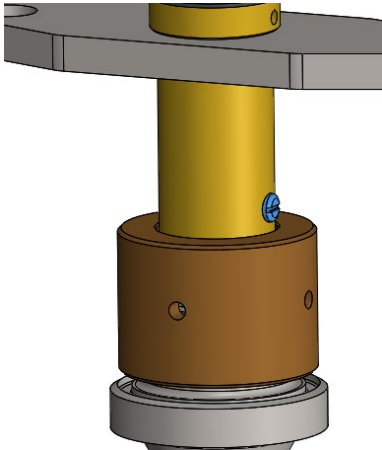
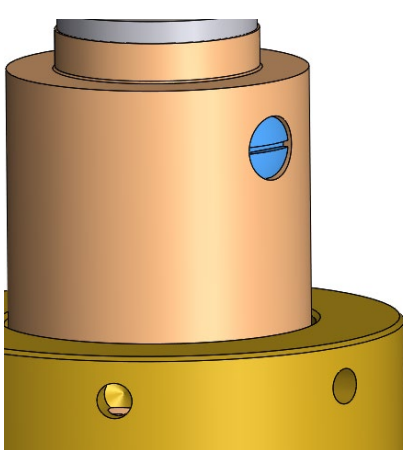
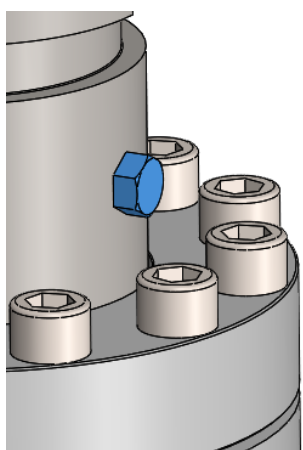
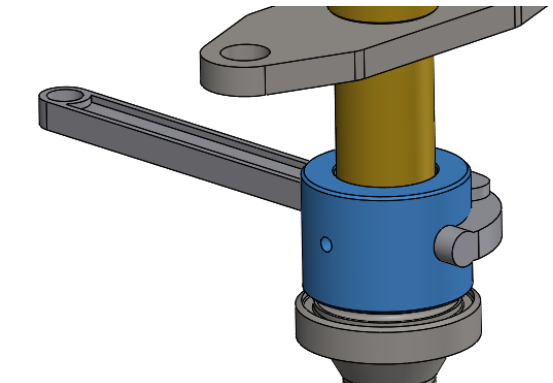
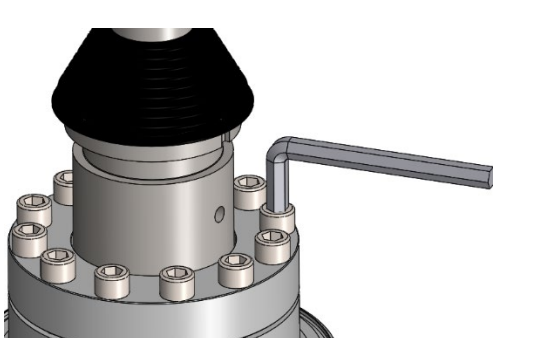
DN80 to DN100

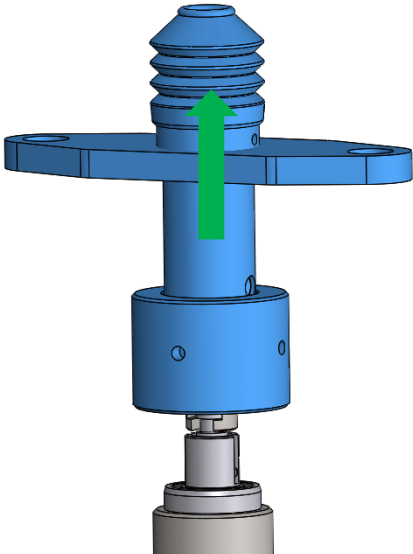
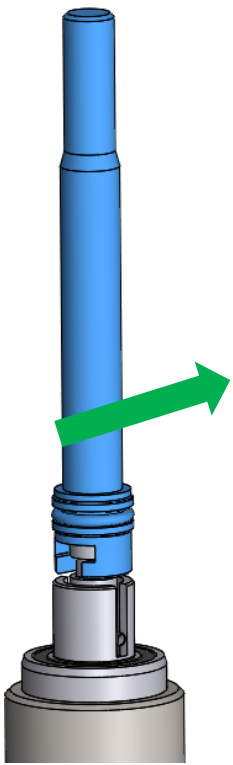

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench, 10mm
Crane mounting tool, WEKA no. 1750

From DN125

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench SW14
Crane mounting tool, WEKA no. 1750

Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.	
1 	DN2 to DN65 Loosen the counter-nut from the drive spindle either by hand or using an open-end spanner. DN2 to DN40-36 Open-end spanner SW18 DN40 to DN65 Open-end spanner SW24
	From DN80 Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. → The counter-nut with holes is exposed. Step 2: Remove the counter-washer by hand or using an articulated hook wrench 35-65/4.

2	   DN2 to DN40-36 Loosen the orifice hole using the plain slot screwdriver, no. 3 . Place the screw including the o-ring onto a clean DN40 to DN65 Loosen the orifice hole using the plain slot screwdriver, no. 4 . Place the screw and copper gasket onto a clean surface. From DN80 Loosen the orifice hole using the open-end spanner SW13 . Place the plug onto a clean
3	 DN2 to DN65 Loosen the sleeve nut using the articulated hook wrench. DN2 to DN40-36 Articulated hook wrench 35-60/4 DN40 to DN65 Articulated hook wrench 95-155/6 Slight tapping with a hammer might be necessary to loosen the sleeve nut.  From DN80 Loosen all cylinder head screws using an Allen wrench. DN80 to DN100 Allen-type wrench, 10mm DN125 to DN150 Allen-type wrench SW14

4		Carefully lift the entire unit (marked blue) and pull over the drive spindle. Please note: During this step, it must be ensured that the drive spindle is not scratched. 
5		The drive spindle can be uncoupled from the insert. Please note: Depending on the nominal width, an additional bearing washer is loosely mounted on the insert. This washer must also always be put to the side.  Please note: Depending on the nominal width, the insert must be lifted first to be uncoupled. The insert must not be dropped! This may result in damage to the seat surface. 

Pull the insert out of the housing.

Lift the insert using the hand-held mounting tool or a crane mounting tool

Special tools can be purchased from WEKA AG.

DN 40 to DN65

Hand-held mounting tool, WEKA no. 2479

DN80 to DN200

Crane mounting tool, WEKA no. 1750

6



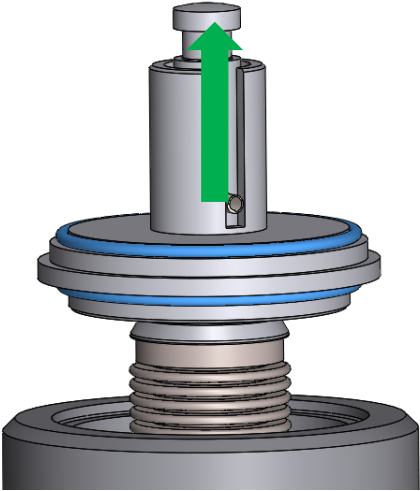
Lifting the insert by hand



Attention

Carefully lift the insert out of the housing and guide it with one hand! Damage to the control cone or other parts must always be avoided. Depending on the nominal width and cryogenic length of the valve, this work step should preferably be performed by 2 persons.



7		It may well be the case that the lower o-ring remains in the housing and is not lifted out with the insert as shown. If this is the case, the o-ring must be removed from the housing. Remove both o-rings using a plastic tool (avoiding damage at the seat surface) and store in a plastic bag. 
---	---	--

6.5.7 Disassembly of a TbxV/WbxV DNxx/PNxx valve

Prior to beginning with your work, you must first determine the nominal width of the valve, because there is a difference in the work steps for the different nominal widths. This information is provided either on the valve (marking) or in the technical drawing.



The disassembled components must be stored in a clean place. Damage to the sealing surfaces requires great effort and expenditure to remedy.



If the valve is an Hlc or Hlcp valve, the first work steps are not required. Only perform the work steps from the point of disassembling the insert.



Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW18
Plain slot screwdriver, size 3
Articulated hook wrench 35-60/4

DN40 to DN65

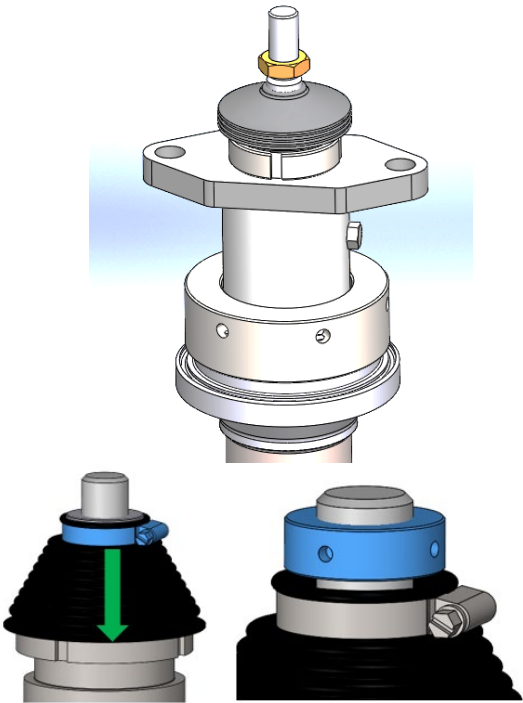
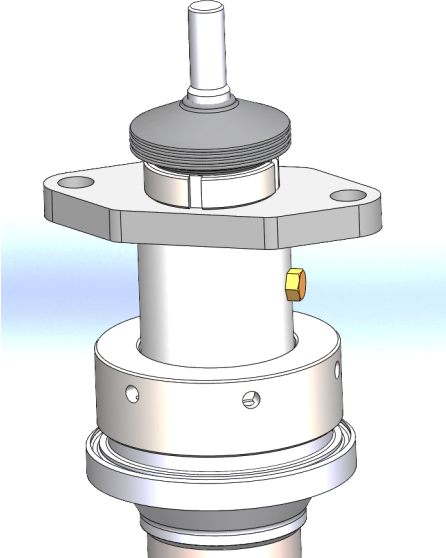
Open-end spanner SW24
Plain slot screwdriver, no. 4
Articulated hook wrench 95-155/6
Hand-held mounting tool, WEKA no. 2479

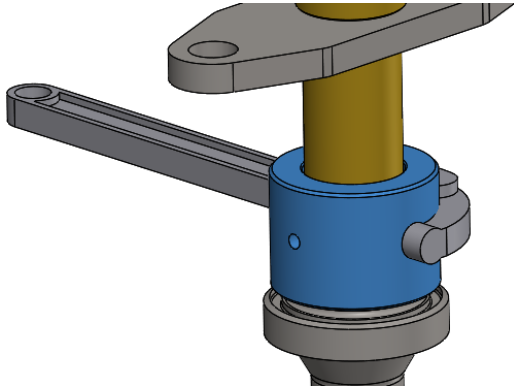
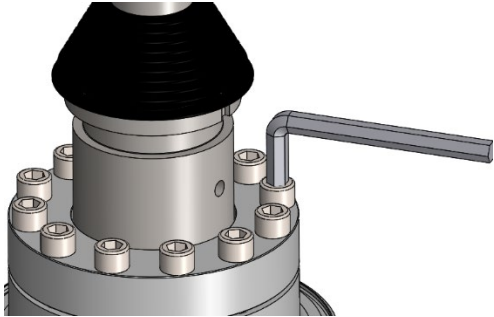
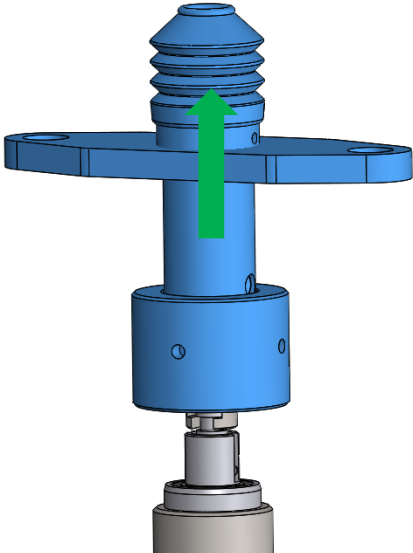
DN80 to DN100

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench, 10mm
Crane mounting tool, WEKA no. 1750

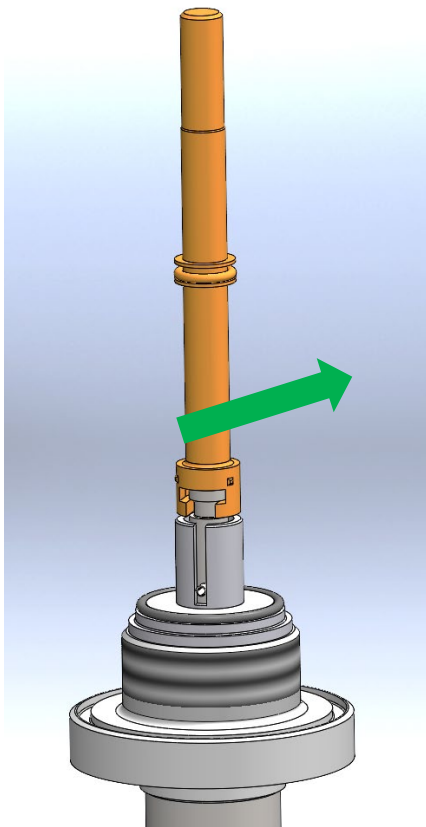
From DN125

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench SW14
Crane mounting tool, WEKA no. 1750

Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same. 1 	DN2 to DN65 Loosen the counter-nut from the drive spindle either by hand or using an open-end spanner. DN2 to DN40-36 Open-end spanner SW18 DN40 to DN65 Open-end spanner SW24
2 	DN2 to DN40-36 Loosen the screw using a plain slot screwdriver. Put it together with the o-ring into a clean plastic bag. DN40 to DN65 Open-end spanner SW24 Loosen the orifice hole using the open-end spanner SW13. Place the plug onto a clean surface.

3		DN2 to DN65 Loosen the sleeve nut using the articulated hook wrench. DN2 to DN40-36 Articulated hook wrench 35-60/4 DN40 to DN65 Articulated hook wrench 95-155/6 Slight tapping with a hammer might be necessary to loosen the sleeve nut.
		From DN80 Loosen all cylinder head screws using an Allen wrench. DN80 to DN100 Allen-type wrench, 10mm DN125 to DN150 Allen-type wrench SW14
4		Carefully lift the entire unit (marked blue) and pull over the drive spindle. Please note: During this step, it must be ensured that the drive spindle is not scratched. 


5



The drive spindle can be uncoupled from the insert.

Please note:

Depending on the nominal width, an additional bearing washer is loosely mounted on the insert. This washer must also always be put to the side.



Please note:

Depending on the nominal width, the insert must be lifted first to be uncoupled. The insert must not be dropped! This may result in damage to the seat surface.



Pull the insert out of the housing.

Lift the insert using the hand-held mounting tool or a crane mounting tool

Special tools can be purchased from WEKA AG.

DN 40 to DN65

Hand-held mounting tool, WEKA no. 2479

DN80 to DN200

Crane mounting tool, WEKA no. 1750

6



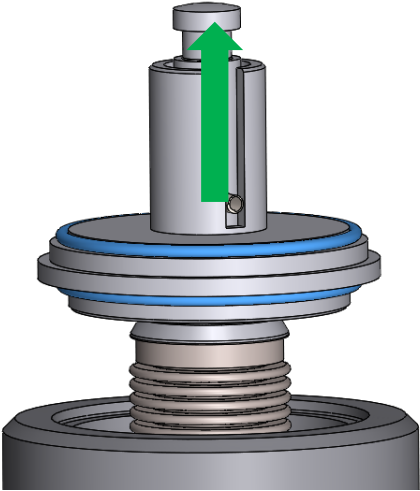
Lifting the insert by hand



Attention

Carefully lift the insert out of the housing and guide it with one hand! Damage to the control cone or other parts must always be avoided. Depending on the nominal width and cryogenic length of the valve, this work step should preferably be performed by 2 persons.



7		It may well be the case that the lower o-ring remains in the housing and is not lifted out with the insert as shown. If this is the case, the o-ring must be removed from the housing. Remove both o-rings using a plastic tool (avoiding damage at the seat surface) and store in a plastic bag. 
---	---	--

6.5.8 Disassembly of a TcxV/WcxV DNxx/PNxx valve

Prior to beginning with your work, you must first determine the nominal width of the valve, because there is a difference in the work steps for the different nominal widths. This information is provided either on the valve (marking) or in the technical drawing.

The disassembled components must be stored in a clean place. Damage to the sealing surfaces requires great effort and expenditure to remedy.

If the valve is an Hlc or Hlcp valve, the first work steps are not required. Only perform the work steps from the point of disassembling the insert.



Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW18
Plain slot screwdriver, no. 3
Allen wrench 6mm

DN40 to DN65

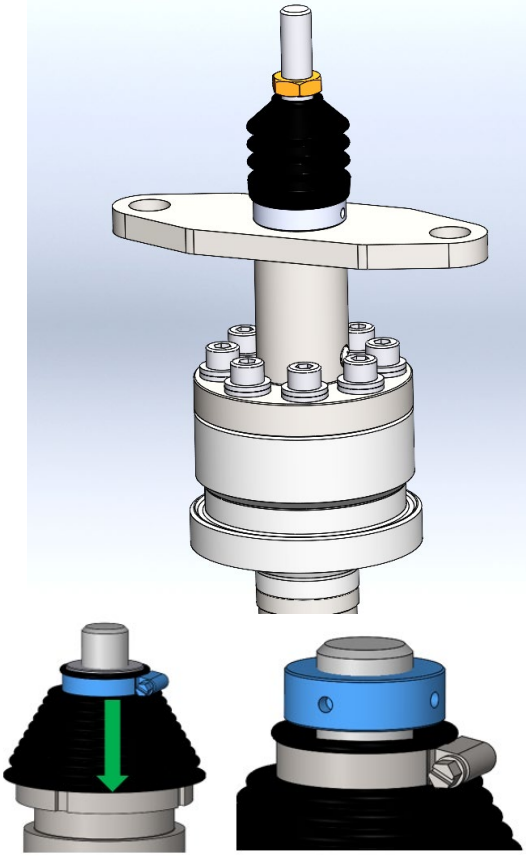
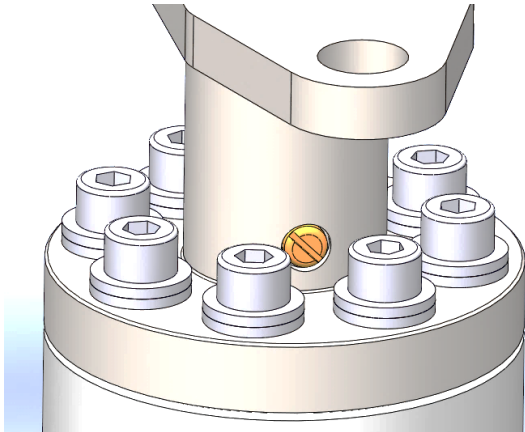
Open-end spanner SW24
Plain slot screwdriver, no. 4
Allen wrench 8mm
Hand-held mounting tool, WEKA no. 2479

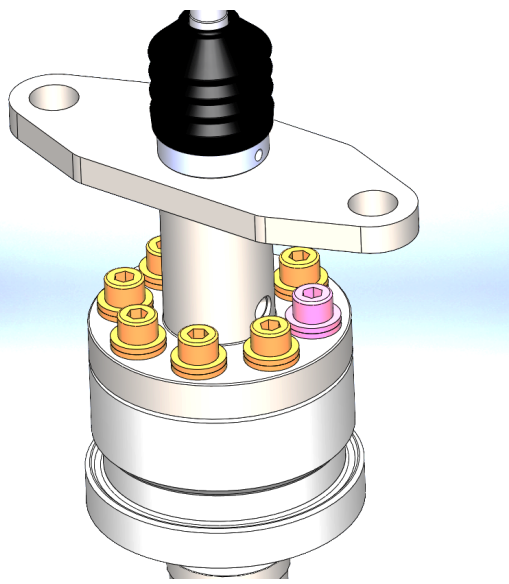
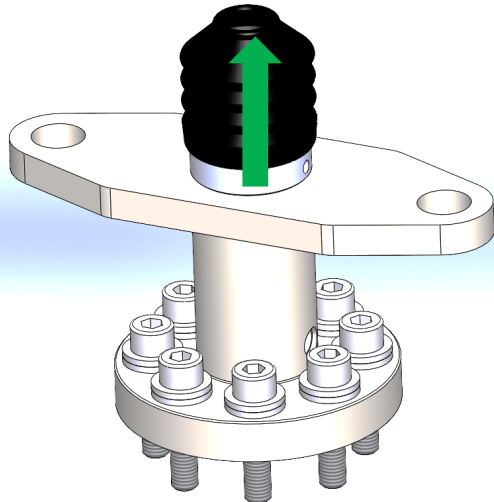
DN80 to DN100

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench, 10mm
Crane mounting tool, WEKA no. 1750

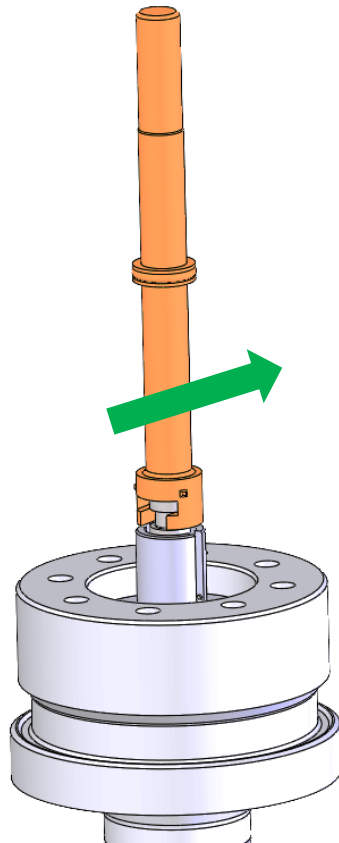
From DN125

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench SW14
Crane mounting tool, WEKA no. 1750

Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same. 8 	DN2 to DN65 Loosen the counter-nut from the drive spindle either by hand or using an open-end spanner. DN2 to DN40-36 Open-end spanner SW18 DN40 to DN65 Open-end spanner SW24
9 	DN2 to DN40-36 Loosen the screw using a plainhead screwdriver. Put it together with the o-ring into a clean plastic bag. DN40 to DN65 Open-end spanner SW24 Loosen the orifice hole using the open-end spanner SW13. Place the plug onto a clean surface.

10		Loosen all cylinder head screws and using an Allen wrench.
11		Carefully lift the entire unit and pull over the drive spindle. Please note: During this step, it must be ensured that the drive spindle is not scratched. 


12



The drive spindle can be uncoupled from the insert.

Please note:

Depending on the nominal width, an additional bearing washer is loosely mounted on the insert. This washer must also always be put to the side.



Please note:

Depending on the nominal width, the insert must be lifted first to be uncoupled. The insert must not be dropped! This may result in damage to the seat surface.



Pull the insert out of the housing (TcxV / WcxV valves slightly differ from these pictures).



Lifting the insert by hand

Lift the insert using the hand-held mounting tool or a crane mounting tool

Special tools can be purchased from WEKA AG.

DN 40 to DN65

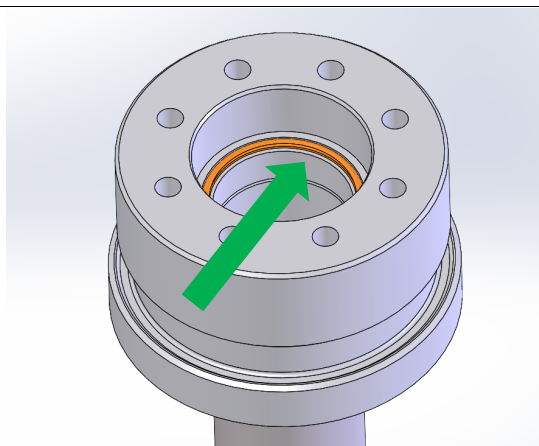
Hand-held mounting tool, WEKA no. 2479

DN80 to DN200

Crane mounting tool, WEKA no. 1750

Attention

Carefully lift the insert out of the housing and guide it with one hand! Damage to the control cone or other parts must always be avoided. Depending on the nominal width and cryogenic length of the valve, this work step should preferably be performed by 2 persons.



Remove the metallic c-ring using a plastic tool (avoiding damage at the seat surface) and store in a plastic bag.



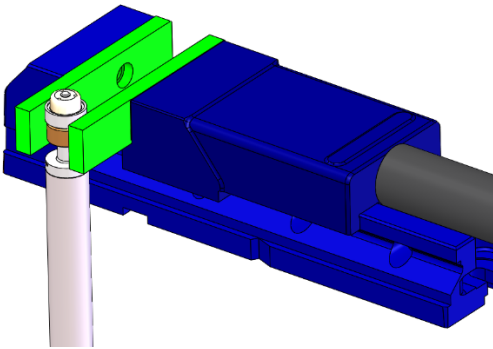
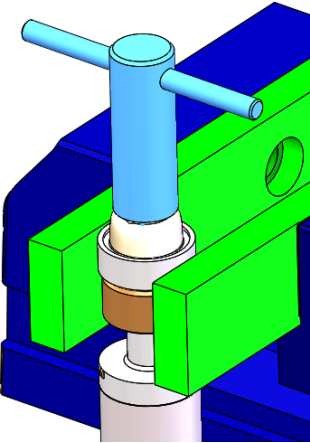
The c-ring ensures the fire safety of the valve. After removal WEKA recommends using a new c-ring.

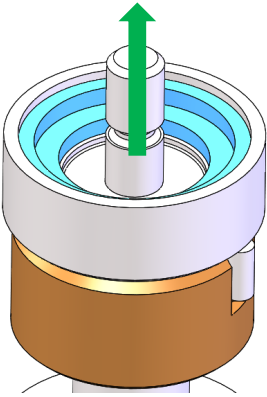
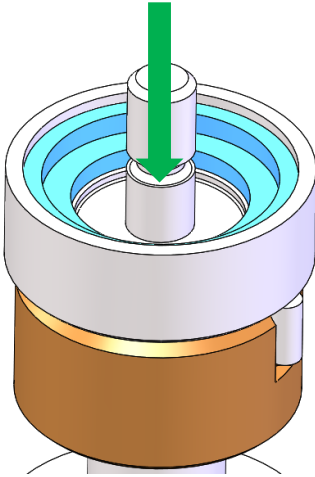
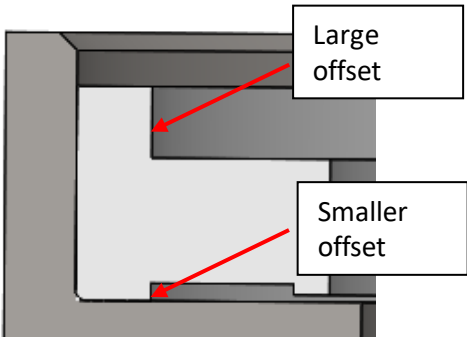
6.5.9 Replacing a control cone

For this purpose, the valve and/or the insert must be completely disassembled. To this end, see chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve.

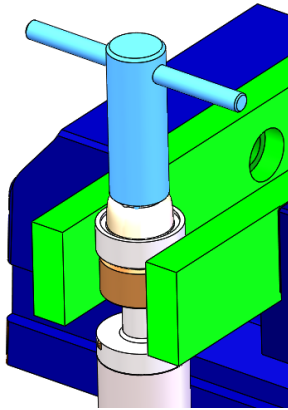
Required tools and auxiliary agents

Vice with soft clamping jaws
 Loctite 243
 Rubbing alcohol
 Lint-free cloth
 Special tool for control cones (depending on nominal width)

Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same. 1 	Clamp the insert by the soft jaws of a vice in upside-down position (control cone facing upwards). Please note: Make sure not to damage the guiding points at the insert with the vice jaws. 
2 	Screw the control cone out of the sealing head using the special tool. Please note: Up to DN15, the control cone is secured with threadlocker (Loctite 243). The image only is a graphic illustration. Control cone tools vary depending on nominal widths. This will be explained in more detail at the end. 

3		Remove the seat seal using a plastic tool or blow it out using a blow gun. Please note: Hard objects, such as metal tools or dirt particles may damage the sealing surface. Attention: Always wear goggles when working with compressed air.  
4		Clean the sealing surface and the seal using rubbing alcohol. WEKA AG recommends using a lint-free cloth! Re-assemble the seal. Please note: Hard objects, such as metal tools or dirt particles may damage the sealing surface. Attention: It must be ensured that the side with the larger offset is placed facing upwards.   
5		Apply threadlocker (Loctite 243) to the thread for the control cone.

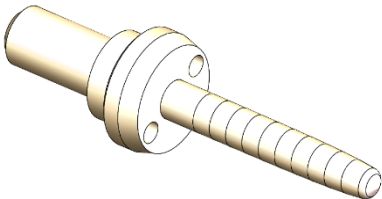
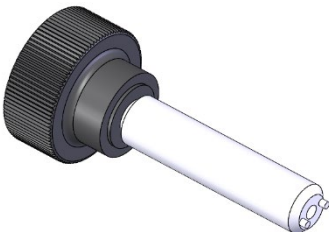




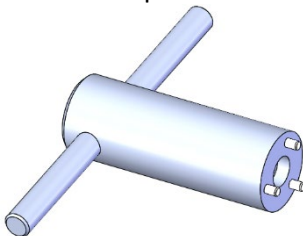
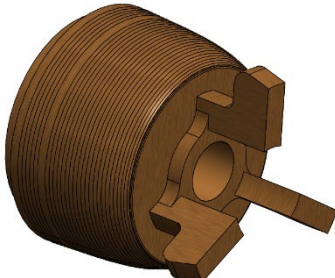
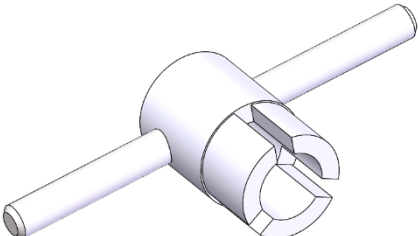
6

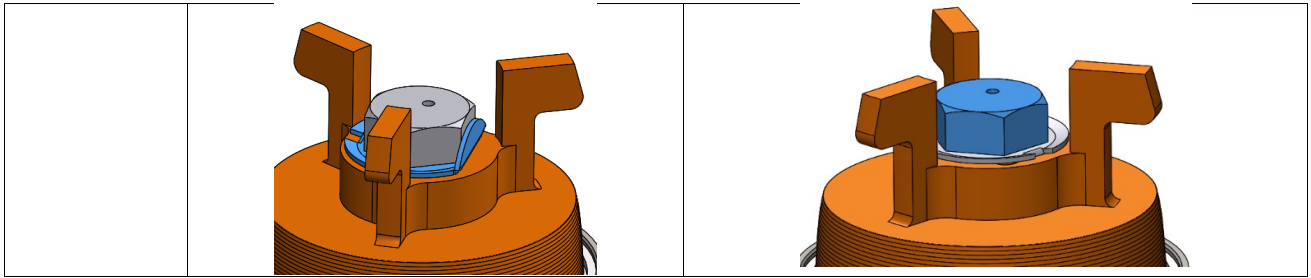


Screw the control cone back onto the sealing head using the appropriate tool.

The image only is a graphic illustration. Control cone tools vary depending on nominal widths. This will be explained in more detail at the end.

Overview list of tools as per WEKA AG data sheet 921004_Flowplugs.pdf

Nominal width	Image of control cone	Image of tool
DN2		Tool: Socket spanner 
DN4 to DN15		Tool: Fixing sleeve (depending on CC) 
		Tool: Plain slot screwdriver, no. 3 (depending on CC) 
DN20 to DN32		Tool: Ring spanner or face spanner 
DN40 to DN65		Tool: Socket spanner 
From DN80	Step 1: The guard plate must first be folded open	Step 2: Loosen the screw using an open-end spanner SW24 or a hex socket spanner SW24



6.5.10 Assembly of a TxV DNxx/PNxx valve

Prior to beginning with your work, you must first determine the nominal width of the valve, because there is a difference in the work steps for the different nominal widths. This information is provided on the valve (marking).



If the valve is an H1c or H1cp valve, the last work steps are not required. The drive spindle and the upper part are assembled differently.



Required tools and auxiliary agents

DN2 to DN40-36

- Open-end spanner SW18
- Plain slot screwdriver, no. 3
- Articulated hook wrench 35-60/4
- Rubbing alcohol
- Lint-free cloth
- Rhodorsil vacuum grease
- Gleitmo 599

DN40 to DN65

- Open-end spanner SW24
- Plain slot screwdriver, no. 4
- Articulated hook wrench 95-155/6
- Hand-held mounting tool, WEKA no. 2479
- Rubbing alcohol
- Lint-free cloth
- Rhodorsil vacuum grease
- Gleitmo 599

DN80 to DN100

- Plain slot screwdriver, size 3
- Articulated hook wrench 35-65/4
- Open-end spanner SW13
- Allen-type wrench, 10mm
- Crane mounting tool, WEKA no. 1750
- Rubbing alcohol
- Lint-free cloth
- Rhodorsil vacuum grease
- Gleitmo 599

From DN125

Plain slot screwdriver, size 3

Articulated hook wrench 35-65/4

Open-end spanner SW13

Allen-type wrench SW14

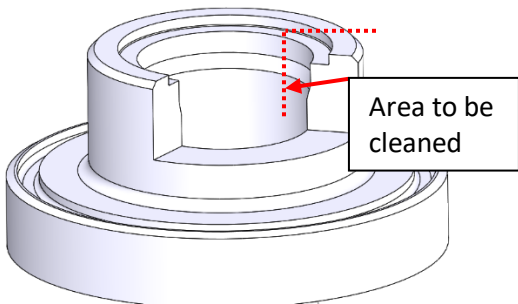
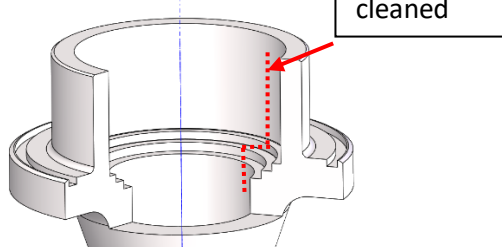
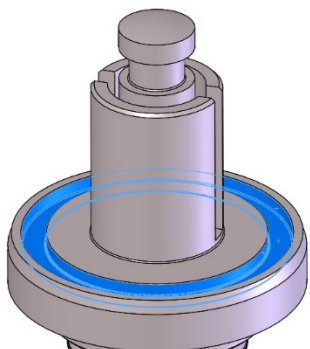
Crane mounting tool, WEKA no. 1750

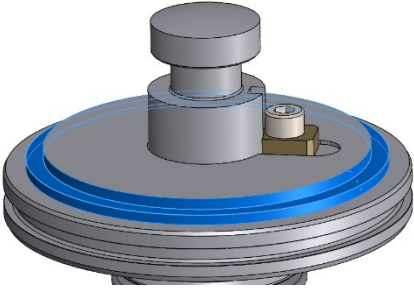
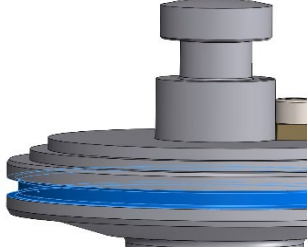
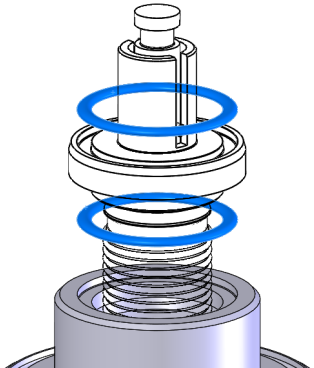
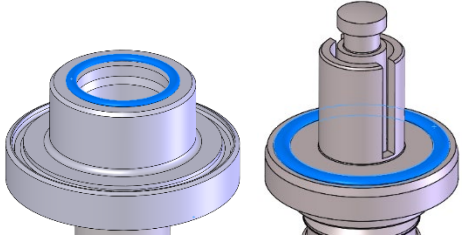

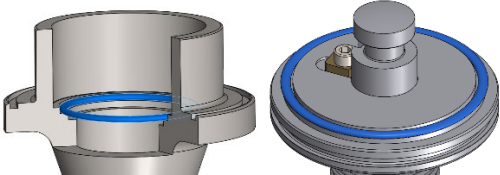
Rubbing alcohol

Lint-free cloth

Rhodorsil vacuum grease

Gleitmo 599

	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1	DN2 to D40-rb 	Clean the sealing surfaces at the threaded part of the housing using rubbing alcohol. The area to be cleaned depend on the nominal width. Please note: Use a lint-free cloth to avoid contamination. 
	From DN40 	
2	DN2 to D40-rb 	Clean the sealing surfaces at the piston (insert) using rubbing alcohol. The area to be cleaned depend on the nominal width. Please note: Use a lint-free cloth to avoid contamination. 
	From DN40	

		Please note: With DN80 valves, a groove at the piston must be additionally cleaned.  
3		Clean the two o-rings of the piston using rubbing alcohol. Please note: Use a lint-free cloth to avoid contamination.  Then grease slightly using Rhodorsil vacuum grease.
4	DN2 to D40-rb 	Assemble the two o-rings. Place one o-ring onto the cleaned surface of the threaded part and the other onto the piston of the insert. Please note: For DN80 valves, the o-ring must be assembled radially at the piston instead of the threaded part.  
	From DN40 	

5



Lift the insert by hand.



Lift the insert using a hand-held mounting tool or a crane mounting tool.

Special tools can be purchased from WEKA AG.

DN 40 to DN65

Hand-held mounting tool, WEKA no. 2479

DN80 to DN200

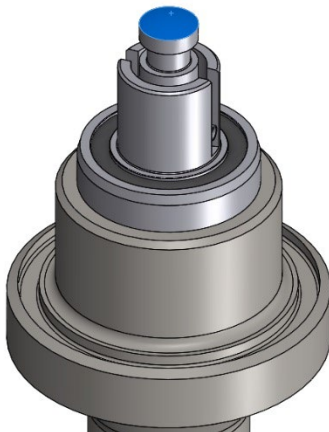
Crane mounting tool, WEKA no. 1750

Attention

Carefully move the insert into the housing and guide it with one hand! Damage to the control cone or other parts must always be avoided. Depending on the nominal width and cryogenic length of the valve, this work step should preferably be performed by 2 persons.




6

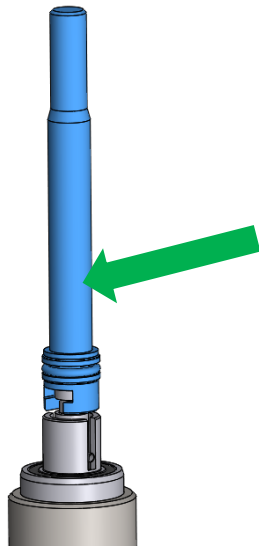


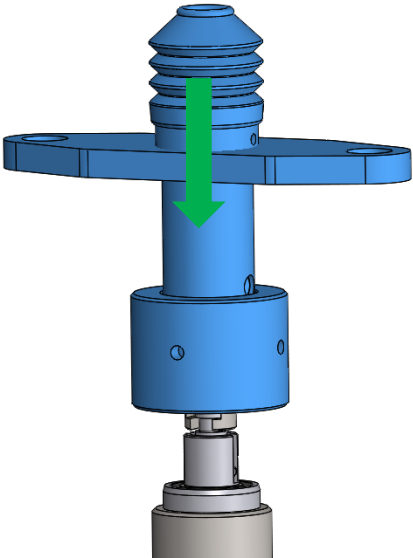
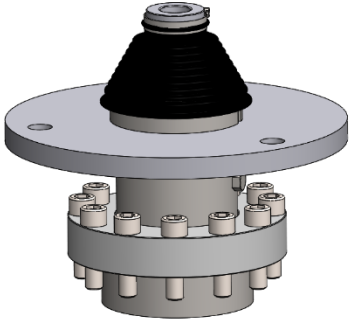
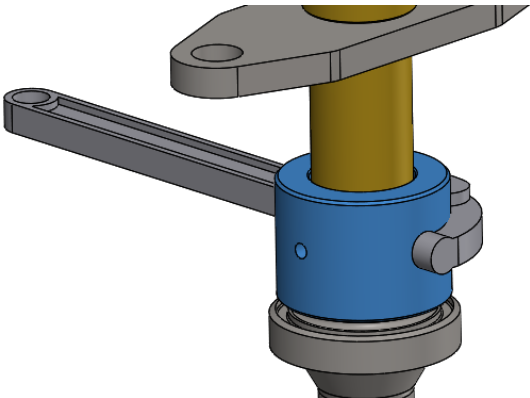
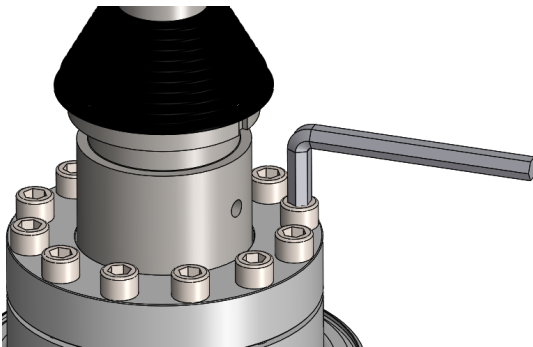
Grease the face side, marked blue, using Gleitmo 599.

Please note:

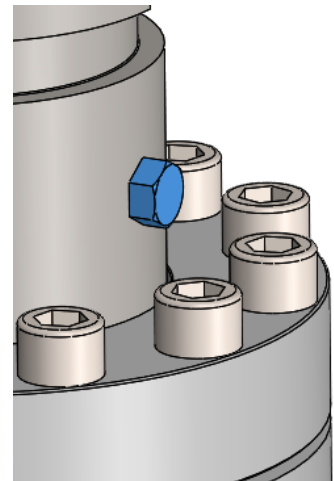
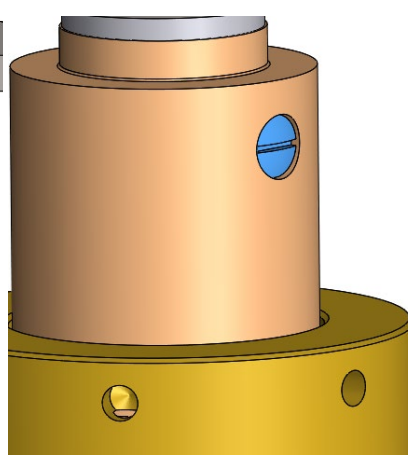
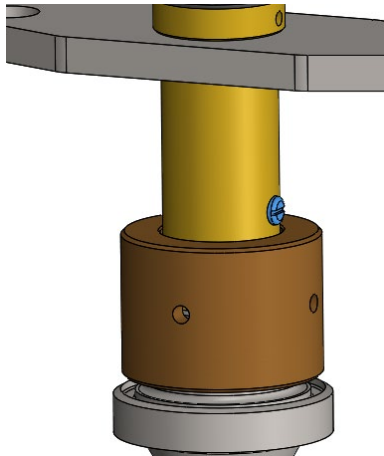
Depending on the nominal width, an additional bearing washer is required. If used, it has been revealed during disassembly. Also grease the bearing washer using Gleitmo 599.



7		Couple the drive spindle with the insert. Please note: Depending on the nominal width, the insert must be lifted first to be coupled. The insert must not be dropped! This may result in damage to the seat surface. 
---	---	---

8		Carefully lift the entire unit (marked blue) over the drive spindle and move it back down. (cross piece, upper part and sleeve nut) From DN80 (cross piece, upper part and flange nut)  Please note: During this step, it must be ensured that the drive spindle is not scratched. 
9		DN2 to DN65 Tighten the sleeve nut using the articulated hook wrench until it blocks. Then tighten using a hammer. DN2 to DN40-36 Articulated hook wrench 35-60/4 DN40 to DN65 Articulated hook wrench 95-155/6
		From DN80 Tighten all cylinder head screws using an Allen wrench. DN80 to DN100 Allen-type wrench, 10mm DN125 to DN150 Allen-type wrench SW14


10



DN2 to DN40-36

Clean the o-ring and orifice opening using rubbing alcohol. Then, assemble the o-ring onto the screw.

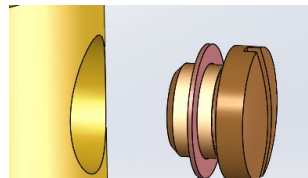
Tighten the screw using the plain slot screwdriver, no. 3.



DN40 to DN65

Clean the copper gasket and orifice opening using rubbing alcohol. Then, assemble the copper gasket onto the screw.


Tighten the orifice opening using the plain slot screwdriver, no. 4.

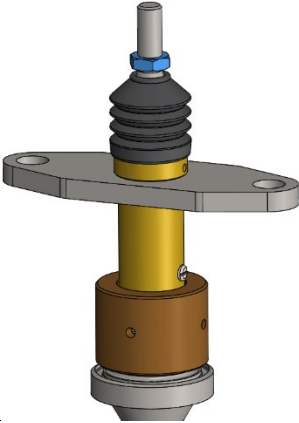
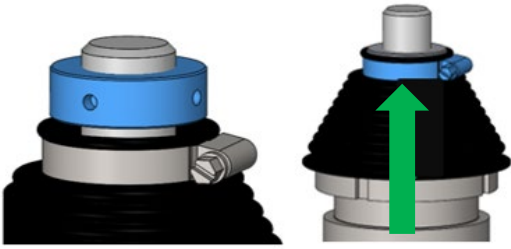


From DN80

Clean the orifice opening using rubbing alcohol.

Assemble the plug greased with Gleitmo 599 using the open-end spanner SW13.



11		DN2 to DN65 Screw the counter-nut onto the drive spindle by hand.
		From DN80 Step 1: Screw the counter-nut onto the drive spindle by hand. Step 2: Pull the hose clip with the rubber bellows onto the counter-nut Tighten the hose clip using the plain slot screwdriver, size 3.

6.5.11 Assembly of a TbxV/WbxV DNxx/PNxx valve

Prior to beginning with your work, you must first determine the nominal width of the valve, because there is a difference in the work steps for the different nominal widths. This information is provided on the valve (marking).



If the valve is an Hlc or Hlcp valve, the last work steps are not required. The drive spindle and the upper part are assembled differently.



Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW18
Plain slot screwdriver, no. 3
Articulated hook wrench 35-60/4
Rubbing alcohol
Lint-free cloth
Rhodorsil vacuum grease
Gleitmo 599

DN40 to DN65

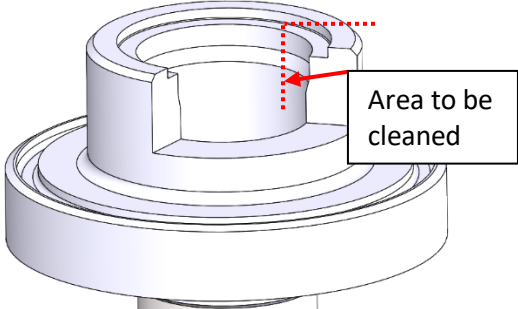
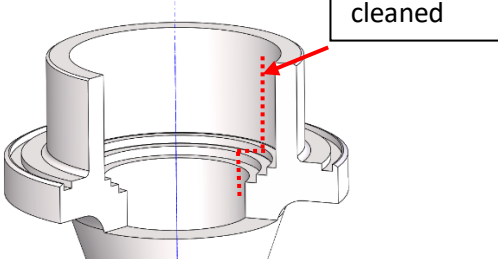
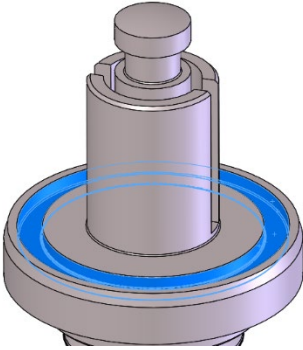
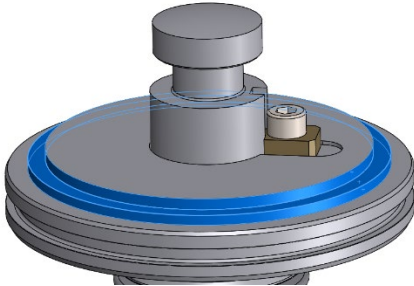
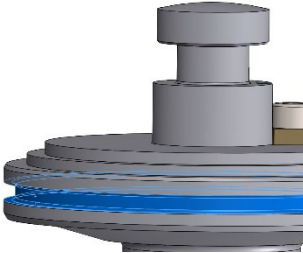
Open-end spanner SW24
Plain slot screwdriver, no. 4
Articulated hook wrench 95-155/6
Hand-held mounting tool, WEKA no. 2479
Rubbing alcohol
Lint-free cloth
Rhodorsil vacuum grease
Gleitmo 599

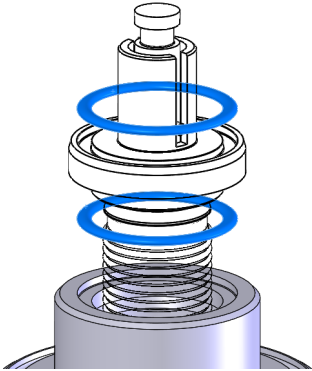
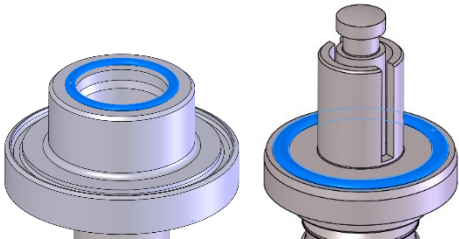
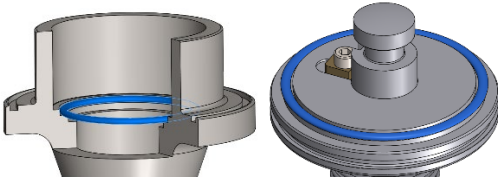

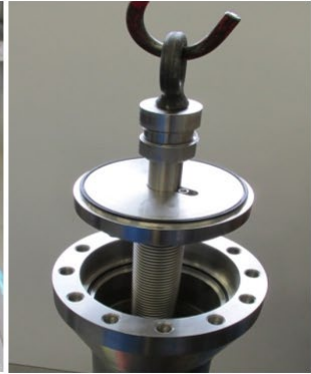
DN80 to DN100

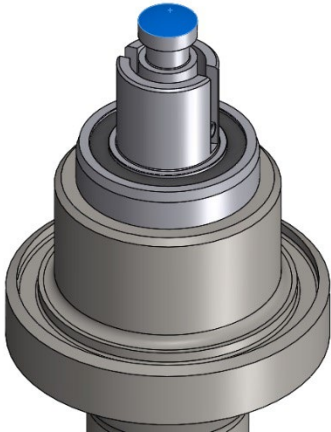

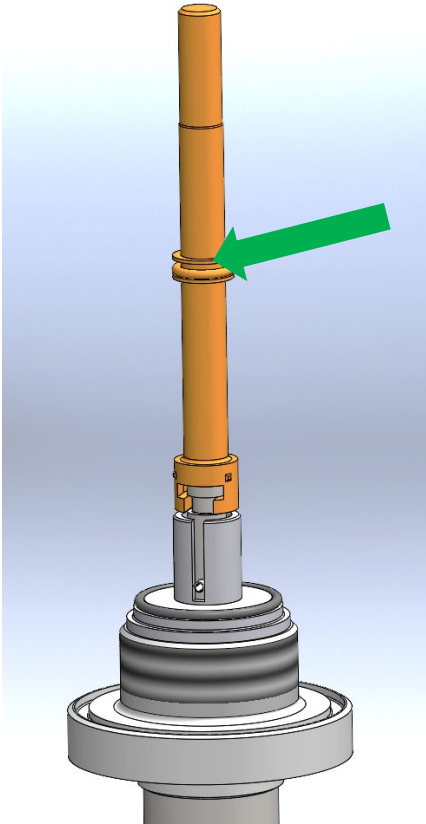
Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench, 10mm
Crane mounting tool, WEKA no. 1750
Rubbing alcohol
Lint-free cloth
Rhodorsil vacuum grease
Gleitmo 599

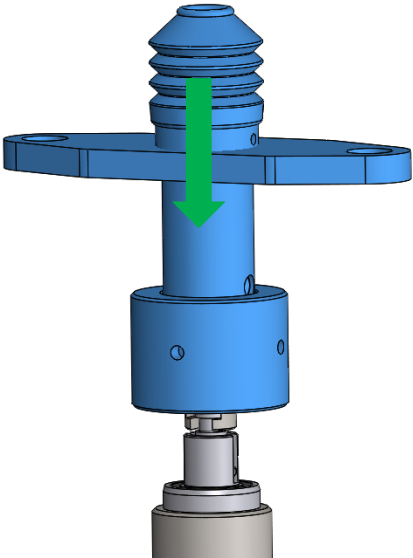
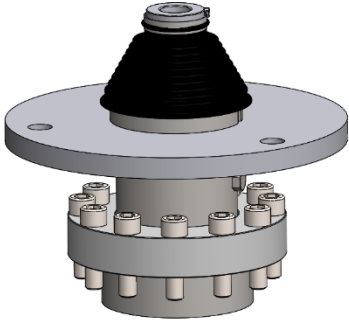
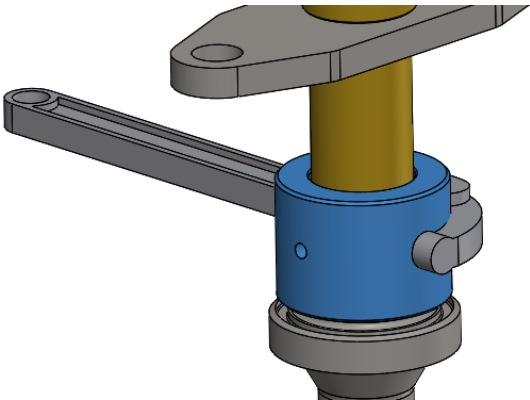
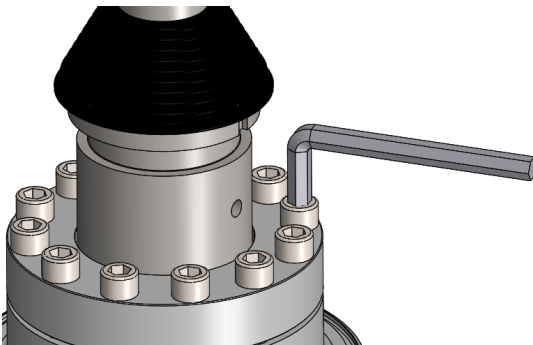
From DN125

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench SW14

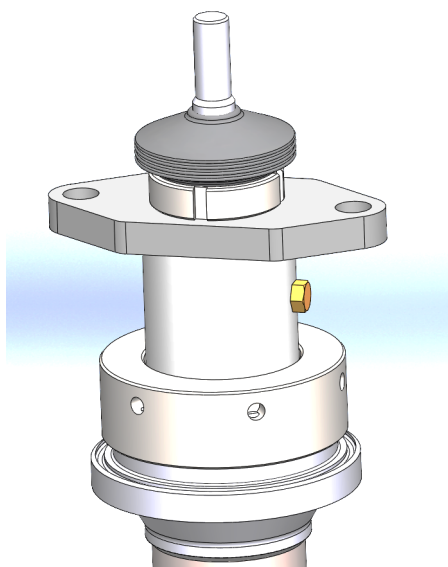
	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1	DN2 to D40-rb 	Clean the sealing surfaces at the threaded part of the housing using rubbing alcohol. The area to be cleaned depend on the nominal width. Please note: Use a lint-free cloth to avoid contamination. 
	From DN40 	
2	DN2 to D40-rb 	Clean the sealing surfaces at the piston (insert) using rubbing alcohol. The area to be cleaned depend on the nominal width. Please note: Use a lint-free cloth to avoid contamination. 
	From DN40 	Please note: With DN80 valves, a groove at the piston must be additionally cleaned.  

3		Clean the two o-rings of the piston using rubbing alcohol. Please note: Use a lint-free cloth to avoid contamination. Then grease slightly using Rhodorsil vacuum grease. 
4	DN2 to D40-rb  From DN40 	Assemble the two o-rings. Place one o-ring onto the cleaned surface of the threaded part and the other onto the piston of the insert. Please note: For DN80 valves, the o-ring must be assembled radially at the piston instead of the threaded part.  
5	 Lift the insert by hand.	   Lift the insert using a hand-held mounting tool or a crane mounting tool. Special tools can be purchased from WEKA AG. DN 40 to DN65 Hand-held mounting tool, WEKA no. 2479 DN80 to DN200 Crane mounting tool, WEKA no. 1750

	Attention Carefully move the insert into the housing and guide it with one hand! Damage to the control cone or other parts must always be avoided. Depending on the nominal width and cryogenic length of the valve, this work step should preferably be performed by 2 persons.	
6		Grease the face side, marked blue, using Gleitmo 599. Please note: Depending on the nominal width, an additional bearing washer is required. If used, it has been revealed during disassembly. Also grease the bearing washer using Gleitmo 599.  
7		Assemble the o-ring. Place one o-ring onto the cleaned surface of the between the backup rings. Couple the drive spindle with the insert. Please note: Depending on the nominal width, the insert must be lifted first to be coupled. The insert must not be dropped! This may result in damage to the seat surface. 
8		

9		Carefully lift the entire unit (marked blue) over the drive spindle and move it back down. (cross piece, upper part and sleeve nut) From DN80 (cross piece, upper part and flange nut)  Please note: During this step, it must be ensured that the drive spindle is not scratched. 
10		DN2 to DN65 Tighten the sleeve nut using the articulated hook wrench until it blocks. Then tighten using a hammer. DN2 to DN40-36 Articulated hook wrench 35-60/4 DN40 to DN65 Articulated hook wrench 95-155/6
		From DN80 Tighten all cylinder head screws using an Allen wrench. DN80 to DN100 Allen-type wrench, 10mm DN125 to DN150 Allen-type wrench SW14

11



Clean the orifice opening using rubbing alcohol.

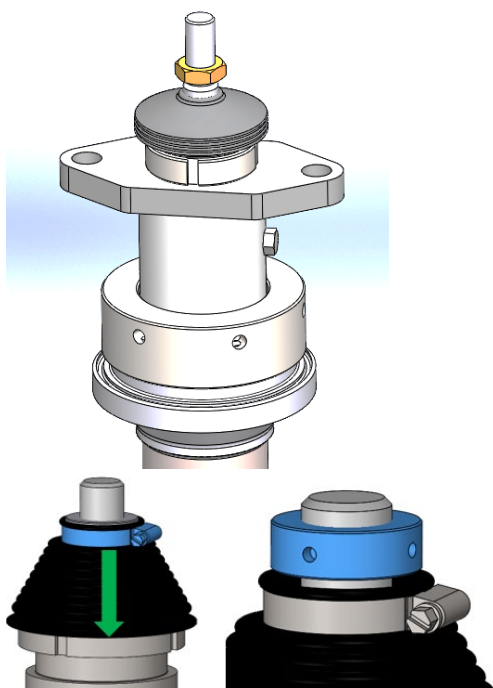

DN2 – DN32

Clean the o-ring and orifice opening using rubbing alcohol. Then, assemble the o-ring onto the screw.

Tighten the screw using a plain slot screwdriver.

From DN40

Assemble the plug greased with Gleitmo 599 using the open-end spanner SW13.



DN2 to DN65

Screw the counter-nut onto the drive spindle by hand.

From DN80

Step 1:

Screw the counter-nut onto the drive spindle by hand.

Step 2:

Pull the hose clip with the rubber bellows onto the counter-nut. Tighten the hose clip using the plain slot screwdriver, size 3.

6.5.12 Assembly of a TcxV/WcxV DNxx/PNxx valve

Prior to beginning with your work, you must first determine the nominal width of the valve, because there is a difference in the work steps for the different nominal widths. This information is provided on the valve (marking).



If the valve is an Hlc or Hlcp valve, the last work steps are not required. The drive spindle and the upper part are assembled differently.



Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW18
Plain slot screwdriver, no. 3
Allen wrench 6mm
Rubbing alcohol
Lint-free cloth
Rhodorsil vacuum grease
Gleitmo 599

DN40 to DN65

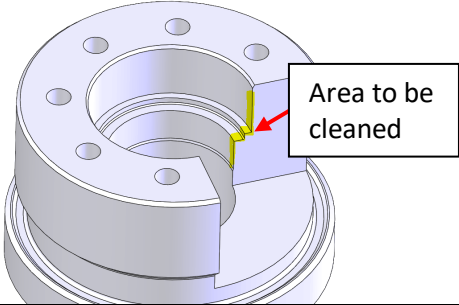
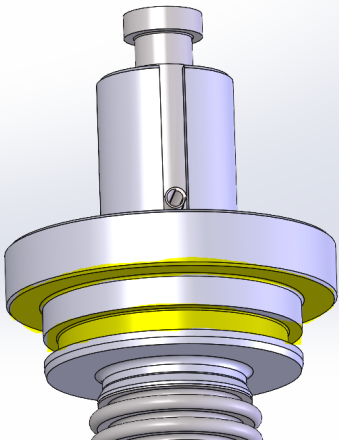
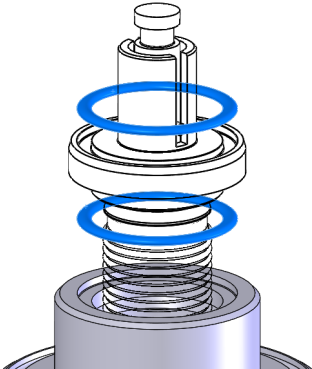
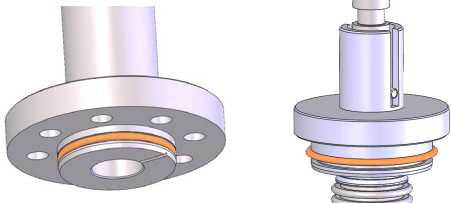
Open-end spanner SW24
Plain slot screwdriver, no. 4
Allen wrench 8mm
Hand-held mounting tool, WEKA no. 2479
Rubbing alcohol
Lint-free cloth
Rhodorsil vacuum grease
Gleitmo 599

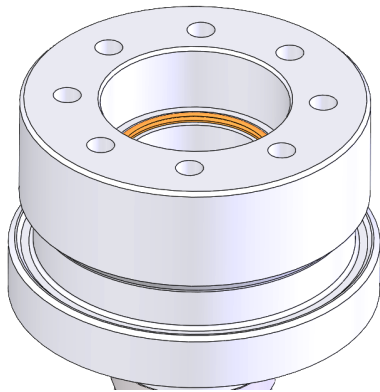
DN80 to DN100

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench, 10mm
Crane mounting tool, WEKA no. 1750
Rubbing alcohol
Lint-free cloth
Rhodorsil vacuum grease
Gleitmo 599

From DN125

Plain slot screwdriver, size 3
Articulated hook wrench 35-65/4
Open-end spanner SW13
Allen-type wrench SW14

	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
12	DN2 to D40-rb 	Clean the sealing surfaces at the threaded part of the housing using rubbing alcohol. The area to be cleaned depend on the nominal width. Please note: Use a lint-free cloth to avoid contamination. 
13	DN2 to D40-rb 	Clean the sealing surfaces at the piston (insert) using rubbing alcohol. The area to be cleaned depend on the nominal width. Please note: Use a lint-free cloth to avoid contamination. 
14		Clean the two o-rings of the piston using rubbing alcohol. Please note: Use a lint-free cloth to avoid contamination. 
15		Assemble the two o-rings. Assemble the c-ring. Place one o-ring onto the cleaned surface of the threaded part and the other onto the piston of the insert.



Put the c-ring directly from the clean plastic bag onto the sealing surface.



Lift the insert by hand.



Lift the insert using a hand-held mounting tool or a crane mounting tool.

Special tools can be purchased from WEKA AG.

DN 40 to DN65

Hand-held mounting tool, WEKA no. 2479

DN80 to DN200

Crane mounting tool, WEKA no. 1750

Attention

Carefully move the insert into the housing and guide it with one hand! Damage to the control cone or other parts must always be avoided. Depending on the nominal width and cryogenic length of the valve, this work step should preferably be performed by 2 persons.



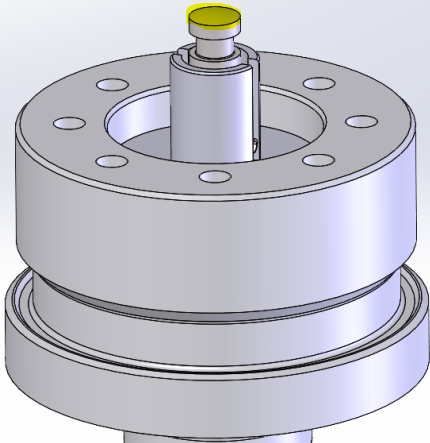

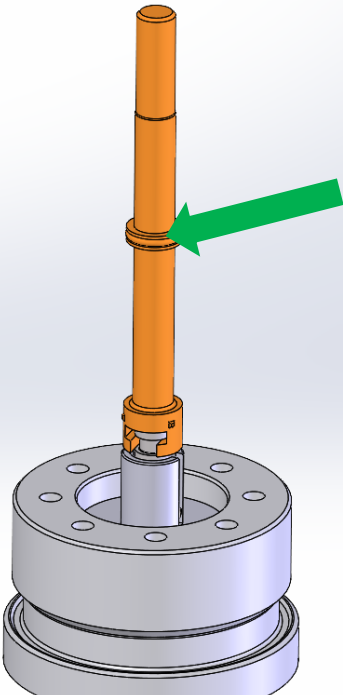
17

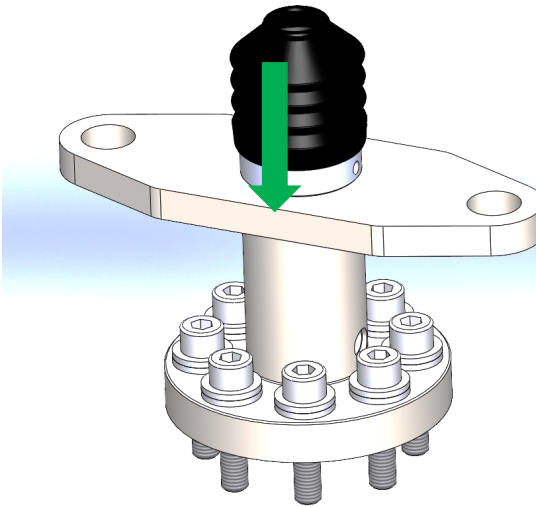
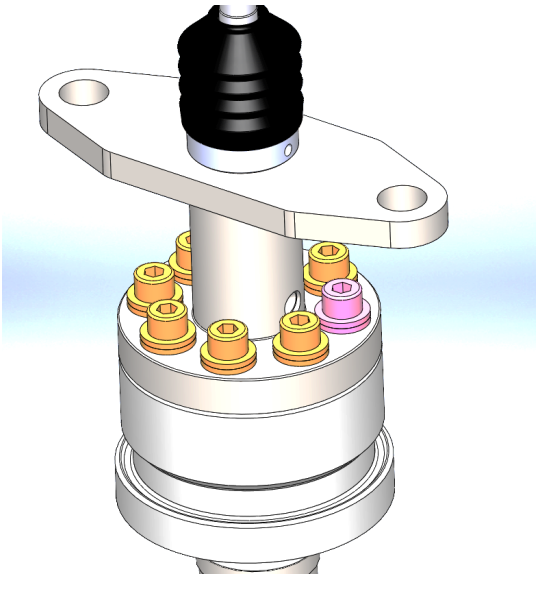
Grease the face side, marked yellow, using Gleitmo 599.

Please note:

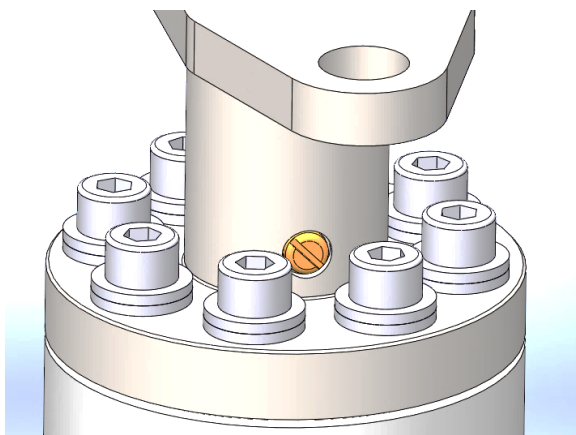
Depending on the nominal width, an additional bearing washer is required. If used, it has been revealed during disassembly. Also grease the bearing washer using Gleitmo 599.



		
18		Assemble the o-ring. Place one o-ring onto the cleaned surface between the backup rings. Couple the drive spindle with the insert. Please note: Depending on the nominal width, the insert must be lifted first to be coupled. The insert must not be dropped! This may result in damage to the seat surface. 

19		Carefully lift the entire unit over the drive spindle and move it back down. (cross piece, upper part and flange) Please note: During this step, it must be ensured that the drive spindle is not scratched. 
20		Tighten all cylinder head screws including the tension washers using an Allen wrench. Mounting torque: - M8 cylinder head screws: 21 Nm - M10 cylinder head screws: 41 Nm

21



Clean the orifice opening using rubbing alcohol.

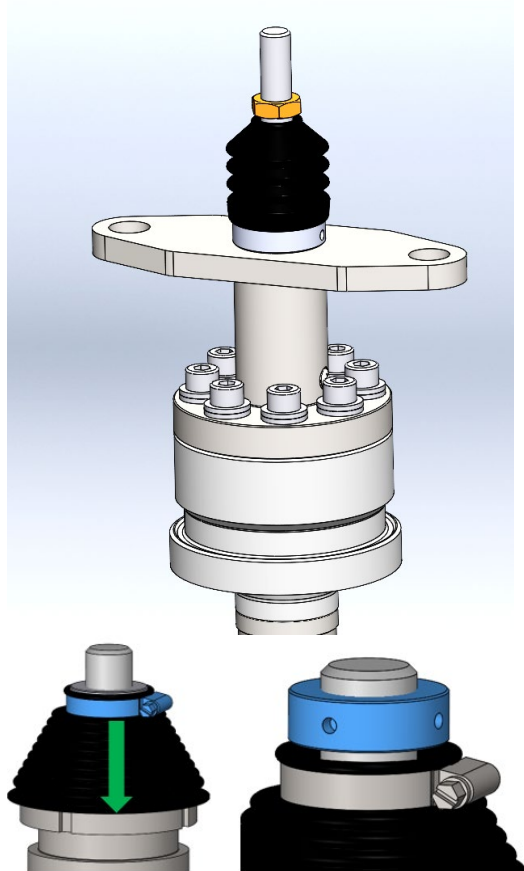
DN2 – DN32

Clean the o-ring and orifice opening using rubbing alcohol. Then, assemble the o-ring onto the screw.

Tighten the screw using a plain slot screwdriver.

From DN40

Assemble the plug greased with Gleitmo 599 using the open-end spanner SW13.



DN2 to DN65

Screw the counter-nut onto the drive spindle by hand.

From DN80

Step 1:

Screw the counter-nut onto the drive spindle by hand.

Step 2:

Pull the hose clip with the rubber bellows onto the counter-nut. Tighten the hose clip using the plain slot screwdriver, size 3.

6.5.13 Assembly of the Hlc or Hlcp drive unit

Required tools and auxiliary agents

DN2 to DN15

Allen-type wrench, 3mm

Allen-type wrench, 1.5mm for M3(for Hlcp version only)

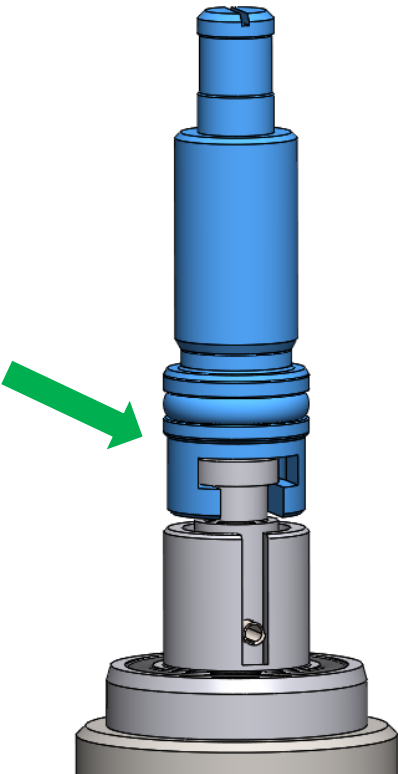
Articulated hook wrench 35-60/4

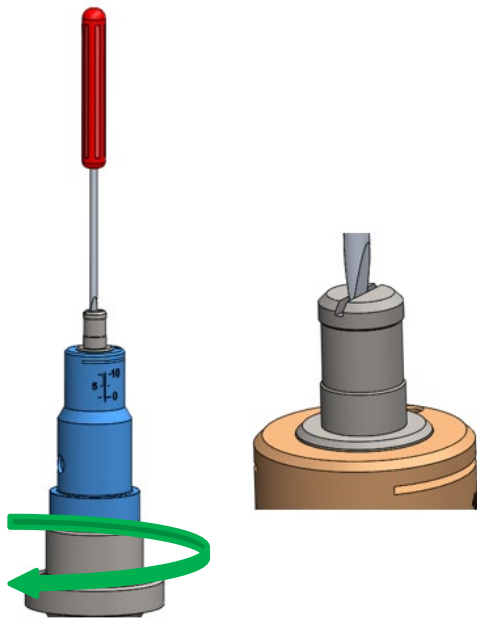
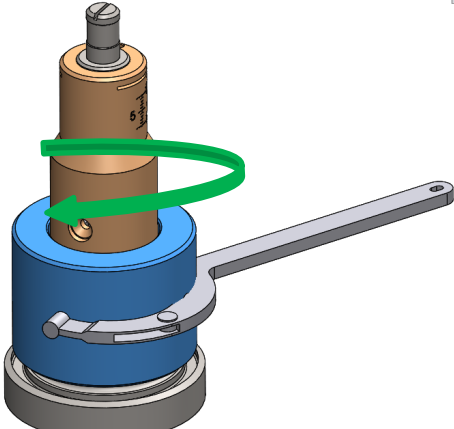
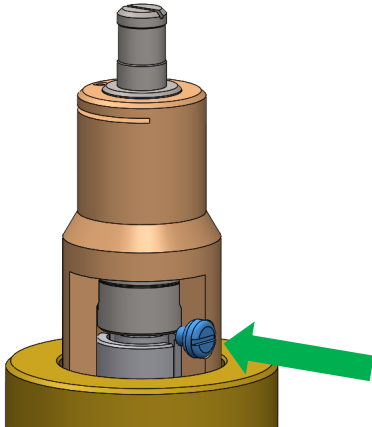
Plain slot screwdriver no. 3


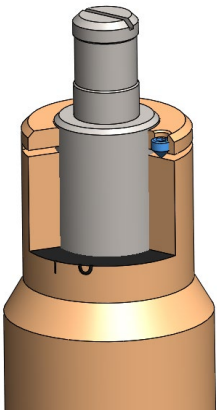
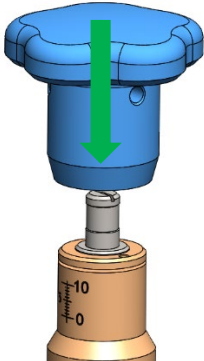
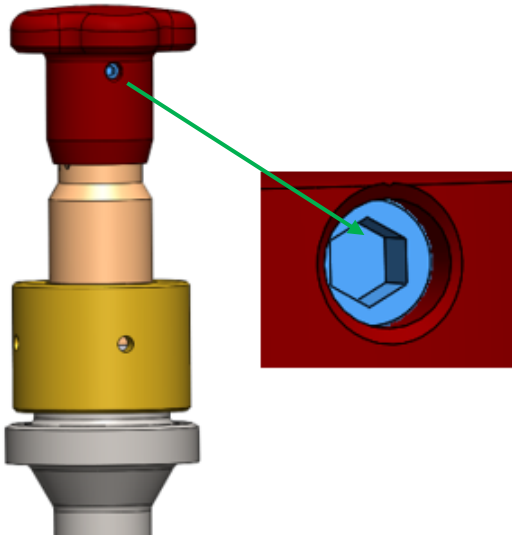
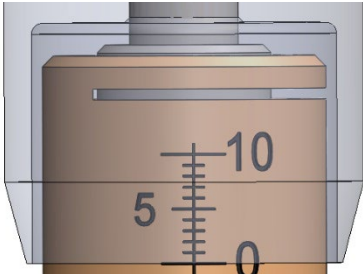
Rubbing alcohol

Lint-free cloth

Rhodorsil vacuum grease

	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Couple the drive spindle with the insert. Please note: WEKA AG recommends removing the o-ring installed in the drive spindle using a plastic tool and to clean the sealing surface of the o-ring using rubbing alcohol. Then, the o-ring must be greased using Rhodorsil vacuum grease. 

2		Carefully mount the upper part over the drive spindle until the thread blocks. Attention: Do not apply force, as you may damage the thread. Please note: If the units are jammed, the o-ring or (depending on nominal width) the support ring cannot be installed correctly. Fix the drive spindle in place using a plain slot screwdriver, size 3. A slot has been worked into the drive spindle specifically for that purpose. Subsequently, turn the upper part (marked blue) by hand until the upper part is fully screwed on and fixed.  
3		Tighten the sleeve nut (marked blue) using an articulated hook wrench 35-60/4 until fully fixed. Then tighten using a hammer.
4		DN2 to DN40-36 Clean the o-ring and orifice opening using rubbing alcohol. Then, assemble the o-ring onto the screw. Tighten the screw using the plain slot screwdriver, no. 3.

		
5		For Hlcp version (precision) Apply the threaded pin using an Allen wrench. DN2 to DN15 Wrench size no. 1.5 for M3
6		Assemble the hand wheel (marked blue) on the drive spindle.
7		Turn the 3 threaded pins into the hand wheel using an Allen wrench. Stop tightening shortly before the pins reach their end stop. Position the hand wheel so that zero stroke is just visible in closed condition.  Firmly tighten the threaded pin. Please note: With a Hlcp valve, the vernier must also be aligned to the stroke scale. 

		DN2 to DN15 Allen-type wrench, 3mm
--	--	--

6.5.14 Assembly of the HL drive unit

Required tools and auxiliary agents

DN50 to DN65

Allen-type wrench, 5mm

Open-end spanner with SW24

Open-end spanner with SW22

Depth gauge

DN80

Allen-type wrench, 6mm

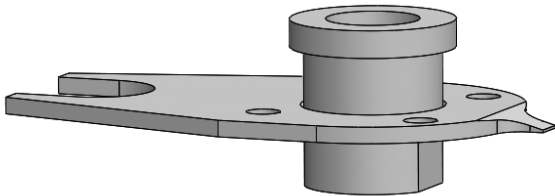
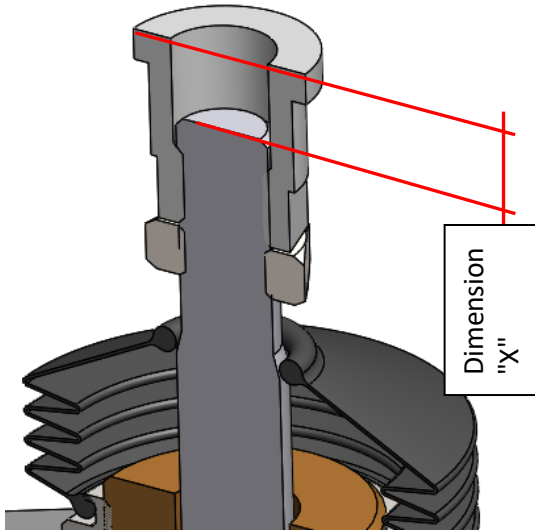
Open-end spanner with SW24

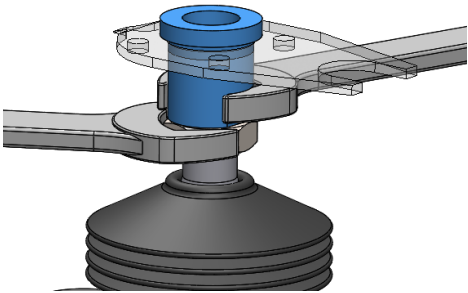
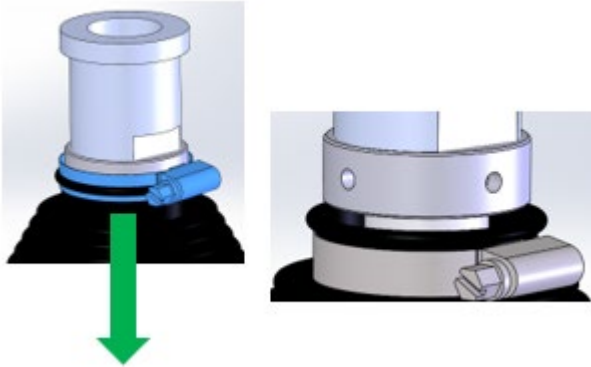
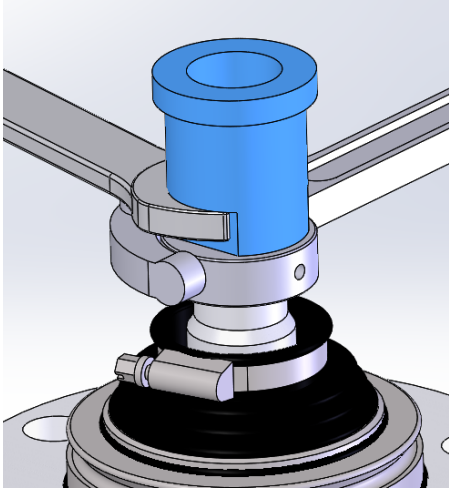
Depth gauge

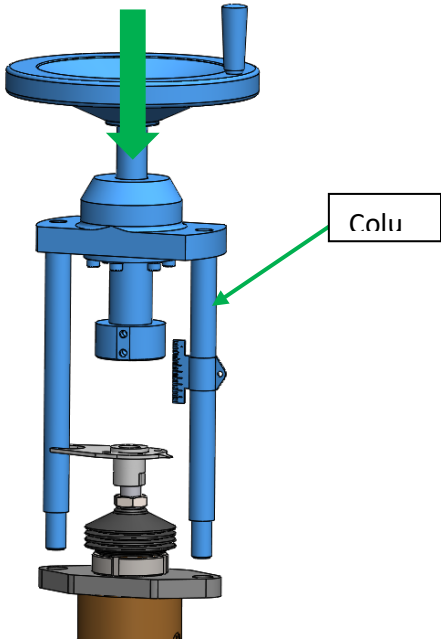
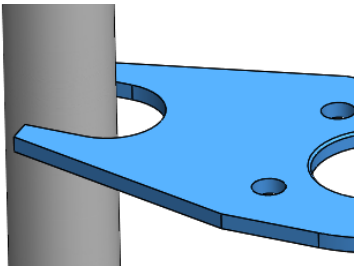
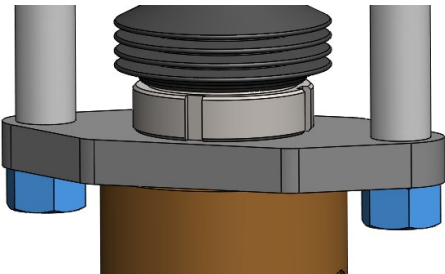
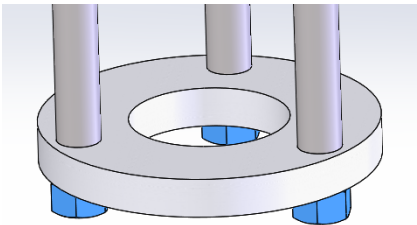
Plain slot screwdriver, size 3

Open-end spanner SW30

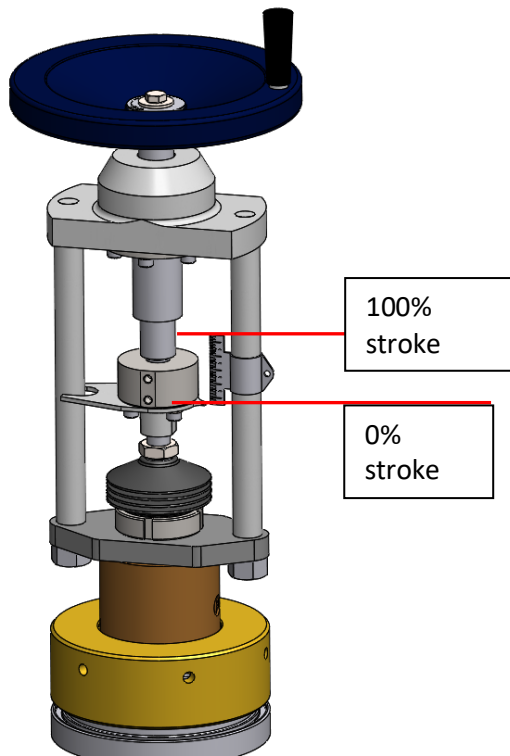
Articulated hook wrench 35-60/4

	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Insert the anti-twist plate into the coupling from below.
2		Assemble the coupling on the drive spindle and tighten hand-tight. It is mandatory to set dimension "X" (measured prior to disassembly) again. Please note: This work step is critical for the correct stroke. 

DN2 to DN65	From DN80
 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Tighten the coupling. DN50 to DN65 Open-end spanner SW22 & SW24 Check dimension "X" again. 3	Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. → The counter-nut with holes is exposed.  Step 2: Using an open-end spanner as shown in the picture, hold the coupling (marked blue). Using an articulated hook wrench, hold the counter-nut. Tighten the coupling.  Check dimension "X" again. Step 3: Pull the hose clip with the rubber bellows onto the counter-nut. Then re-tighten the hose clip. DN80 Open-end spanner SW30 Articulated hook wrench 35-60/4

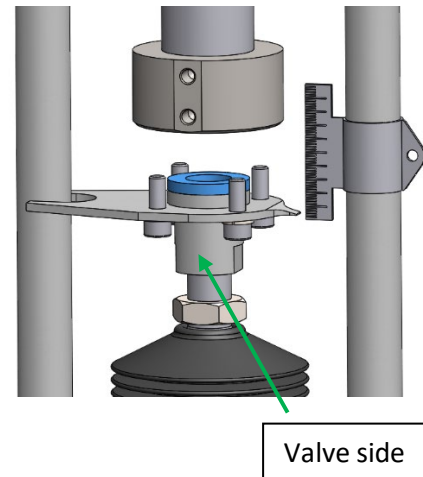
4		Turn the hand wheel to the open position. Carefully assemble the complete hand wheel unit. Please note: Do not hold or lift the manual drive unit by the hand wheel. We recommend holding it by the columns.  The anti-twist plate must be positioned such that it is retracted in the column. 
5		Tighten the hex nut using the open-end spanner. DN50 to DN80 Open-end spanner SW24 Please note: From DN80, the manual column drive is fixed by 3 columns. Therefore, all 3 nuts need to be tightened.  

6



Step 1:

Place the thrust washer (marked blue) back onto the coupling on the valve side (must be concentrically positioned).



Put the valve in completely closed position by turning the hand wheel.

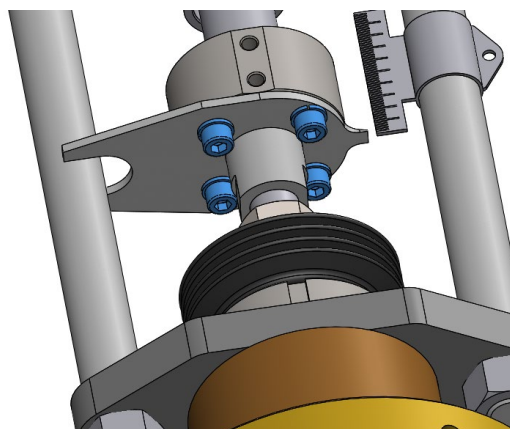
0% stroke position

Attention:

Blocking or jamming must be avoided. If it could not be avoided, place the drive in 100% stroke position again and re-position the thrust washer.



7



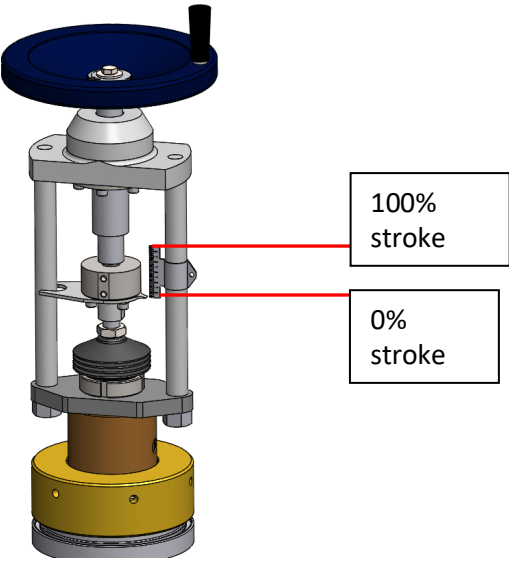
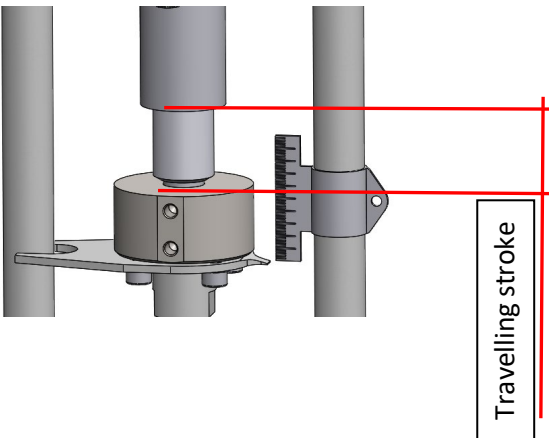
Tighten the washers and cylinder head screws (4x) using an Allen wrench.

DN50 to DN65

Allen-type wrench, 5mm

DN80

Allen-type wrench, 6mm

8		Perform the stroke check If the stroke is incorrect, either the bearing washer has not been installed correctly or the dimension "X" has been set incorrectly. 
---	---	--

6.5.15 Setting of the preload pressure

General information

Please read this manual carefully before starting work!

The modification of valves may only be done by trained and experienced personnel familiar with the product.

According to these mounting and operating instructions, "trained personnel" refers to individuals who are able to judge the work they are assigned to and recognize possible dangers due to their specialized training, their knowledge and experience as well as their knowledge of the relevant standards.

Any hazards that could be caused by the process medium, the operating pressure, the signal pressure or by moving parts of the control valves are to be prevented by means of the appropriate measures.

The modification has to be performed in a clean room where all adequate tools are available.

Valves should be in the vertical position with the actuator on the top. Intermediate storage of valve parts after disassembly should be in clean environment and parts wrapped in a plastic bag!

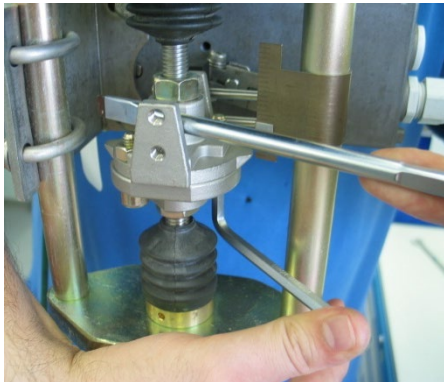
Before starting it is to be determined if the actuator is Po or Ps (Po = normally closed, Ps= normally open) because there is a difference in the work procedure.

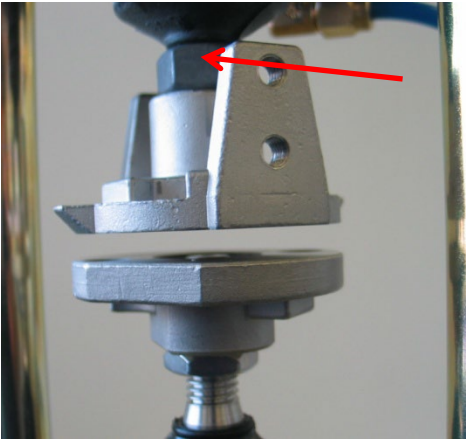
Utilised Tools

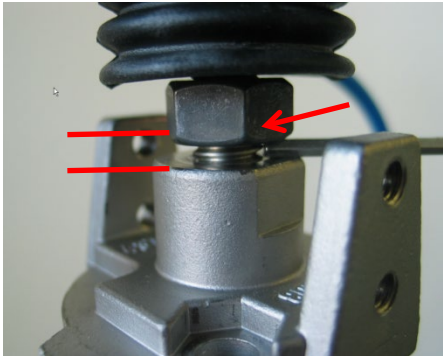
Allen key No 6

Flat screwdriver No 5 or bigger

Flat spanner No 19 & 24

	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Connect the shop air either direct on the actuator or over the positioner. Use shop air with 3bar pressure. Ps actuator Actuate the actuator before unloosen the 2 allen screws on the coupling halves. Po actuator Both screws can be unloosen with allen key No 6 without actuation of the actuator.

2		Remove the allen screws and nuts. Unloosen the upper coupling half by unlocking the nut (arrow) with a flat spanner No 19. Use again the flat screwdriver to lock (see pict. above). Turn up the upper coupling half for several revolutions. Close the actuator completely. Caution! Keep your fingers out of the danger zone!!! Ensure that both coupling halves do not contact after closing
3		Turn down the upper coupling half (actuator still closed) until they touch each other. Fix the counter nut by hand.
4		Open the actuator completely. Pressurize the Po actuator Depressurize the Ps actuator

5		Set the needed preload pressure by turning down the upper coupling half. To control leave the counter nut untouched and measure the distance between. Thread M12 is equal to 1.5mm gradient per revolution. Caution! The correct preload pressure is stated on the valve drawing and has to be observed.
6		Carefully connect both coupling halves by closing the actuator. Caution! Keep your fingers out of the danger zone!!! <i>It is recommended that the screws are mounted simultaneously with the closing of the actuator.</i>
7		Reassemble the nuts. Lock the counter nut by using a flat spanner No 19.
8		Tighten the screws with the allen key No 6 strongly. To lock the coupling halves use a flat screw driver No 5.

6.5.16 Assembly of the PM drive, vonRohr type

Prior to beginning with your work, you must first determine whether the drive is Po (closed at zero pressure) or Ps (open at zero pressure), because there is a difference in the work steps for the two types. This information can be found on the type plate of the drive.

Please Note:

Setting the preload for all cryogenic valves shall be performed according to chapter **6.5.15 Setting of the preload pressure.**

If any topic regarding setting the preload pressure is not clear to you, please do not hesitate to contact us.

Po drive

Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW13
Open-end spanner SW18
Open-end spanner SW24
Allen-type wrench, 6mm
Depth gauge

DN40 to DN65

Open-end spanner SW13
Open-end spanner SW24 (2x)
Allen-type wrench, 6mm
Depth gauge

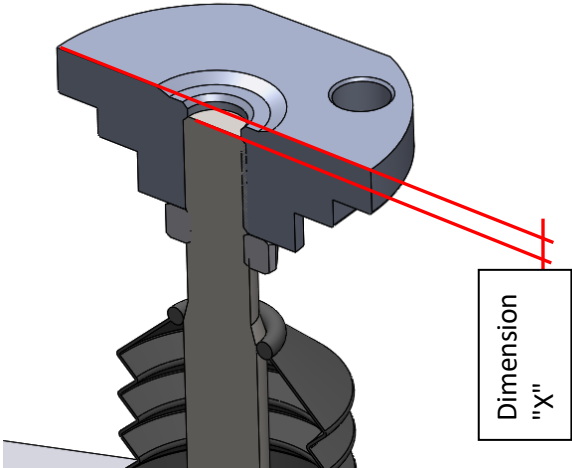
DN80

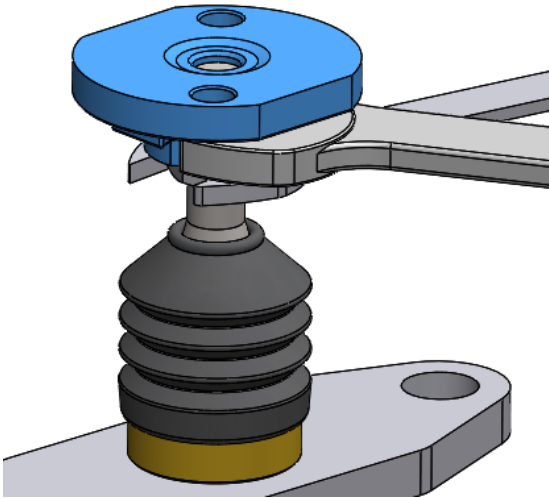
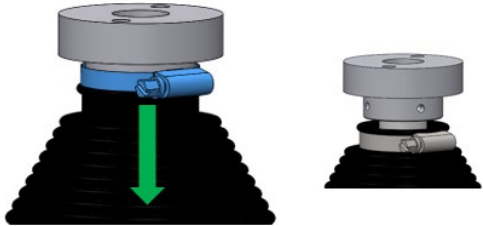
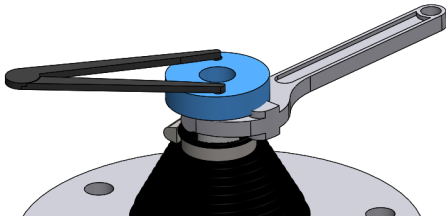
Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 6mm
Plain slot screwdriver, size 3
Face spanner with pins D6
Articulated hook wrench 35-60/4
Depth gauge

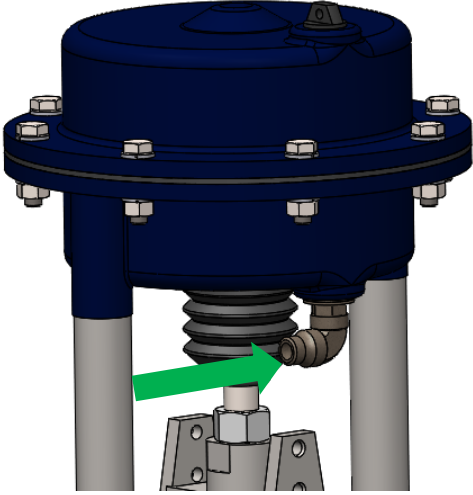
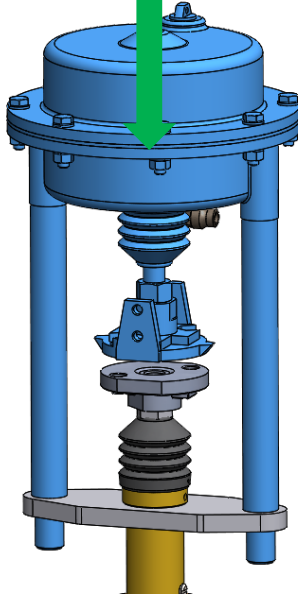
DN125

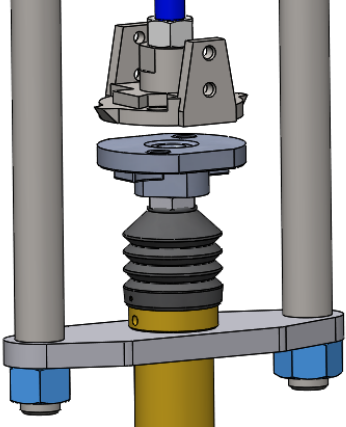
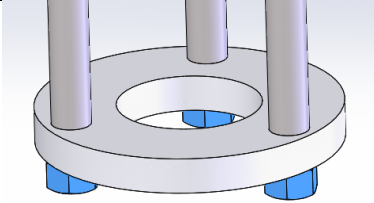
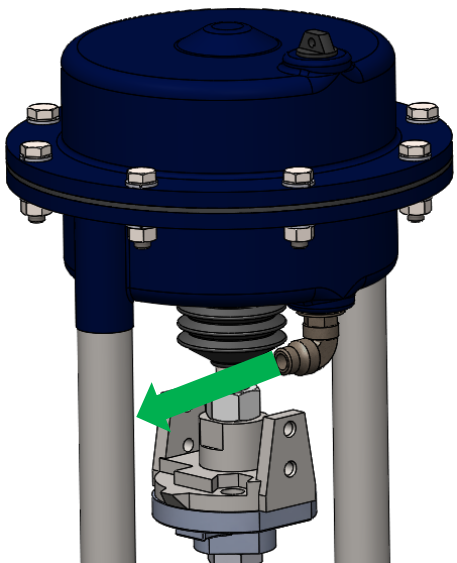
Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 10mm
Plain slot screwdriver, size 3
Open-end spanner SW36
Articulated hook wrench 35-60/4
Depth gauge

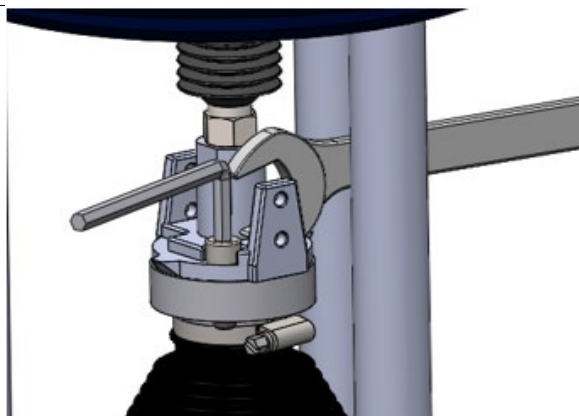


	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Assemble the coupling on the drive spindle and tighten hand-tight. It is mandatory to set dimension "X" (measured prior to disassembly) again. Please note: This work step is critical for the correct stroke. 

	DN2 to DN65	From DN80
	 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Tighten the coupling.	Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. → The counter-nut with holes is exposed.  Step 2: Using a face spanner as shown in the picture, hold the coupling (marked blue). Using an articulated hook wrench, hold the counter-nut. Tighten the coupling.  Check dimension "X" again. Step 3: Pull the hose clip with the rubber bellows onto the counter-nut. Then re-tighten the hose clip. DN80 Face spanner with pins D6 Articulated hook wrench 35-60/4 DN125 Open-end spanner SW36 Articulated hook wrench 35-60/4
2	DN2 to DN40-36 Open-end spanner SW18 & SW24 DN40 – DN65 Open-end spanner SW24 & SW24 Check dimension "X" again.	

3		Re-connect the compressed air line to the drive. The maximum and minimum air pressure values are provided in the customer drawing. Please note: The maximum air pressure of 6 bar must not be exceeded; higher pressure will result in damage to the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive.  
4		Carefully assemble the complete hand wheel unit. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. Please note: Depending on the nominal width or the drive type, the work should be performed by two persons or using a crane. Please note: The coupling must be aligned as shown in the picture. If that is not the case, the drive spindle can be turned carefully so that the holes are aligned.   
5		Tighten the hex nut using an open-end spanner SW24 Remark: With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.!

		
6		Remove the compressed air line from the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 
7		DN2 to DN65 Tighten the screws, incl. nut at the coupling using a 6mm Allen wrench. Using a screwdriver, press against the coupling. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. 



DN80 to DN125

Tighten the screws at the coupling using an Allen wrench. Using a screwdriver, press against the coupling.

Attention:

The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface.



DN80

Allen-type wrench, 6mm

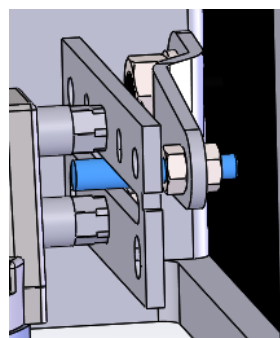
DN125

Allen-type wrench, 10mm

If position controllers are used

Step 1:

Swivel back the position controller. Insert the pin into the tappet.

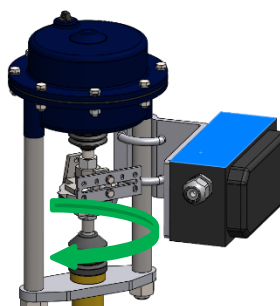


Step 2:

Tighten the 4 hex nuts using the open-end spanner SW13.

Step 3:

Re-connect the screw-fitting of the compressed air line with the position controller.



8

Please note:

If the pin does not easily fit into the tappet, the coupling has not been aligned correctly.



Ps drive

Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW13
Open-end spanner SW18
Open-end spanner SW24
Allen-type wrench, 6mm
Depth gauge

DN40 to DN65

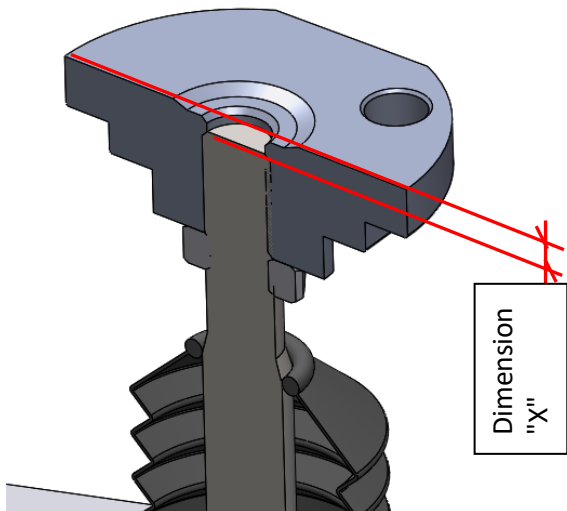
Open-end spanner SW13
Open-end spanner SW24 (2x)
Allen-type wrench, 6mm
Depth gauge

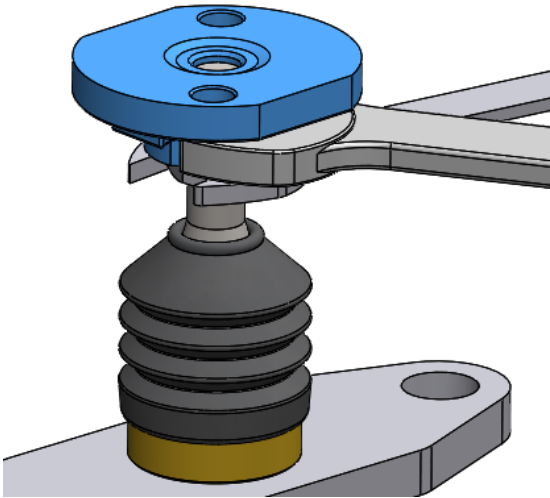
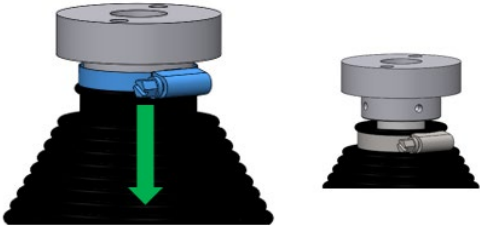
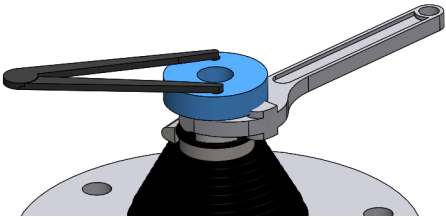
DN80

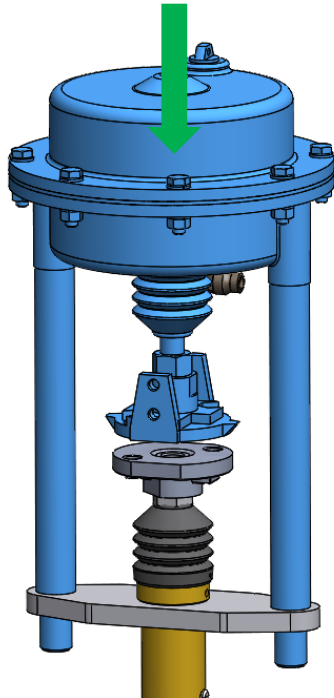
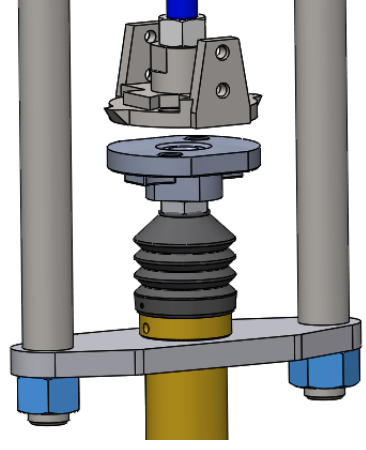
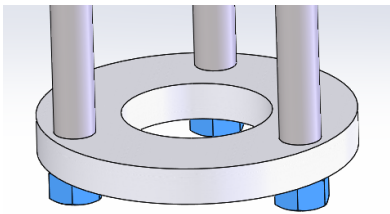
Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 6mm
Plain slot screwdriver, size 3
Face spanner with pins D6
Articulated hook wrench 35-60/4
Depth gauge

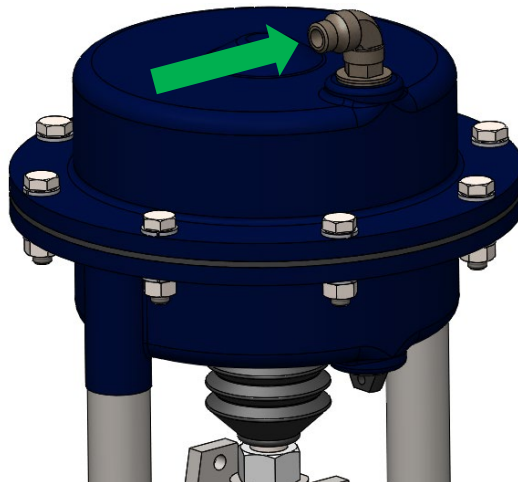
DN125

Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 10mm
Plain slot screwdriver, size 3
Open-end spanner SW36
Articulated hook wrench 35-60/4
Depth gauge

	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
9		Assemble the coupling on the drive spindle and tighten hand-tight. It is mandatory to set dimension "X" (measured prior to disassembly) again. Please note: This work step is critical for the correct stroke. 

	DN2 to DN65	From DN80
10	 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Tighten the coupling. DN2 to DN40-36 Open-end spanner SW18 & SW24 DN40 – DN65 Open-end spanner SW24 & SW24 Check dimension "X" again.	Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. → The counter-nut with holes is exposed.  Step 2: Using a face spanner as shown in the picture, hold the coupling (marked blue). Using an articulated hook wrench, hold the counter-nut. Tighten the coupling.  Check dimension "X" again. Step 3: Pull the hose clip with the rubber bellows onto the counter-nut. Then re-tighten the hose clip. DN80 Face spanner with pins D6 Articulated hook wrench 35-60/4 DN125 Open-end spanner SW36 Articulated hook wrench 35-60/4

11		Carefully assemble the complete hand wheel unit. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. Please note: Depending on the nominal width or the drive type, the work should be performed by two persons or using a crane. Please note: The coupling must be aligned as shown in the picture. If that is not the case, the drive spindle can be turned carefully so that the holes are aligned.   
12		Tighten the hex nut using an open-end spanner SW24 Remark: With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.! 
13		Re-connect the compressed air line to the drive. The maximum and minimum air pressure values are provided in the customer drawing. Please note: The maximum air pressure of 6 bar must not be exceeded; higher pressure will result in damage to the drive. 



Attention:

Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive.



DN2 to DN65

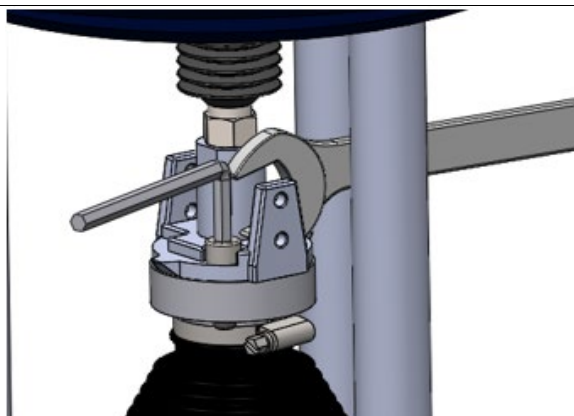
Tighten the screws, incl. nut at the coupling using a 6mm Allen wrench. Using a screwdriver, press against the coupling

Attention:

The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface.



14



DN80 to DN125

Tighten the screws at the coupling using an Allen wrench. Using a screwdriver, press against the coupling.

Attention:

The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface.



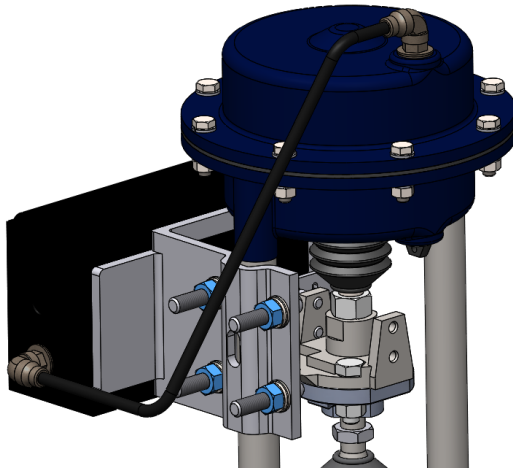
DN80

Allen-type wrench, 6mm

DN125

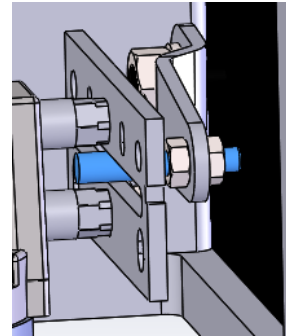
Allen-type wrench, 10mm

15



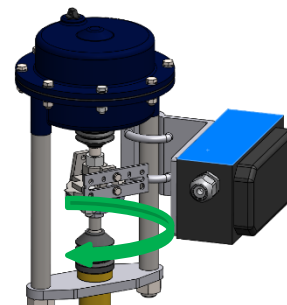
If position controllers are used

Step 1:
Swivel back the position controller. Insert the pin into the tappet



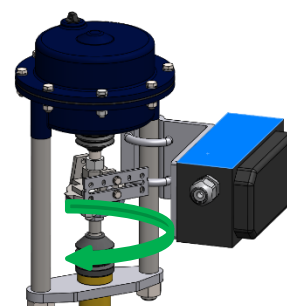
Step 2:
Tighten the 4 hex nuts using the open-end spanner SW13.

Step 3:
Re-connect the screw-fitting of the compressed air line with the position controller.



Please note:

If the pin does not easily fit into the tappet, the coupling has not been aligned correctly.



6.5.17 Assembly of the PM drive, Samson type

Prior to beginning with your work, you must first determine whether the drive is Po (closed at zero pressure) or Ps (open at zero pressure), because there is a difference in the work steps for the two types. This information is provided on the type plate of the drive

Please Note:

Setting the preload for all cryogenic valves shall be performed according to chapter **6.5.15 Setting of the preload pressure.**

If any topic regarding setting the preload pressure is not clear to you, please do not hesitate to contact us.

Po drive

Required tools and auxiliary agents

DN20

Open-end spanner SW8 (2x)
Open-end spanner SW13
Open-end spanner SW17
Open-end spanner SW18
Open-end spanner SW24
Depth gauge

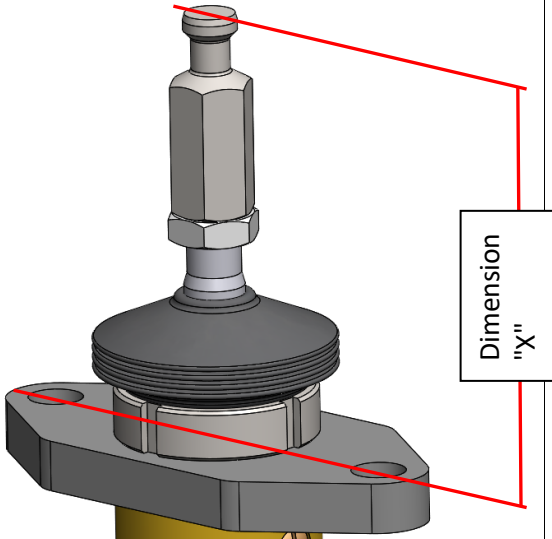
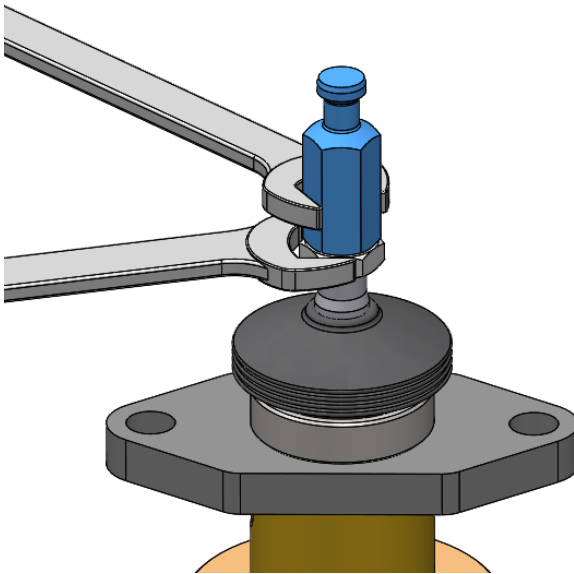
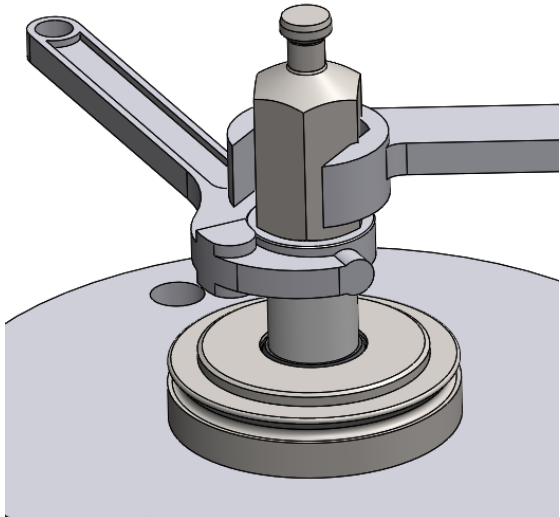
DN40 to DN65

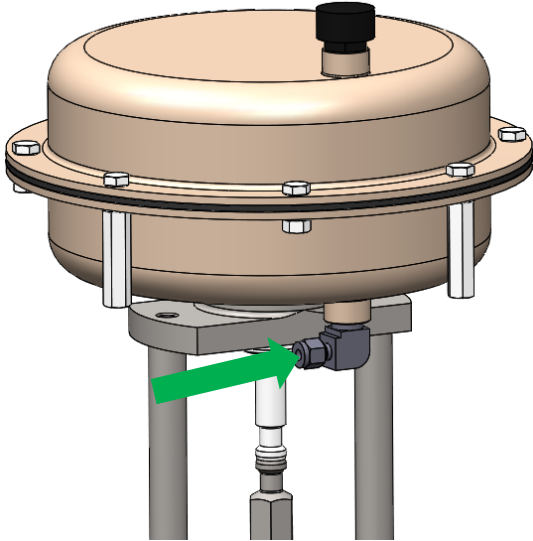
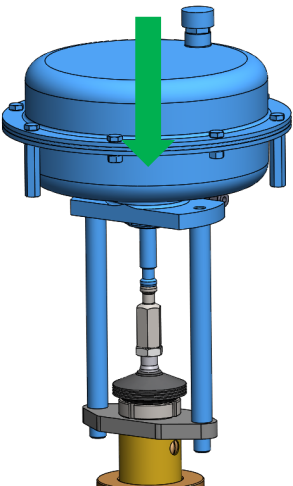
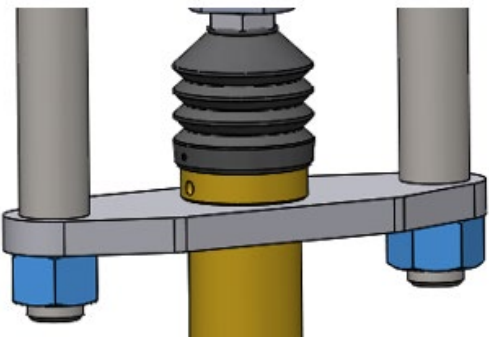
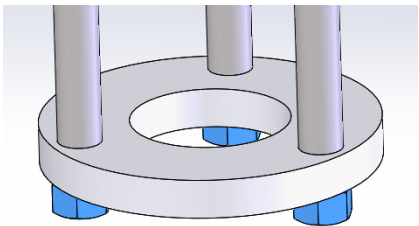
Open-end spanner SW10
Open-end spanner SW13
Open-end spanner SW22
Open-end spanner SW24
Depth gauge

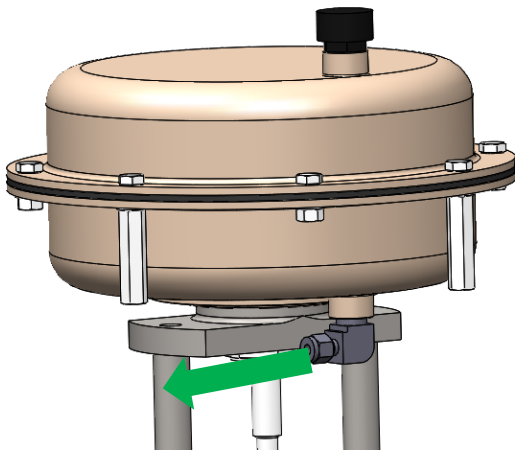
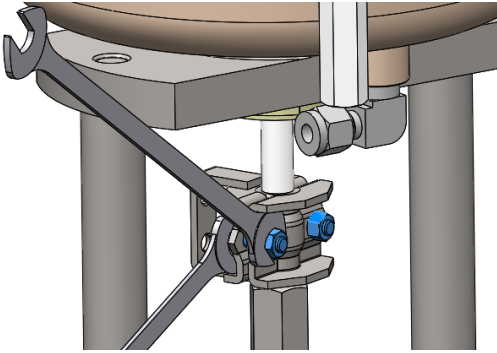
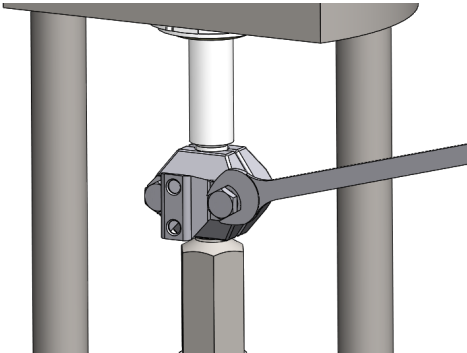
From DN80

Open-end spanner SW10
Open-end spanner SW13
Open-end spanner SW24
Open-end spanner SW32
Articulated hook wrench 35-60/4
Depth gauge

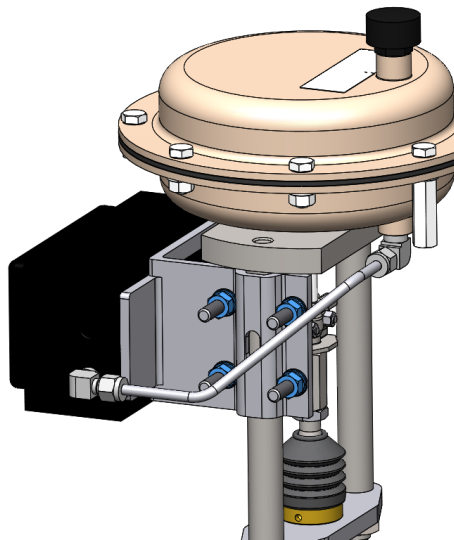


	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Assemble the coupling on the drive spindle and tighten hand-tight. It is mandatory to set dimension "X" (measured prior to disassembly) again. Please note: This work step is critical for the correct stroke 
	DN2 to DN65	From DN80
2		Using an open-end spanner SW32 as shown in the picture, hold the coupling. Using an articulated hook wrench 35-60/4, hold the counter-nut. Tighten the coupling.  Check dimension "X" again.
	Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Tighten the coupling. DN20 Open-end spanner SW17 & SW18 DN40 to DN65 Open-end spanner SW22 & SW24 Check dimension "X" again.	

3		Re-connect the compressed air line to the drive. The maximum and minimum air pressure values are provided in the customer drawing. Please note: The maximum air pressure of 6 bar must not be exceeded; higher pressure will result in damage to the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive.  
4		Carefully assemble the complete hand wheel unit. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. Please note: Depending on the nominal width or the drive type, the work should be performed by two persons or using a crane.  
5		Tighten the hex nut using an open-end spanner SW24 Remark: With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.! 

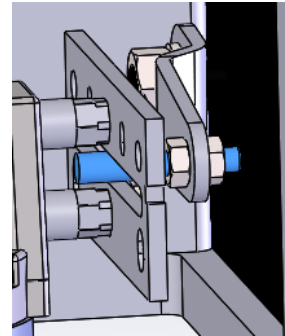
6		Remove the compressed air line from the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 
7		DN20 Tighten the screws, incl. nut at the coupling using two open-end spanners SW8. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. 
		From DN40 Tighten the screws at the coupling using two open-end spanners SW10. The coupling can be disassembled. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. 

8



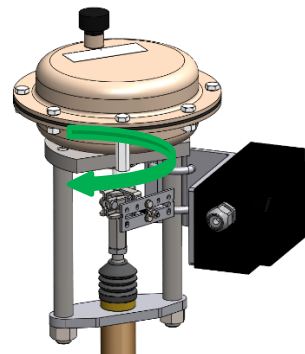
If position controllers are used

Step 1:
Swivel back the position controller. Insert the pin into the tappet.



Step 2:
Tighten the 4 hex nuts using the open-end spanner SW13.

Step 3:
Re-connect the screw-fitting of the compressed air line with the position controller.



Please note:

If the pin does not easily fit into the tappet, the coupling has not been aligned correctly.



6.5.18 Assembly of the PM drive, Sart-von-Rohr type for TbxV/WbxV or TcxV/WcxV valves

Prior to beginning with your work, you must first determine whether the drive is Po (closed at zero pressure) or Ps (open at zero pressure), because there is a difference in the work steps for the two types. This information can be found on the type plate of the drive.

Please Note:

Setting the preload for all cryogenic valves shall be performed according to chapter **6.5.15 Setting of the preload pressure.**

If any topic regarding setting the preload pressure is not clear to you, please do not hesitate to contact us.

Po drive

Required tools and auxiliary agents

DN2 to DN40-36

Open-end spanner SW13
Open-end spanner SW18
Open-end spanner SW24
Allen-type wrench, 6mm
Depth gauge

DN40 to DN65

Open-end spanner SW13
Open-end spanner SW24 (2x)
Allen-type wrench, 6mm
Depth gauge

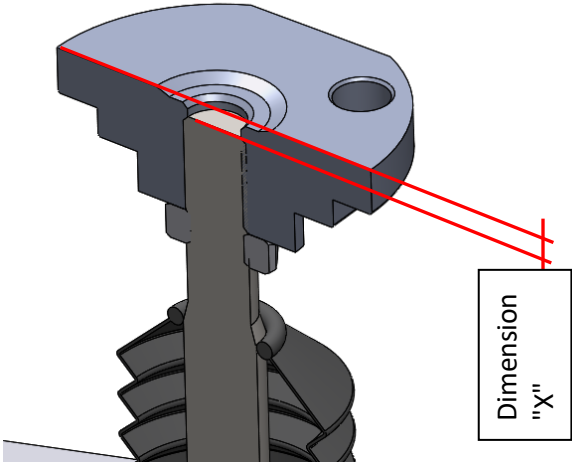
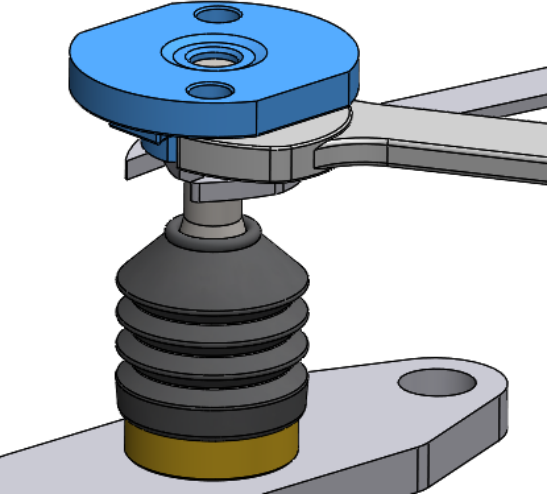
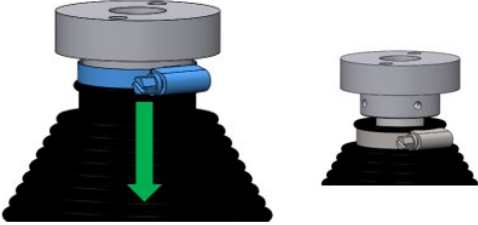
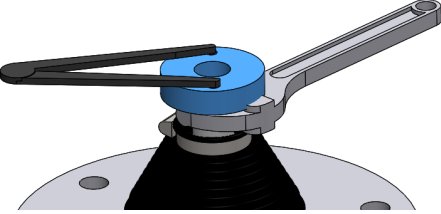
DN80

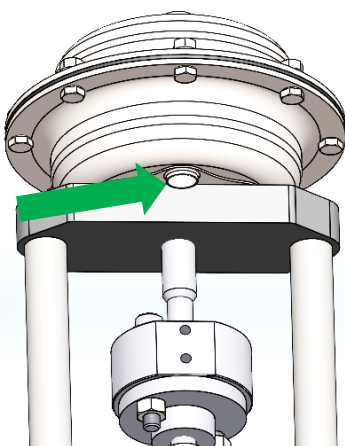
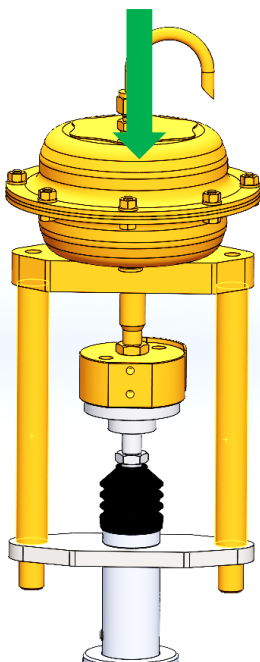
Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 6mm
Plain slot screwdriver, size 3
Face spanner with pins D6
Articulated hook wrench 35-60/4
Depth gauge

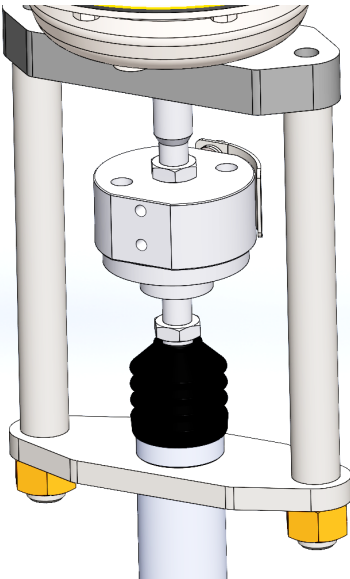
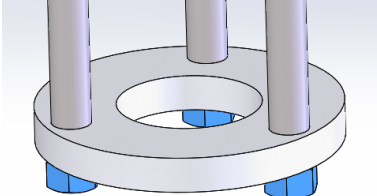
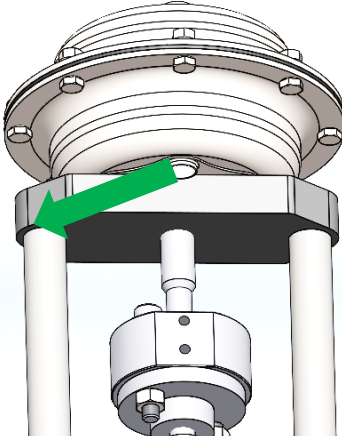
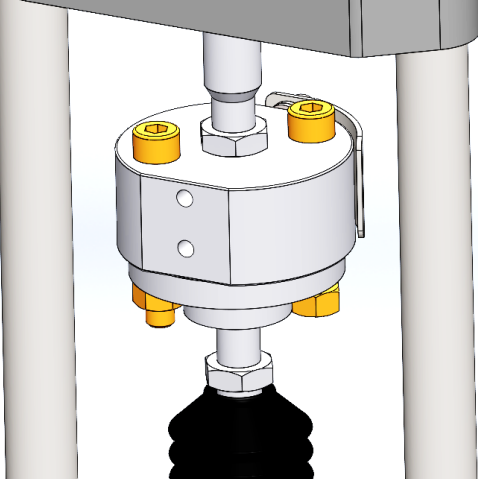
DN125

Open-end spanner SW13
Open-end spanner SW24
Allen-type wrench, 10mm
Plain slot screwdriver, size 3
Open-end spanner SW36
Articulated hook wrench 35-60/4
Depth gauge



	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the work steps remain the same.		
1		Assemble the coupling on the drive spindle and tighten hand-tight. It is mandatory to set dimension "X" (measured prior to disassembly) again. Please note: This work step is critical for the correct stroke. 
	DN2 to DN65	From DN80
2	 Using two open-end spanners as shown in the picture, hold the coupling (marked blue) and the nut at the drive spindle. Tighten the coupling. DN2 to DN40-36 Open-end spanner SW18 & SW24 DN40 – DN65 Open-end spanner SW24 & SW24 Check dimension "X" again.	Step 1: Loosen the hose clip using the plain slot screwdriver, size 3, so that the rubber bellows can be pulled down and removed. ➔ The counter-nut with holes is exposed.  Step 2: Using a face spanner as shown in the picture, hold the coupling (marked blue). Using an articulated hook wrench, hold the counter-nut. Tighten the coupling.  Check dimension "X" again. Step 3:

		Pull the hose clip with the rubber bellows onto the counter-nut Then re-tighten the hose clip. DN80 Face spanner with pins D6 Articulated hook wrench 35-60/4 DN125 Open-end spanner SW36 Articulated hook wrench 35-60/4
3		Re-connect the compressed air line to the drive. The maximum and minimum air pressure values are provided in the customer drawing. Please note: The maximum air pressure of 6 bar must not be exceeded; higher pressure will result in damage to the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive.  
4		Carefully assemble the complete actuator unit. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. Please note: Depending on the nominal width or the drive type, the work should be performed by two persons or using a crane. Please note: The coupling must be aligned as shown in the picture. If that is not the case, the drive spindle can be turned carefully so that the holes are aligned.   

5		Tighten the hex nut using an open-end spanner SW24 Remark: With larger nominal widths, there are 3 or 4 columns. All nuts need to be loosened and removed.! 
6		Remove the compressed air line from the drive. Attention: Drive and/or coupling are moving parts. Risk of injury! Keep your hands off the drive. 
7		DN2 to DN65 Tighten the screws, incl. nut at the coupling using a 6mm Allen wrench and an open-end spanner SW13. Attention: The insert must not be turned during disassembly, This could result in irreversible damage to the seat surface. 

6.5.19 Replacing the seals

A technical drawing is created for every valve. The respectively required replacement seals, including data such as dimensions, material, description and WEKA AG article number, are listed in the customer's drawings.

WEKA AG recommends cleaning every seal with rubbing alcohol before installing it. Also clean the corresponding sealing surface at the valve. To avoid contamination, use a lint-free cloth.

The cleaning instructions must be observed for the oxygen application.




WEKA AG recommends using vacuum grease (Gleitmo 599) for the o-rings.

WEKA AG recommends using vacuum grease (Gleitmo 599 with BAM approval) for the O-rings when operating with oxygen.

For exact instructions on the manner and sequence of cleaning and work steps, please see the disassembly and assembly instructions of the valve and/or the control cone.



Replacing the seat seal



To replace the seat seal (marked blue), perform the steps described in chapter 6.5.9 Replacing a control cone. After removal of the control cone, the seal can be replaced.

Please note:

Hard objects such as metal tools or dirt particles may damage the sealing surface.



Attention:

Always wear goggles when using compressed air.




Replacing the complete insert

To replace the insert, first, the drive unit needs to be disassembled, then, the instructions in chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve must be followed until the insert is exposed and free to remove.

WEKA AG recommends replacing all seals when replacing the insert.

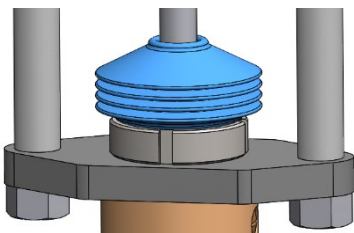


Replacing the o-rings at the insert



To replace the o-rings at the insert, first, the drive unit needs to be disassembled, then, the instructions in chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve must be followed until the insert is exposed. After that, the o-rings can be replaced.


Replacing the rubber bellows



To replace the rubber bellows, first, the drive unit needs to be disassembled, then, the instructions in chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve must be followed up to removal of the couplings and the counter-nut.

Then, the rubber bellows can be replaced.

Replacing the seal of the orifice hole



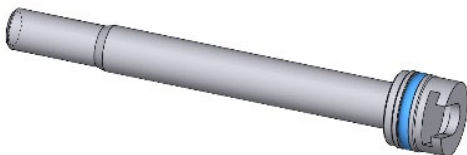
For the required tools, please see chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve. First, the orifice hole must be opened, then the seal must be removed and replaced by a new one.

DN2 to DN40-36: Replace o-ring

DN40 to DN65: Replace copper gasket

From DN80: Plug with PTFE band

Replacing the o-rings at the drive spindle, DN2 to DN65

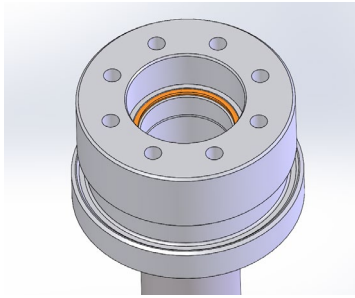


To replace the o-ring at the drive spindle, first, the drive unit needs to be disassembled, then, the instructions in chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve must be followed until the drive spindle is revealed. Then, the o-ring can be replaced.

With HIC valves, only the drive unit needs to be disassembled. In that case, the drive spindle is already loose.



Replacing the c-ring at the upper valve part for TcxV/WcxV valves

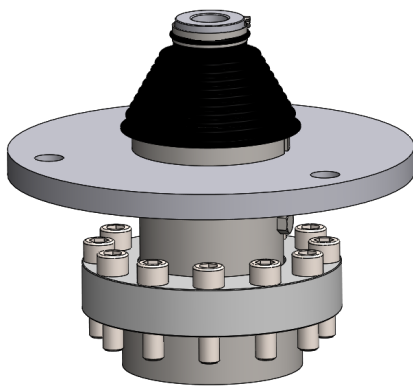


Remove the metallic c-ring using a plastic tool (avoiding damage at the seat surface) and store in a plastic bag. Clean the area. Then put a new c-ring into the groove.

The c-ring ensures the fire safety of the valve.
After removal WEKA recommends using a new c-ring.



Replacing the o-rings at the drive spindle, for DN80, for TbxV/WbxV and TcxV/WcxV valves



To replace the o-ring incl. support ring in the upper part, first, the drive unit needs to be disassembled, then, the instructions in chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve must be followed until the upper part, incl. the cross piece can be removed.

Clamp the upper part into the vice with soft clamping jaws. Then, remove the clamping nut for the cross piece using the hook wrench.

DN2 to DN40-36

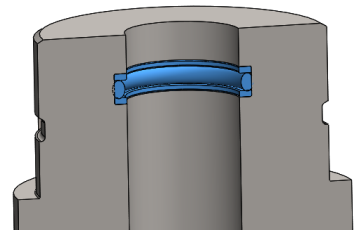
Hook wrench 34-36/4

DN40 to DN65

Hook wrench 58-62

For DN80

Hook wrench 80-90



Then, the o-ring incl. support ring can be removed from the upper part with a plastic tools.

Replacing the convection brakes



To replace the convection brakes, first, the drive unit needs to be disassembled, then, the instructions in chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve must be followed until the insert is exposed.

Step 1:

Remove the convection brakes by hand


Step 2:

Remove adhesive residues using a small file. There should be no more glue residue in the corners.

Step 3:

Clean the new convection brakes and the insert using rubbing alcohol (use a lint-free cloth).

Step 4:




Apply two to three spots of instant adhesive (as assembly aid) on the pipe between the weld-on steel rings (marked blue).

WEKA AG recommends using Loctite 403 (WEKA-no. 89417) as instant adhesive



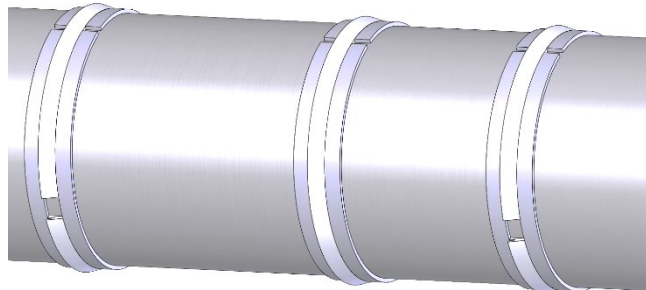
Step 5:



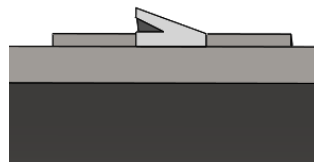
Convection brake should be slightly deformed according to the picture. This should facilitate the assembly.

Step 6:

Assemble new convection brakes Make sure to correctly align the convection brake to ensure full functionality. Also, the convection brake openings should be offset from each other as shown in the picture.



Side of metal bellows



Side of control plug

7. Marking

The valve housing is marked with following information:

Manufacturer sign
Order number
Tag number
Year of manufacture
Material
DN XXX / PN XX
PED marking
Flow direction (Represented by an arrow)

Ex

if the valve is used in a hazardous area, the Ex marking is attached to the housing.

The valve may only be used for the purposes recorded on the technical drawing and the marking on the product.



8. Commissioning and operation

8.1 General information

To ensure long service life of the valves, the following information must be observed:



- Loose parts must be (re-)tightened.
- The valve must not be blocked.
- If liquids leak from the valve, operation must be stopped and the manufacturer must be contacted.
- If the valve is iced up, operation must be stopped and the manufacturer must be contacted.
- If the valve does not perform its full stroke, operation must be stopped and the manufacturer must be contacted.
- A stroke check must always be performed to make sure that all parts are correctly assembled. In case of clamping/jamming or friction noise, operation must be stopped immediately and the cause must be investigated.

Establish the electrical and pneumatic connections for all pneumatic (e.g. solenoid valves, pneumatic drives, position controllers) and electrical (e.g. switches, position controllers) components according to the technical drawing of the valve.

Prior to commissioning of a new system and particularly after repair work, the entire piping system must be purged. For that purpose, all valves must be put in the open position. In this process, all hazardous particles, such as chips and welding beads are removed.

Ex

Missing potential equalization can cause static charge, which may result in sparking and lead to explosions. Connect the metallic housing of the valve with the potential equalization conductor of the system

Possible potential equalisation methods:

- Weld the weld sockets (process connection) to the earthed piping system.
- If none of these are possible, set up a wire or cable connection of at least 4mm² via a clamp to the potential equalization conductor of the system.



- The connection points must be free of paint and well conductive.

Also, the accessories, like switches, actuator, etc. must be connected to the potential equalization system, if mentioned in their IOM.

Oxygen

Valves for oxygen service require special attention for assembly and disassembly. Dirt or the wrong equipment can lead to total damage. Only BAM-tested (approved for the area of application) seals or equipment are permitted. Cleaning according to WEKA specification no. 20150055 or similar must be observed



8.2 Manually actuated valves

Only exert force until the valve is tight. Too much force will damage the valve. If during operation it is found that increasing amounts of force are required for opening/closing of the valve, this is indicative of a defect. The process must be stopped and the manufacturer must be contacted.



Turning in clockwise direction closes the valve.

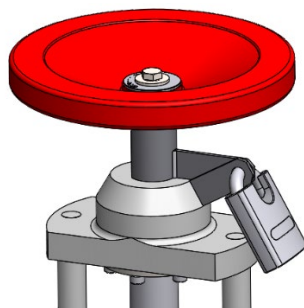


Turning in counter-clockwise direction opens the valve.

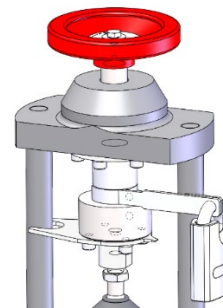


Locking option

For some valve types, it is possible to lock the valves either in open or closed position using a padlock. The locking device must be opened before turning the hand wheel.



Valve open lock

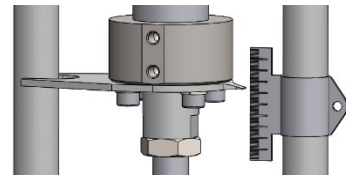


Valve closed lock

Stroke indicator

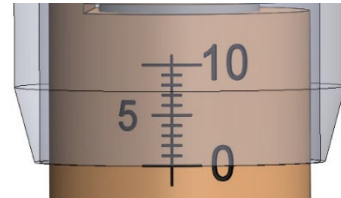
HL manual drive

With the HL manual drives, a stroke scale is fixed to the column.




Hlc/Hlcp manual drive

With the Hlc/Hlcp manual drives, a stroke scale is engraved into the upper part.



With precision manual drives (Hlcp), an additional vernier scale is lasered into the hand wheel.



Alignment of the manual drive

If the manual drive is in an unsuitable position to install the cables and the connection for the position / end switch, the alignment can be adjusted by turning the sleeve nut or the flange (from DN80).

For description of the work steps, please see chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve and/or chapter 6.5.6 Assembly of a TxV DNxx/PNxx valve.

8.3 Pneumatic valves

- The compressed air values must comply with the pneumatic diagram in the customer's drawing.
- Control the valve by applying the appropriate input signal to the control signal element of the valve (e.g. position controller or solenoid valve).
- Always connect the pneumatic air pressure line to the valve according to the pneumatic diagram in the customer's drawing.



Attention:

During operation, the actuator and/or coupling move with substantial force. Risk of injury! Keep your hands off the actuator!



Compressed-air supply:

To achieve trouble-free operation of the position controller, dry, clean, and oil-free instrument air is required.

Unless otherwise specified by the manufacturer of the attached pneumatic components, the minimum required compressed-air quality as per ISO/DIS 8573-1:

- Size and density of solids: Class 3
- Pressure dew point: Class 3 (minimum 20 K below ambient temperature)

Travel limiting

travel limiting function of the actuator must be performed according to Samson's data sheet.

Alignment of the drive

If the drive is in an unsuitable position to install the cables and the connection for the position / end switch, the alignment can be adjusted by turning the sleeve nut or the flange (from DN80).

For description of the work steps, please see chapter 6.5.6 Disassembly of a TxV DNxx/PNxx valve and/or chapter 6.5.6 Assembly of a TxV DNxx/PNxx valve.

8.4 Electrical and pneumatic additional components

If applicable, electrical signal values are defined in the technical drawings.

Initialization of the position controller:

The valves are already initialized with the positioner.

WEKA AG recommends re-initializing the position controllers during commissioning of the valves. For instructions for this process, either contact WEKA AG or download them directly from the homepage of the position controller supplier.

Various extra components

The valves can be equipped with various extra components, such as sensors, switches, solenoid valves, etc. Connect the components to your monitoring system. For instructions of this process either contact WEKA AG or download them directly from the homepage of the component manufacturer.

Please Note:

Attaching and adjusting inductive sensors shall be performed according to chapter

8.4.1 Attaching and adjusting inductive sensors

If any topic regarding attaching and adjusting inductive sensors is not clear to you, please do not hesitate to contact us.

8.4.1 Attaching and adjusting inductive sensors

Assembly of the necessary components

The work must be performed in a clean environment using suitable tools.



**Tools**

The required tools are listed in the respective chapters. Special tools or special auxiliary agents can be ordered from WEKA AG. They are not included in the scope of delivery.

Previous knowledge

A certain amount of previous knowledge of mechanical handling is mandatory to prevent damage to the valve. Tightening of fasteners, such as screws and nuts, must be performed according to generally applicable mechanical engineering guidelines.

Training

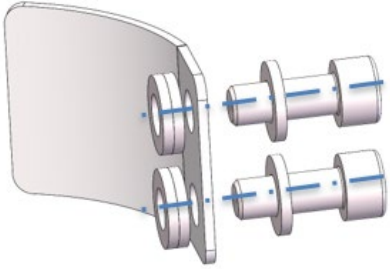
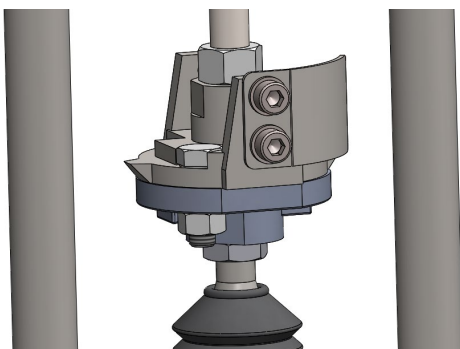
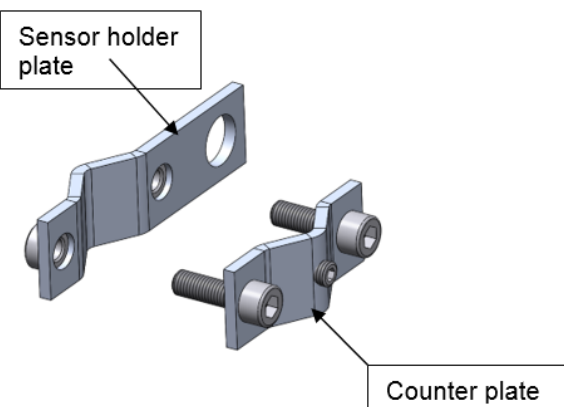
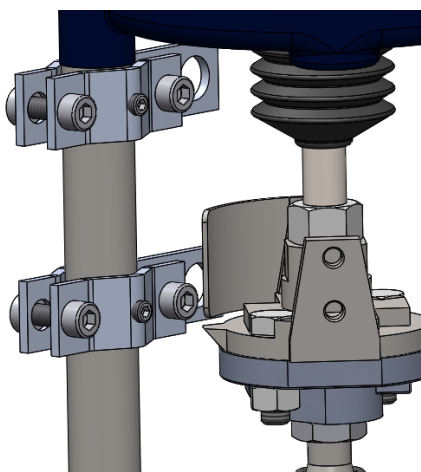
WEKA AG offers training courses in addition to this manual; participants receive valuable advice to make their work and specific work steps easier

Required tools and auxiliary agents

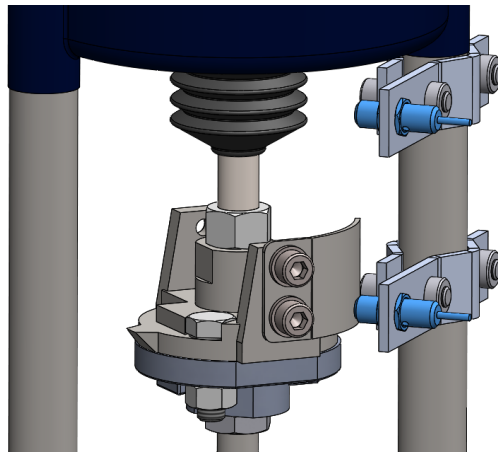
Allen-type wrench, 5mm

Allen-type wrench, 3mm

Open-end spanner acc. datasheet of inductive sensor

Step	Picture	Description
Additional note: Depending on the nominal width of the valve, the components may slightly vary in appearance. However, the steps remain the same.		
1		Assemble the parts of the sensor counter plate Includes: 2x screw M6x16 6x washer D12/6.4x1.6 1x sensor counter plate
2		Attach the whole unit to the actuator coupling. Tighten both screws with an Allen-type wrench, 5mm
3		Assemble the parts of the sensor holder unit Includes: 2x screw M6x20 1x grub screw M6x6 1x sensor holder 1x counter plate of sensor holder Note the orientation of the sensor holder unit!
4		Mount the sensor holder unit on the pillar. If two inductive sensors are required, then two units must be mounted The grub screw should still be completely loose. The two screws can easily be tightened hand-tight Note the orientation of the sensor holder unit!

5



Mount the desired inductive sensor with tools according to the inductive sensor datasheet.

Set the inductive sensor / sensor holder unit to the correct positions. There are further notes in chapter 2

After that:

Tighten both screws with an Allen-type wrench, 5mm. Torque: 6Nm

Tighten grub screw with an Allen-type wrench, 3mm Torque: 5Nm

8.5 Operation Conditions

The operating and ambient conditions may be restricted for products for use in potentially explosive atmospheres. Please comply with the information on the technical drawing and the marking on the product.



Ambient and fluid temperature range

Ambient and fluid temperature ranges are defined on the technical drawing of the valve.

Temperature class

The Ex marking indicates the temperature class from T3...T6. The following table applies:

Max. fluid temperature	Temperature class
+75°C	T6
+125°C	T4
+150°C	T3



Maximal allowed pressure

For the maximum allowed pressure please refer to the technical drawing of the valve.

9. Maintenance

9.1 General information

The valve components are designed to be largely maintenance-free.

Selection of optimum material combination limits wear to an absolute minimum. Make sure to keep the system clean during operation. Particularly valves that are accessed only rarely or are difficult to reach need to be checked carefully and thoroughly to ensure their proper function. The recommended spare parts are listed in the valve drawing and can be generally supplied within a few days. However, WEKA AG recommends keeping a set of seals, comprising the seat seal, dynamic safety seal, static seal and static safety seal (see drawings), in stock.

Inspection of the seals and the control cone is generally only performed during a maintenance interval of a system. WEKA AG recommends disassembling the valves and replacing the seals at least every 5 years.

Ex

The valve may only be repaired and modified by the manufacturer (or, if appropriate, in consultation with the notified body).

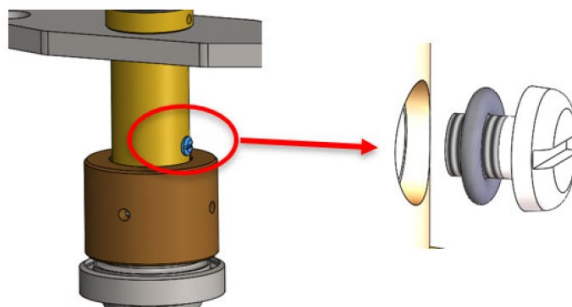


9.2 Orifice hole

Tightness of the insert to the outside can be tested by means of the orifice hole. By removing the screw from the orifice hole, a leakage test can be started to check the unit for tightness. Depending on the result of the test, maintenance may be required.



Especially in Ex applications it is recommended to check the tightness on a regular interval.



Please note:

Over time, the pressure in the small test chamber will increase due to a slight natural leakage rate. Gas escapes through the o-ring. With normally acting seals, a pressure increase is only experienced after several months. During this period, the enclosed gas may reach pressure values that can be identified by a characteristic gas escape noise. This is not an unusual or dangerous operating condition.



10. Spare parts

All spare parts are listed in the technical drawing of the valve.

For spare parts' requests, please contact us at the address below and always state the valve number and the correct spare parts number according to the specifications in the technical drawing.

WEKA AG

Schürlistrasse 8
CH-8344 Bäretswil
Switzerland

Phone: +41 (0)43 833 43 43

Fax: +41 (0)43 833 43 49

Email: info@weka-ag.ch

Web: www.weka-ag.ch

11. Disassembly and disposal

Disassembly

Before starting disassembly, make sure that the fittings are depressurized, drained and de-energized. Dismantling may only be carried out by qualified personnel.

Disposal

The device is predominantly made of steel (apart from the sealing components and any equipment parts) and must be disposed of in accordance with the locally applicable disposal regulations. It must be ensured that the parts are neither contaminated by the medium nor contaminated in any other way.


12. Declarations of conformity**WEKA AG · Switzerland**Schürlistrasse 8 · CH-8344 Bäretswil · Phone +41 43 833 43 43 · info@weka-ag.ch · www.weka-ag.ch**EU-KONFORMITÄTSERKLÄRUNG
EU DECLARATION OF CONFORMITY****Wir / We****WEKA AG**

(Name des Herstellers) (Manufacturers name)

erklären in alleiniger Verantwortung, dass das Produkt
declare under our sole responsibility that the product**Kryo-Ventil / Cryogenic valve****Typen / Types:** TDV, TEV, TGV, TYV, TZV, WDV, WEV, WGV, WZV**Ausführung / Execution:** PM-, PK-, Hlc-, Hlcp-, Hls-, Hlsp-, HL-, EG-
d, g, f(Bezeichnung Typ oder Modell, Los-, Chargen- oder Seriennummer, möglichst Herkunft und Stückzahl)
(Name, type or model, lot, batch or serial number, possibly sources and numbers of items)auf das sich diese Erklärung bezieht, mit den folgenden Normen oder normativen Dokumenten übereinstimmt
to which this declaration relates is in conformity with the following standards or other normative documentsDIN EN 12516-2:2015-01
EN ISO 80079-36:2016
EN ISO 80079-37:2016(Titel und/oder Nummer sowie Ausgabedatum der Normen oder der anderen normativen Dokumente)
(Title and/or number and date of issue of the standards or other normative documents)**Gemäss den Bestimmungen der Richtlinie(n)**
Following the provisions of directive(s)
(falls zutreffend) (if applicable)

2014/68/EU (PED)	Art 4.3	WEKA AG (Art. 4.3)	
Qualitätssicherung /	Kat. I	WEKA AG (CE) Modul / module A	
quality assurance	Kat. ≥ II	DNV (CE 0575) Modul / module H	PEDH000000R
		DNV (CE 0575) Modul / module H1	PEDH10000017
		DNV AS, Veritasveien 1, 1363 Høvik, Norway	

2014/34/EU (ATEX)	Eurofins Conformity Statement	SEV 19 ATEX 0321
	Eurofins AG, Luppenstrasse 3, 8320 Fehraltorf, Switzerland	

(Richtlinie, Geltungsbereich / Kategorie, ggf. Name, Nummer und Anschrift der notifizierten Stelle)
(Directive, scope / category, if necessary name, number and address of notified body)(Ort und Datum der Ausstellung)
(Place and date of issue)(Name und Unterschrift des Befugten)
(Name and signature of authorized person)**Bäretswil, 19.04.2022**
Marc Hofmann
(Quality Manager)
Pascal Erni
(Product Manager)

WEKA_DoC_EU TxV WxV Ex_DE_EN / 2022-04-19

1 / 5



Conformity Statement

- (1)
- (2) Equipment or protective system intended for use in potentially explosive atmospheres - **Directive 2014/34/EU**
- (3) Certificate number: **SEV 19 ATEX 0321**
- (4) Product: Cryogenic valves TzxV, WzxV, BV
- (5) Manufacturer: WEKA AG
- (6) Address: Schürlistrasse 8, 8344 Bäretswil, Switzerland
- (7) This product and any acceptable variation thereto are specified in the schedule to this certificate and the documents therein referred to.
- (8) Eurofins certifies that this product has been found to comply with the essential health and safety requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres given in Annex II to Directive 2014/34/EU of the European parliament and of the Council, dated 26 February 2014. The examination and test results are recorded in confidential report no. 19CH-00533.X03
- (9) Compliance with the essential health and safety requirements has been assured by compliance with:
EN ISO 80079-36:2016
EN ISO 80079-37:2016
Except in respect of those requirements listed at item 18 of the schedule.
- (10) If the sign «X» is placed after the certificate number, it indicates that the product is subjected to special conditions for safe use specified in the schedule to this certificate. The sign "U" is placed after the certificate number. It indicates that this certificate must not be mistaken for a certificate intended for an equipment or protective system. This partial certification may be used as a basis for certification of an equipment or protective system.
- (11) This Conformity Statement relates only to the design and construction of the specified product and not to specific items of product subsequently manufactured.
- (12) The marking of the product shall include the following:

**II 2 G Ex h IIC T6 ...T3 Gb****Eurofins Electric & Electronic Product Testing AG**
Notified Body ATEXMartin Plüss
Product Certificationwww.eurofins.ch

Fehraltorf, 2021-06-17

Issue: 2

Page 1 of 4



(13) Appendix

(14) Conformity Statement no. SEV 19 ATEX 0321

(15) Description of product

The above-mentioned valves are used as shut-off valves or control valves to regulate fluids (gases or liquified gases). The flow is usually controlled by an actuator (pneumatic, electric or manual) by moving the insert to open/close the valve. The actuator is not part of this certification. It is separate certified.

TzxV

The housing is usually integrated in a vessel and thermic insulated by vacuum. For the implementation in the piping of customers application there are several designs available to get an optimal connection. The 'outer' part is placed on the 'warm' side of the valve (ambient temperature range).

WzxV and BV

These valves are usually not thermic insulated. The housing is implemented in the piping of customers application. There are several designs available to get an optimal connection. Valve and accessories are under environmental conditions.

For Ex applications there are two possible cases to be considered:

1. Explosion hazardous atmosphere inside the valve.
2. Explosion hazardous atmosphere outside the valve.

A typical application concerning Ex protection is the use of the valve for Hydrogen application. In normal operation the Hydrogen flow is controlled by the valve. The Hydrogen is pure and liquefied (-254°C). There is no explosive atmosphere inside or outside the valve.

While setting the system to work, for a shut-down or maintenance there could get Oxygen into the system and creates an explosive atmosphere. Also, a leakage could cause a mixture of Hydrogen and air and therefore an explosive atmosphere outside the valve.

These considerations result in a division concept of zone 2 or rarely in zone 1.

A further thinkable constellation is a valve for Helium (inert gas) in an LNG (Liquid Natural Gas) environment. In this case only the outer parts of the valve are influenced by the Ex protection (incl. actuator and accessories). There is no zone specified for the inner side of the valve but Zone 1 or 2 for the outer side of the valve.

Classification of installation and use:	stationary
Ingress protection:	More than IP66
Rated ambient temperature range (°C):	-40 °C to +150 °C
Liquid temperature range (°C):	-271.15 °C to +150 °C
	Depending of temperature class and type.
	See type description

Rated ambient temperature range (°C) for Ex Components	---
---	-----

Dependence of the temperature class on the maximum liquid temperature

Temperature class	Maximum fluid temperature
T6	+75 °C
T4	+125 °C
T3	+150 °C

Type key

...	-	...	...	...	V	DN...	/	PN...	...	-	...	h=...
1.		2.	3.	4.	5.	6.	7.	8.	9.		10.	11.

1. Type of actuator
could be pneumatic, electric or manual
Is not part of this certificate and must be checked separately for each case (must be certified separately). See notes for type key below for more information.
2. Valve type (warm or cold)
T: cryogenic valve, basic type of valve for deep temperature fluids (cold valve), typical below -196°C
W: warm valve, basic type of valve for higher temperatures (warm valve)
B: break valve (warm or cold valve with special kv characteristic)
3. Special parameter (guard connection, vacuum test connection, flanged)
empty = no specialities (standard)
b: valve design stainless steel (all outer parts in stainless steel 316/316L)
c: valve design stainless steel with marine type approval code (all outer parts in stainless steel 316/316L, weld seams can be x-rayed, static seal with c-ring, no pressure bearing thread > 25mm)
d: connection for integral vacuum test
f: flanged connection between valve housing and pipe
g: with a He guard sealing to outside i.e. full double seal
h: Static, metallic sealing (Helicoflex)
Remark: The digit can be omitted or it can be a simple parameter, but it can also be combined up to 4 digits. E.g. "omitted" aa-TEQV DN250/PN40 or E.g. combined up to 4 aa-TbdfhEQV DN250/PN40
4. Valve body pattern
E: valve body in angle pattern
D: valve body in globe pattern, welded
G: valve body in globe pattern
Y: valve body in Y-pattern, 45°
Z: valve body with slanted in- and outlet nozzles
5. Stem sealing type
Empty = bellow sealing with safety sealing
Q: Quad ring sealing, without safety sealing
F: spring-loaded Quad ring stem sealing (typical for high pressure valves)
6. V: for "valve", fixed
7. DN.: nominal size in "mm"
8. PN.: nominal pressure in "bar", specify also the max. allowable working pressure (T<=amb.)



9. Control type (control valve or shut-off valve)

D: shut-off valve

C: control valve

10. Actuator mode

Is not part of this certificate and must be checked separately for each case (must be certified separately)

For pneumatic actuators the mode is added

Po: pneumatic valve, normally closed i.e. less of air supply valve closed

Ps: pneumatic valve, normally open i.e. less of air supply valve open

11. Cryogenic length

h=...: cryogenic length, h in "mm

empty: without cryogenic length i.e. warm-valve

Notes about type key:

Type of actuator

PM: valve with pneumatical diaphragm actuator

PK: valve with pneumatical piston actuator

PKS: valve with pneumatical piston actuator and springs (safety valve)

HL valve with manual drive, pillar design

HI: valve with manual drive, integral design

HIc valve with manual drive, integral design, compact

HIcp valve with manual drive, integral design, compact, precision with nonius

HIsc valve with manual drive, integral design, switch controlled

HIsp valve with manual drive, integral design, switch controlled, precision with nonius

EG: valve with electrical actuator

Ambient temperature range:

For the part of the valve which is outside the cold, insulated area

-40°C bis +60°C

Fluid temperature range:

TxV -271.15°C bis +50°C

WxV -30°C bis +50°C

BV -40°C bis +150°C

(16) Specific conditions of use

None

(17) Essential health and safety requirements

In addition to the essential health and safety requirements (EHSRs) covered by the standards listed at item 9, the following are considered relevant to this product, and conformity is demonstrated in the report:

Clause	Subject
None	

(18) Drawings and documents

Number	Sheet	Issue date	Description
See Test Report "Manufacturer's Documents"			

www.eurofins.ch

Fehraltorf, 2021-06-17

Issue: 2

Page 4 of 4



**WEKA AG · Switzerland**

Schürlistrasse 8 · CH-8344 Bäretswil · Phone +41 43 833 43 43 · info@weka-ag.ch · www.weka-ag.ch

EU-KONFORMITÄTSERKLÄRUNG EU DECLARATION OF CONFORMITY

Wir / We**WEKA AG**

(Name des Herstellers) (Manufacturers name)

erklären in alleiniger Verantwortung, dass das Produkt
declare under our sole responsibility that the product**Kryo-Ventil / Cryogenic valve****Typen / Types:** TDV, TEV, TGV, TYV, TZV, WDV, WEV, WGV, WZV
TDQV, TEQV, TGQV, TEcQV, WDQV, WEQV, WGQV**Ausführung / Execution:** PM-, PK-, Hlc-, Hlcp-, Hls-, Hlsp-, HL-, EG-
d, g, f(Bezeichnung Typ oder Modell, Los-, Chargen- oder Seriennummer, möglichst Herkunft und Stückzahl)
(Name, type or model, lot, batch or serial number, possibly sources and numbers of items)auf das sich diese Erklärung bezieht, mit den folgenden Normen oder normativen Dokumenten übereinstimmt
to which this declaration relates is in conformity with the following standards or other normative documents**DIN EN 12516-2:2015-01**(Titel und/oder Nummer sowie Ausgabedatum der Normen oder der anderen normativen Dokumente)
(Title and/or number and date of issue of the standards or other normative documents)**Gemäss den Bestimmungen der Richtlinie(n)**
Following the provisions of directive(s)
(falls zutreffend) (if applicable)

2014/68/EU (PED)	Art 4.3	WEKA AG (Art. 4.3)	
Qualitätssicherung /	Kat. I	WEKA AG (CE) Modul / module A	
quality assurance	Kat. ≥ II	DNV (CE 0575) Modul / module H	PEDH000000R
		DNV (CE 0575) Modul / module H1	PEDH10000017
		DNV AS, Veritasveien 1, 1363 Høvik, Norway	

(Richtlinie, Geltungsbereich / Kategorie, ggf. Name, Nummer und Anschrift der notifizierten Stelle)
(Directive, scope / category, if necessary name, number and address of notified body)(Ort und Datum der Ausstellung)
(Place and date of issue)**Bäretswil, 19.04.2022**(Name und Unterschrift des Befugten)
(Name and signature of authorized person)
Marc Hofmann
(Quality Manager)
Pascal Erni
(Product Manager)